


# OIL ANALYSIS REPORT

Sample Rating Trend



**WATER**

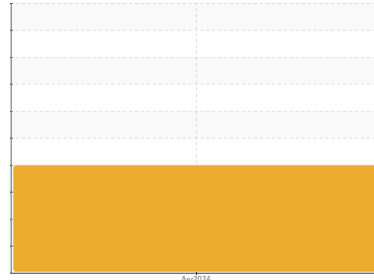

Machine Id

**LEROI 112722 (S/N LE19442)**

Component

**Rotary Compressor**

Fluid

{not provided} (--- GAL)

**DIAGNOSIS**

**▲ Recommendation**

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**▲ Contamination**

There is a high amount of particulates present in the oil. There is a moderate concentration of water present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TO90004037</b>	---	---
Sample Date	Client Info			<b>04 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	<b>2</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>3	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>3	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>4</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>45</b>	---	---
Zinc	ppm	ASTM D5185m		<b>8</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>446</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>45	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>7</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Water	%	ASTM D6304	>0.6	<b>▲ 0.913</b>	---	---
ppm Water	ppm	ASTM D6304		<b>▲ 9134</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>▲ 127601</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>▲ 31108</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>▲ 8649</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>▲ 4518</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>▲ 269</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>3</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>▲ 24/22/20</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.30</b>	---	---

# OIL ANALYSIS REPORT

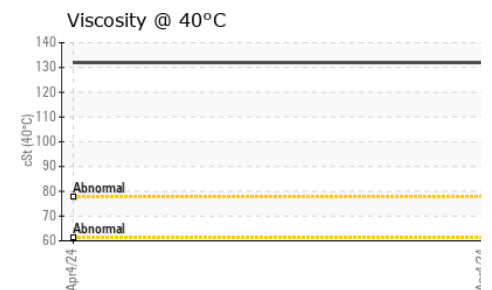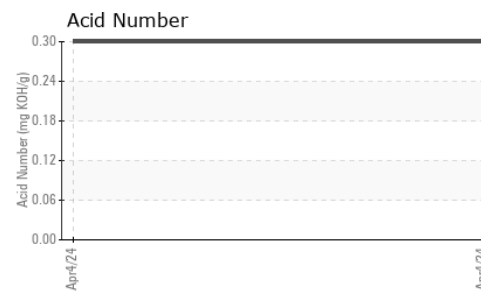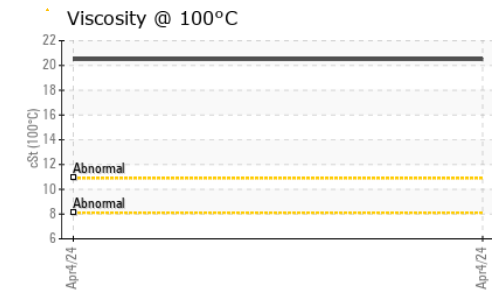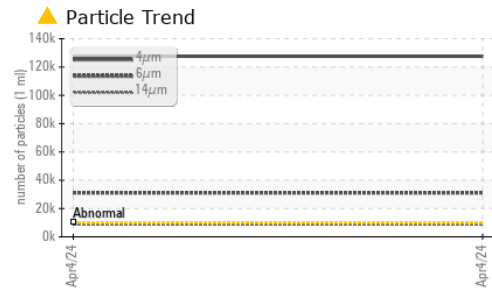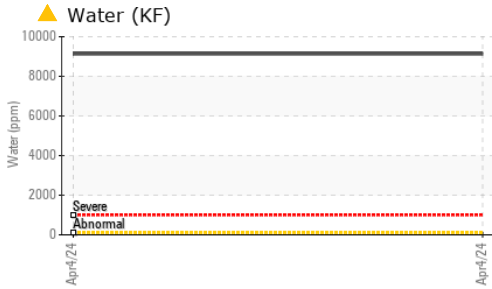




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.6	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	132	---	---
Visc @ 100°C	cSt	ASTM D445	20.5	---	---
Viscosity Index (VI)	Scale	ASTM D2270	179	---	---

**SAMPLE IMAGES**

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

**GRAPHS**

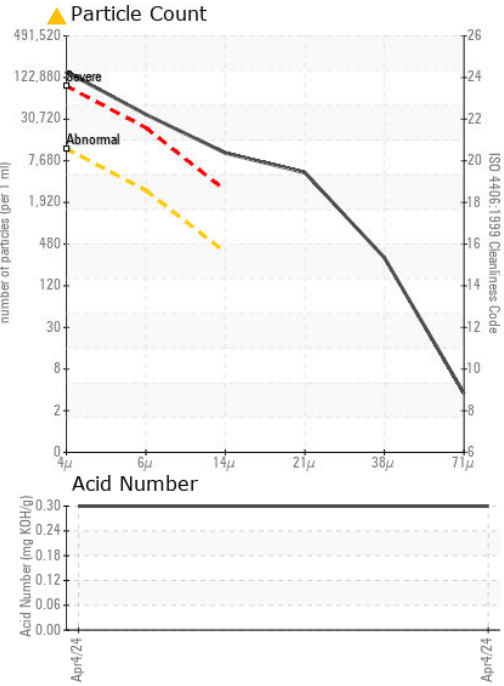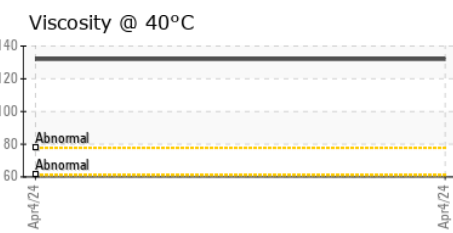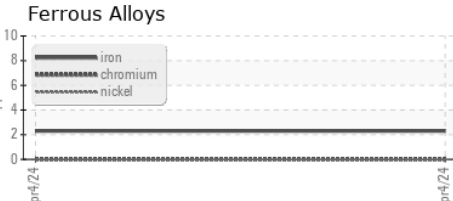

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO90004037  
**Lab Number** : 06145305  
**Unique Number** : 10970113  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )  
**Received** : 10 Apr 2024  
**Tested** : 12 Apr 2024  
**Diagnosed** : 15 Apr 2024 - Jonathan Hester

**CIMARRON ENERGY - CARLSBAD**  
 4425 GRANDI RD, UNIT F  
 CARLSBAD, NM  
 UM 88220-8923  
 Contact: CARLOS LEAL  
 cleal@cimarron.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)