




# OIL ANALYSIS REPORT

Sample Rating Trend

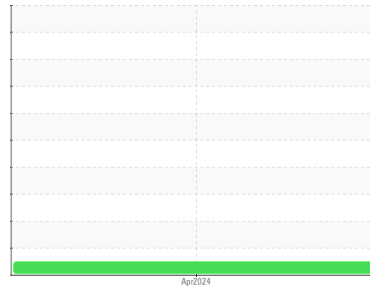

**NORMAL**



Area

## SYNOIL 8K PLUS

Machine Id

### INGERSOLL RAND UP6-10TAS-125-WDR VP6580U07233 - RLS MACHINE

Component

#### Compressor

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### Contamination

There is no indication of any contamination in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ06145321</b>	---	---
Sample Date	Client Info			<b>03 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>2418</b>	---	---
Oil Age	hrs	Client Info		<b>258</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>15	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>65	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>65	<b>1</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	0.9	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	0.2	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	0.1	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m	429	<b>420</b>	---	---
Zinc	ppm	ASTM D5185m	0.3	<b>60</b>	---	---
Sulfur	ppm	ASTM D5185m	1336	<b>1049</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>3</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	<b>0.34</b>	---	---



# OIL ANALYSIS REPORT

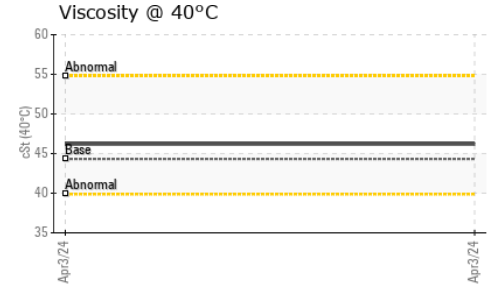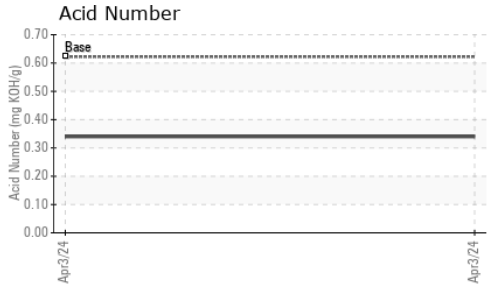




VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.32	<b>46.2</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

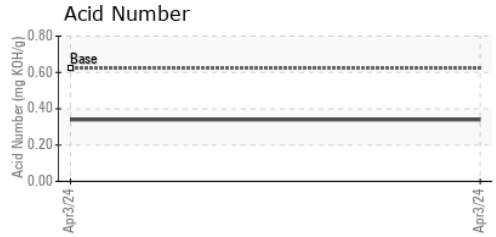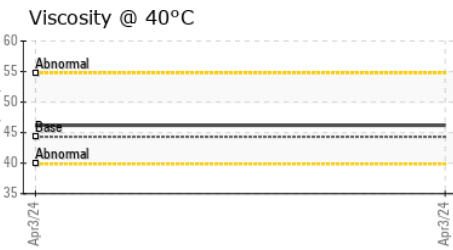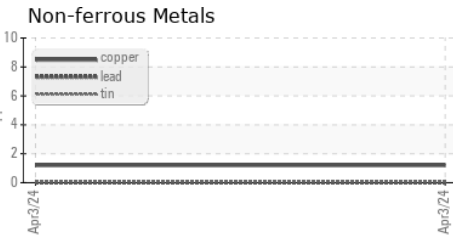

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06145321      **Received** : 10 Apr 2024  
**Lab Number** : **06145321**      **Tested** : 12 Apr 2024  
**Unique Number** : 10970129      **Diagnosed** : 14 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**ZORN COMP & EQUIPMENT CO (GB)**  
 733 POTTS AVE  
 GREEN BAY, WI  
 US 54304

Contact: DEAN SCHAD  
 dean.schad@zornair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (920)391-8121

F: (920)499-1168