




# OIL ANALYSIS REPORT

## Sample Rating Trend

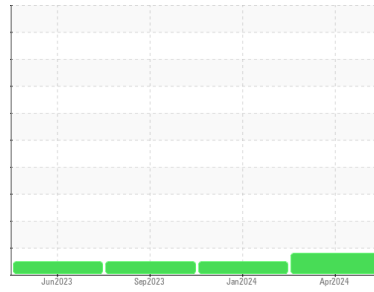

ISO



Machine Id  
**HSC-4**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0007808</b>	USP0004651	USP255098
Sample Date	Client Info			<b>04 Apr 2024</b>	03 Jan 2024	18 Sep 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>&lt;1</b>	4	<1
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	1	0
Lead	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>4	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	1
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	50	<b>0</b>	0	0






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	1	1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Water	%	ASTM D6304	>0.01	<b>0.001</b>	0.002	0.006
ppm Water	ppm	ASTM D6304	>100	<b>13</b>	25	68.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>19060</b>	1122	1194
Particles >6µm		ASTM D7647	>2500	<b>2063</b>	221	245
Particles >14µm		ASTM D7647	>320	<b>50</b>	9	16
Particles >21µm		ASTM D7647	>80	<b>10</b>	3	4
Particles >38µm		ASTM D7647	>20	<b>0</b>	1	1
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>21/18/13</b>	17/15/10	17/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	<b>0.055</b>	0.014	0.013



# OIL ANALYSIS REPORT

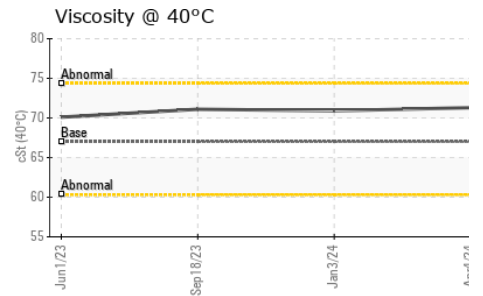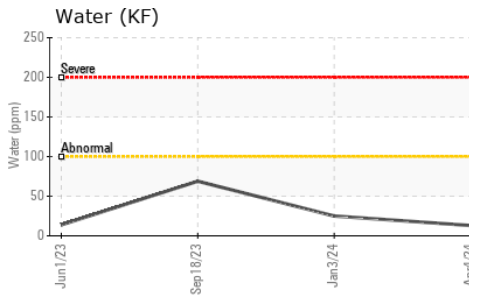
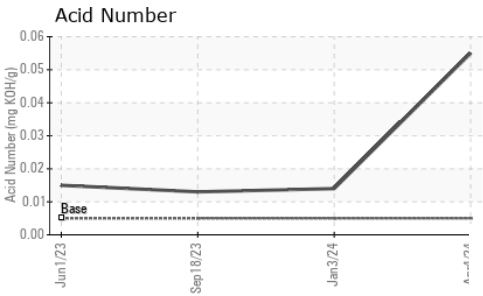
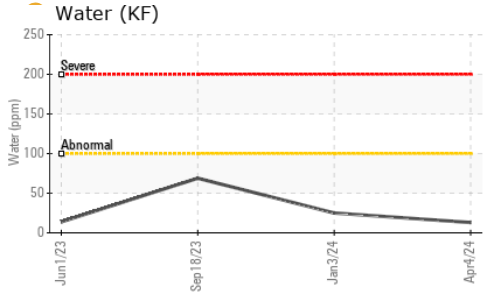
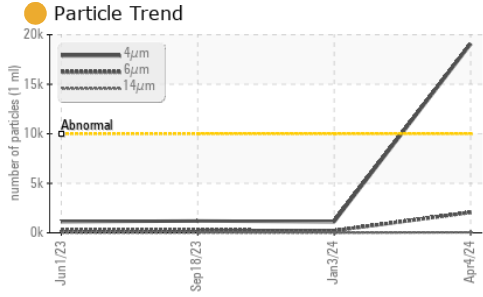


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	71.3	70.9	71.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

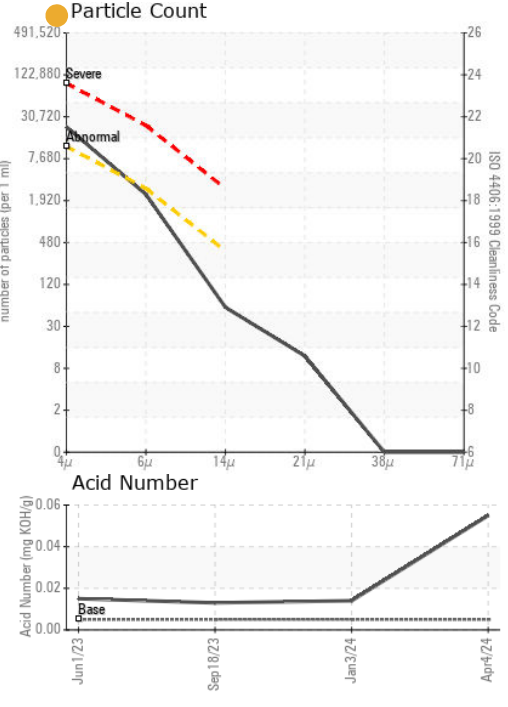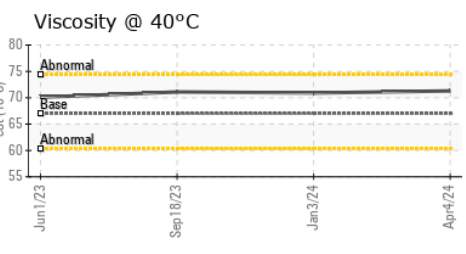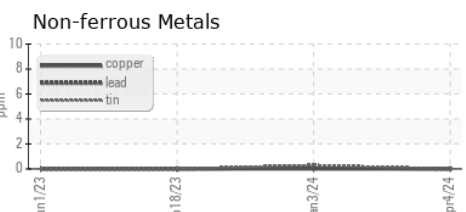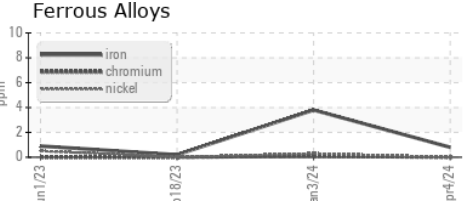

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP007808      **Received** : 11 Apr 2024  
**Lab Number** : 06145929      **Tested** : 12 Apr 2024  
**Unique Number** : 10976007      **Diagnosed** : 12 Apr 2024 - Doug Bogart  
**Test Package** : IND 2

**CONAGRA - WASECA NEW PLANT**  
 2351 BROWN AVE  
 WASECA, MN  
 US 56093  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)