


OIL ANALYSIS REPORT

AIRLUBE 228 **ATLAS COPCO API623579 - PLASTIC OMNIUM 5** Component Compressor



Sample Rating Trend



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06145965	UCH04249517	
Sample Date		Client Info		25 Mar 2024	25 Jun 2017	
Machine Age	hrs	Client Info		34236	4357	
Oil Age	hrs	Client Info		2447	4357	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	1	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	<1	
Chromium	ppm	ASTM D5185m	>5	<1	0	
Nickel	ppm	ASTM D5185m		<1	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>15	2	0	
Lead	ppm	ASTM D5185m	>65	1	<1	
Copper	ppm	ASTM D5185m	>65	7	0	
Tin	ppm	ASTM D5185m	>10	1	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1.5	0	0	
Barium	ppm	ASTM D5185m	0	0	0	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m	0.3	<1	0	
Magnesium	ppm	ASTM D5185m	0	<1	0	
Calcium	ppm	ASTM D5185m	0	3	0	
Phosphorus	ppm	ASTM D5185m	406	106	6	
Zinc	ppm	ASTM D5185m	0	5	20	
Sulfur	ppm	ASTM D5185m	1283	55	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0	0	
Sodium	ppm	ASTM D5185m		0	2	
Potassium	ppm	ASTM D5185m	>20	1	0	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.463

0.817


1.02





OIL ANALYSIS REPORT

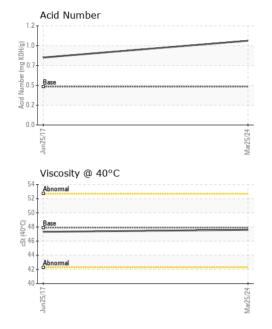


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERT	IFS	method	limit/base	current	history1	history2
						Historyz
Visc @ 40°C	cSt	ASTM D445	47.9	47.6	47.31	
SAMPLE IMAGES	8	method	limit/base	current	history1	history2
Color						no image
Bottom						no image
0.5.1.5.1.0						
GRAPHS						
GRAPHS Ferrous Alloys						













Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

: UCH06145965 Lab Number : 06145965

Unique Number : 10976043

Test Package : IND 2

Received : 11 Apr 2024 **Tested** : 12 Apr 2024 Diagnosed

: 15 Apr 2024 - Don Baldridge

AIR TECHNOLOGIES INC (DET-LIV) 11771 BELDEN CT LIVONIA, MI US 48150-1446

Contact: MICHAEL WYSZCZELSKI michael.wyszczelski@otcindustrial.com

T: (734)762-9247 F: (734)762-9248

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)