

Area


**PALASYN 45**

Machine Id

**SULLIVAN PALATEK 19EE000145 - WELLS LAMONT**

Component

**Compressor**

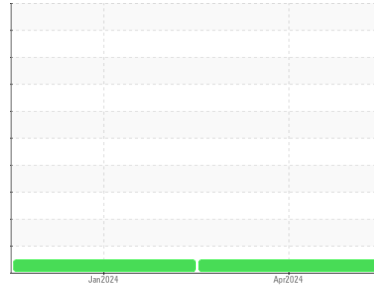

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>UCS06145971</b>	UCS06095689	---
Sample Date	Client Info	<b>02 Apr 2024</b>	25 Jan 2024	---
Machine Age	hrs	Client Info	<b>10813</b>	10379
Oil Age	hrs	Client Info	<b>1067</b>	633
Oil Changed	Client Info	<b>Not Chngd</b>	Not Chngd	---
Sample Status		<b>NORMAL</b>	NORMAL	---

**CONTAMINATION** method limit/base current history1 history2

Water	WC Method	>0.1	<b>NEG</b>	NEG	---
-------	-----------	------	------------	-----	-----

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>1</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>1</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>1</b>	0	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	0.0	<b>7</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m	0.0	<b>3</b>	0	---
Phosphorus	ppm	ASTM D5185m	966	<b>571</b>	614	---
Zinc	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	---
Sulfur	ppm	ASTM D5185m	1309	<b>1096</b>	1127	---


**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	1	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	---

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.10</b>	0.08	---
------------------	----------	------------	-------	-------------	------	-----


# OIL ANALYSIS REPORT

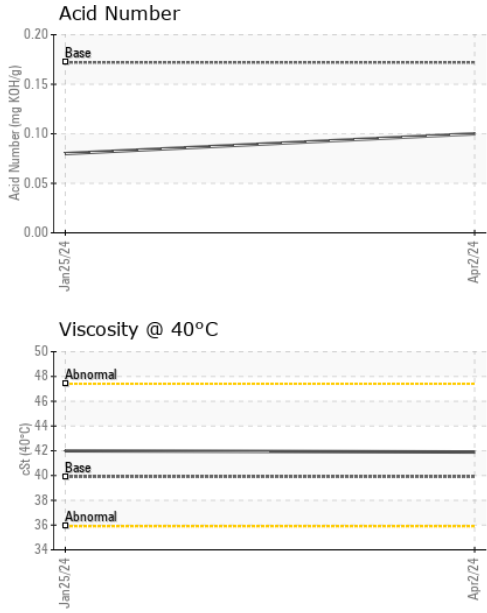





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>41.9</b>	42.0	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

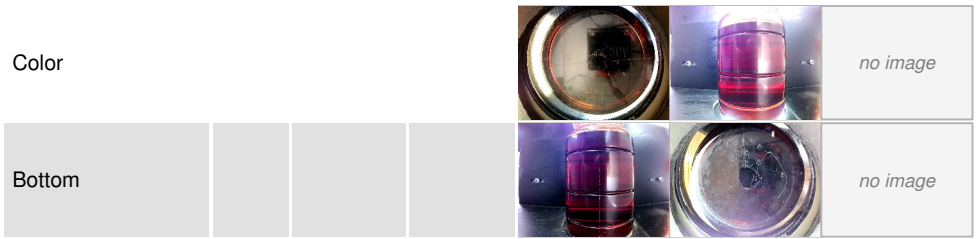

## GRAPHS

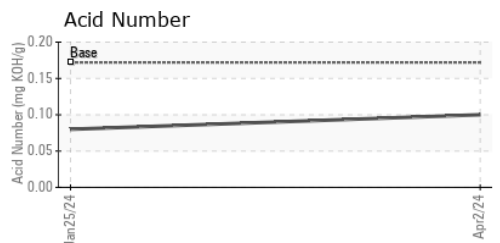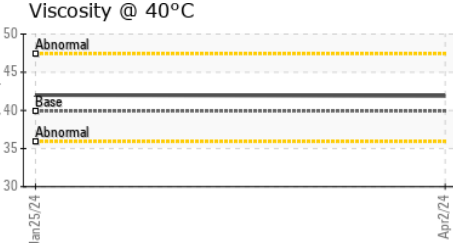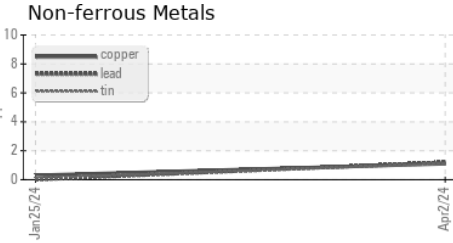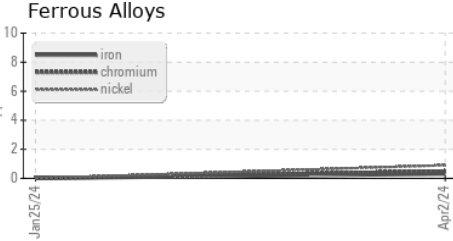

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06145971      **Received** : 11 Apr 2024  
**Lab Number** : **06145971**      **Tested** : 12 Apr 2024  
**Unique Number** : 10976049      **Diagnosed** : 15 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**BLAKE AND PENDLETON**  
 MEMPHIS, TN  
 US 38133  
 Contact: JAY GIANNINI  
 JGIANNINI@BLAKEANDPENDLETON.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)