




OIL ANALYSIS REPORT



Machine Id
Grand Blanc CAT 3 GBLM03BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

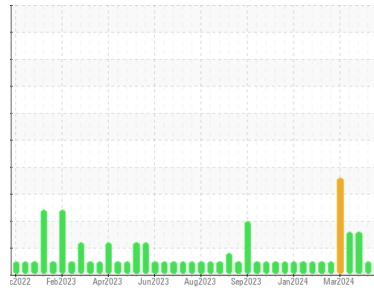

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0905754	WC0905737	WC0905729
Sample Date	Client Info		10 Apr 2024	25 Mar 2024	19 Mar 2024
Machine Age	hrs	Client Info	82825	82525	82267
Oil Age	hrs	Client Info	0	895	800
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			NORMAL	NORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	4	11	▲ 16
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m	<1	<1	0
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >6	2	2	3
Lead	ppm	ASTM D5185m >9	2	2	6
Copper	ppm	ASTM D5185m >6	5	12	▲ 17
Tin	ppm	ASTM D5185m >4	2	2	2
Vanadium	ppm	ASTM D5185m	<1	0	<1
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	4	9	12
Barium	ppm	ASTM D5185m	0	0	1
Molybdenum	ppm	ASTM D5185m	4	5	9
Manganese	ppm	ASTM D5185m	1	<1	<1
Magnesium	ppm	ASTM D5185m	9	11	25
Calcium	ppm	ASTM D5185m	1871	1817	1878
Phosphorus	ppm	ASTM D5185m	298	260	288
Zinc	ppm	ASTM D5185m	350	331	372
Sulfur	ppm	ASTM D5185m	3328	3761	3901

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	84	123	112
Sodium	ppm	ASTM D5185m >21	3	40	64
Potassium	ppm	ASTM D5185m >20	3	0	5

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	6.1	6.7	6.5
Sulfation	Abs/.1mm	*ASTM D7415	21.6	25.2	23.8


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	14.2	18.6	16.5
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	1.59	2.14	2.743
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	3.29	3.10	2.83




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

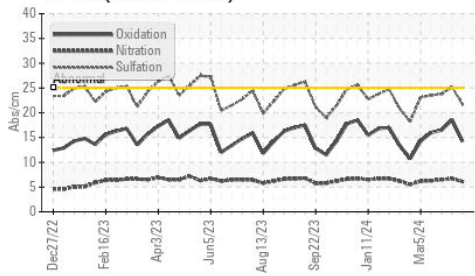


Acid Number

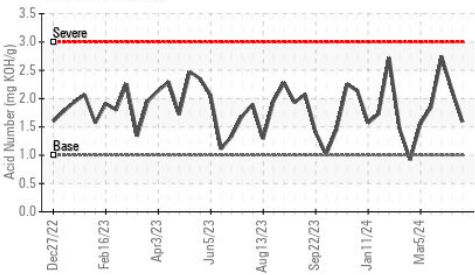

Base Number

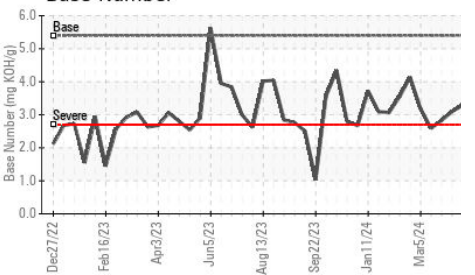

Viscosity @ 100°C

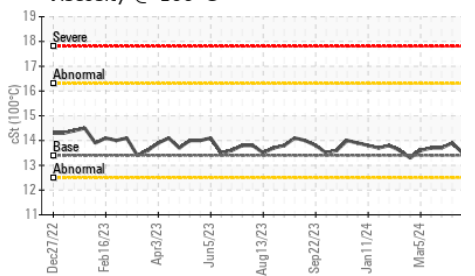


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.5	13.9

GRAPHS


Iron (ppm)

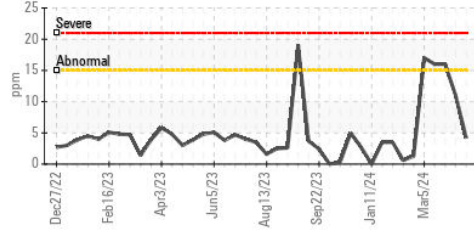


Lead (ppm)

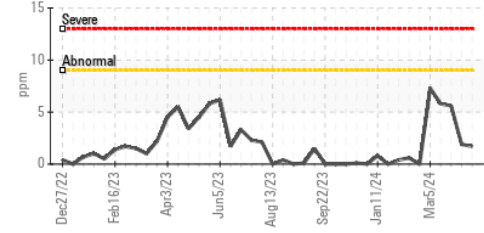


Aluminum (ppm)

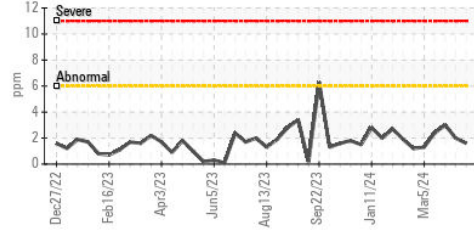


Chromium (ppm)

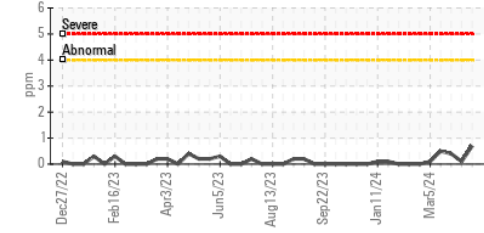


Copper (ppm)

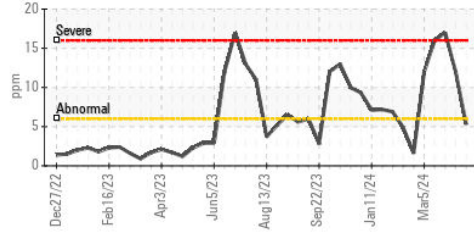


Silicon (ppm)

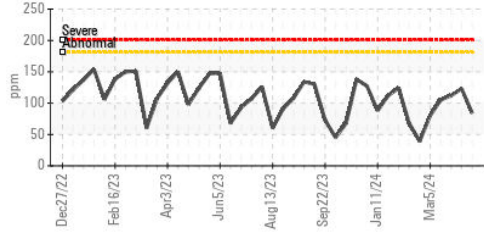

Viscosity @ 100°C

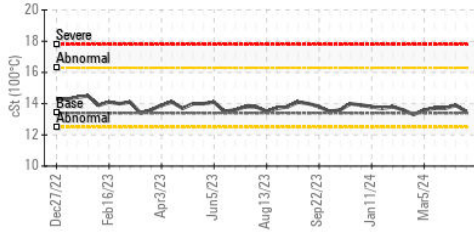

Base Number

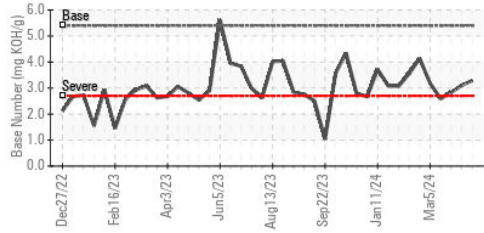

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0905754 **Received** : 11 Apr 2024
Lab Number : 06146058 **Tested** : 12 Apr 2024
Unique Number : 10976136 **Diagnosed** : 15 Apr 2024 - Don Baldrige
Test Package : MOB 2

EDL NA Recips-Grand Blanc
 Grand Blanc Powerstation, 2361 West Grand Blanc Road
 Grand Blanc, MI
 US 48439
 Contact: Tony Saint Marie
 tony.saintmarie@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)