OIL ANALYSIS REPORT

Sample Rating Trend

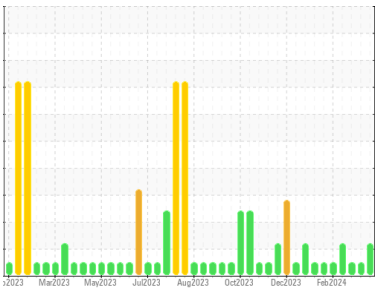

DEGRADATION

Machine Id
Grand Blanc CAT 5 GBLM05BE
Component
Biogas Engine
Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

DIAGNOSIS

Recommendation
The oil is near the end of it`s useful service life, recommend schedule an oil change. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is at the top-end of the recommended limit.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0905696**	WC0905746	WC0905745
Sample Date		Client Info		**10 Apr 2024**	03 Apr 2024	25 Mar 2024
Machine Age	hrs	Client Info		**59838**	59646	59436
Oil Age	hrs	Client Info		**0**	0	190
Oil Changed		Client Info		**N/A**	N/A	Changed
Sample Status				**ABNORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method	>.11	**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	**4**	2	1
Chromium	ppm	ASTM D5185m	>4	**<1**	0	0
Nickel	ppm	ASTM D5185m		**1**	0	0
Titanium	ppm	ASTM D5185m		**<1**	<1	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>6	**2**	2	2
Lead	ppm	ASTM D5185m	>9	**4**	0	0
Copper	ppm	ASTM D5185m	>6	**2**	<1	<1
Tin	ppm	ASTM D5185m	>4	**3**	<1	0
Vanadium	ppm	ASTM D5185m		**<1**	<1	0
Cadmium	ppm	ASTM D5185m		**<1**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**5**	6	6
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**4**	2	2
Manganese	ppm	ASTM D5185m		**1**	0	0
Magnesium	ppm	ASTM D5185m		**11**	10	9
Calcium	ppm	ASTM D5185m		**1912**	1846	1670
Phosphorus	ppm	ASTM D5185m		**309**	250	236
Zinc	ppm	ASTM D5185m		**365**	343	298
Sulfur	ppm	ASTM D5185m		**3553**	3328	2873

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>181	**130**	99	68
Sodium	ppm	ASTM D5185m	>21	**0**	<1	2
Potassium	ppm	ASTM D5185m	>20	**3**	0	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0.1**	0.1	0
Nitration	Abs/cm	*ASTM D7624		**6.3**	5.8	5.8
Sulfation	Abs/.1mm	*ASTM D7415		**24.7**	22.6	20.5

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**16.7**	14.4	12.6
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	▲ **2.11**	1.70	1.41
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	**2.36**	2.69	3.62

OIL ANALYSIS REPORT

Acid Number

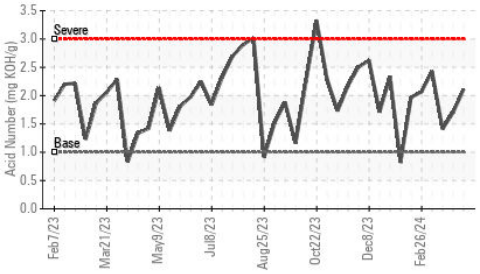

FT-IR (Direct Trend)

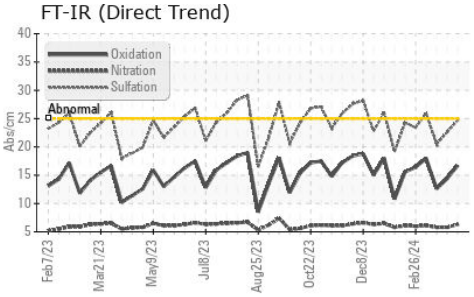

Base Number

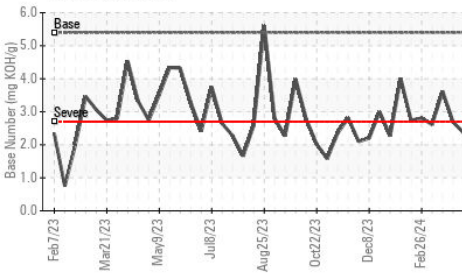

Viscosity @ 100°C

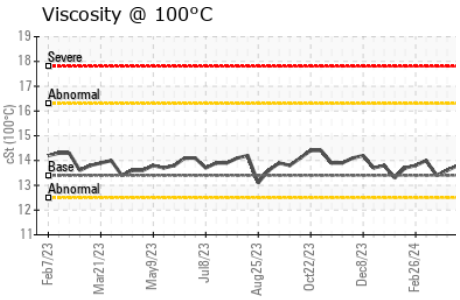

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	**13.8**	13.6	13.4

GRAPHS

Iron (ppm)

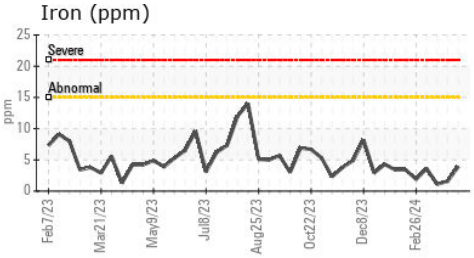

Lead (ppm)

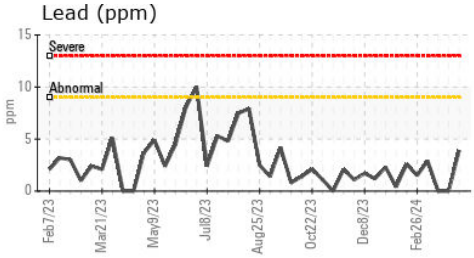

Aluminum (ppm)

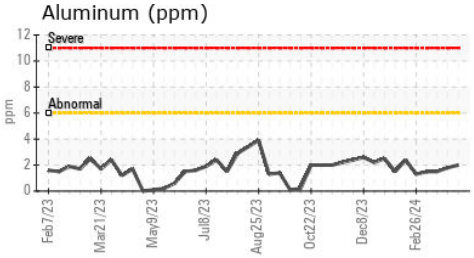

Chromium (ppm)

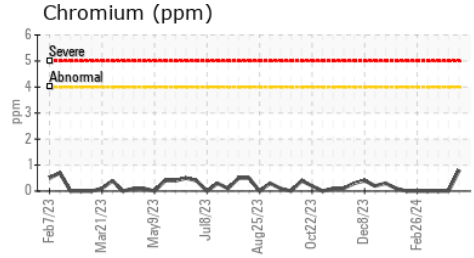

Copper (ppm)

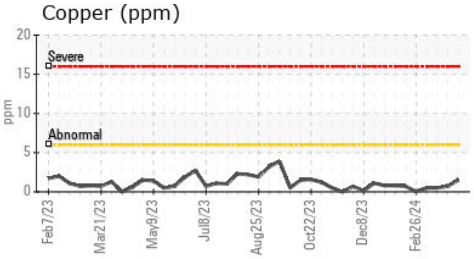

Silicon (ppm)

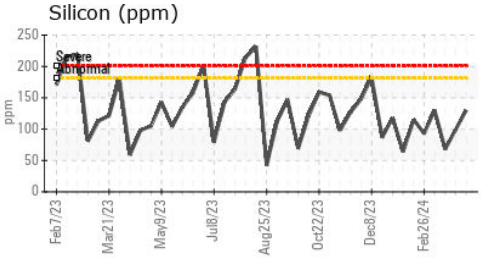

Viscosity @ 100°C

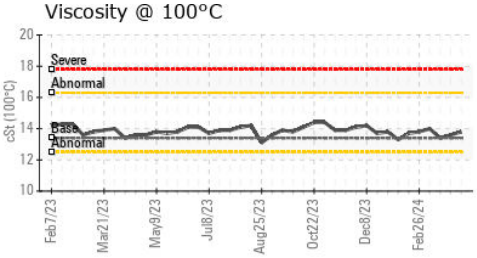

Base Number

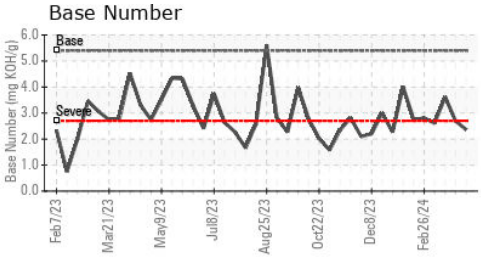

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0905696
Lab Number : 06146060
Unique Number : 10976138
Test Package : MOB 2

Received : 11 Apr 2024
Tested : 12 Apr 2024
Diagnosed : 15 Apr 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Grand Blanc
Grand Blanc Powerstation, 2361 West Grand Blanc Road
Grand Blanc, MI
US 48439
Contact: Tony Saint Marie
tony.saintmarie@edlenergy.com
T:
F:

Report Id: EDLGRA [WUSCAR] 06146060 (Generated: 04/15/2024 19:57:24) Rev: 1

Submitted By: Tony Saint Marie