




# OIL ANALYSIS REPORT

## Sample Rating Trend

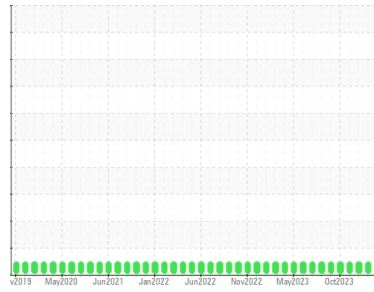

**NORMAL**



Area  
**NOC PUMP ROOM**  
 Machine Id  
**DDE-7501B (S/N NOC FIREWATER PUMP)**  
 Component  
**Diesel Engine**  
 Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (12 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>HLC0003147</b>	HLC0003187	HLC0003141
Sample Date	Client Info	<b>08 Mar 2024</b>	13 Jan 2024	16 Dec 2023
Machine Age	hrs Client Info	<b>0</b>	0	371
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	<b>6</b>	3	<1
Chromium	ppm ASTM D5185m >20	<b>&lt;1</b>	0	0
Nickel	ppm ASTM D5185m >4	<b>1</b>	0	<1
Titanium	ppm ASTM D5185m	<b>2</b>	<1	<1
Silver	ppm ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >20	<b>2</b>	<1	2
Lead	ppm ASTM D5185m >40	<b>2</b>	<1	0
Copper	ppm ASTM D5185m >330	<b>2</b>	<1	2
Tin	ppm ASTM D5185m >15	<b>2</b>	2	0
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm ASTM D5185m	<b>1</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 151	<b>113</b>	120	90
Barium	ppm ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 250	<b>10</b>	2	<1
Manganese	ppm ASTM D5185m	<b>1</b>	0	<1
Magnesium	ppm ASTM D5185m 0	<b>596</b>	655	676
Calcium	ppm ASTM D5185m 2046	<b>1414</b>	1456	1318
Phosphorus	ppm ASTM D5185m 1043	<b>713</b>	691	714
Zinc	ppm ASTM D5185m 943	<b>773</b>	837	830
Sulfur	ppm ASTM D5185m 5012	<b>3016</b>	2958	2994

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>6</b>	4	4
Sodium	ppm ASTM D5185m	<b>4</b>	2	0
Potassium	ppm ASTM D5185m >20	<b>4</b>	2	1

### INFRA-RED






method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm *ASTM D7624 >20	<b>6.2</b>	6.3	6.1
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>18.1</b>	17.7	17.5

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>12.4</b>	12.3	12.3
Base Number (BN)	mg KOH/g ASTM D2896 12.5	<b>8.3</b>	10.31	9.90







# OIL ANALYSIS REPORT

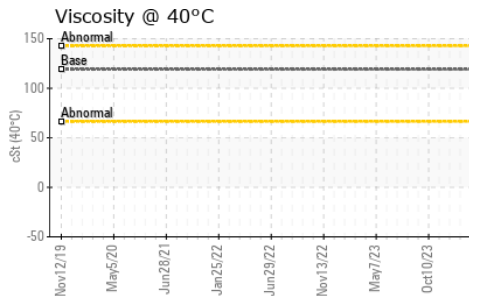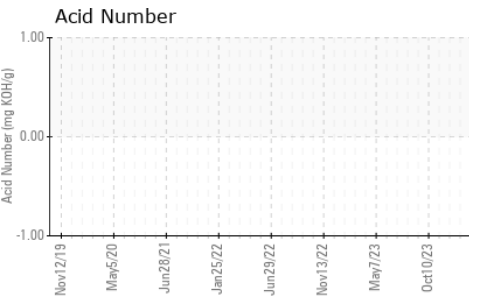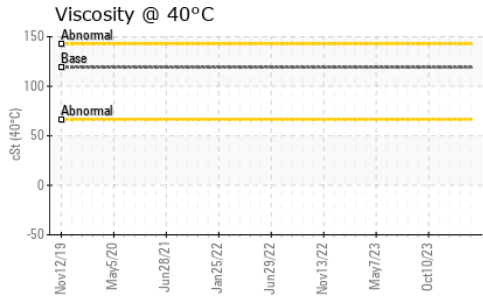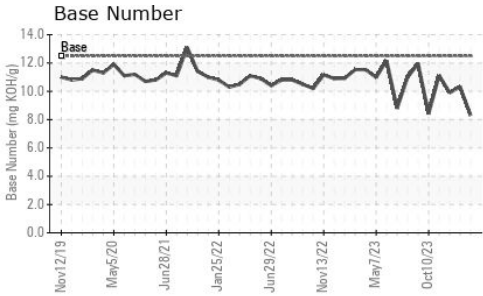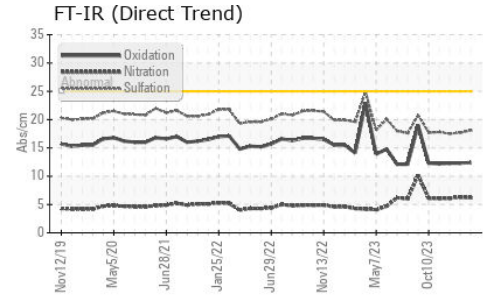

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.29	14.2

## GRAPHS

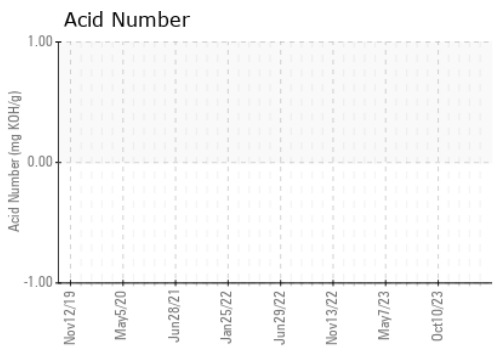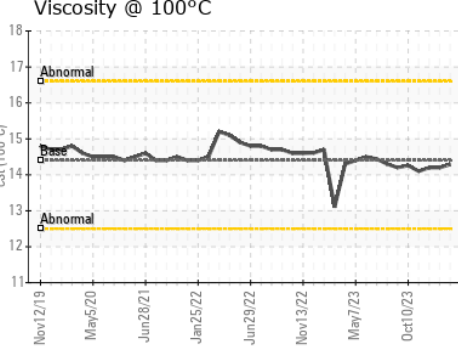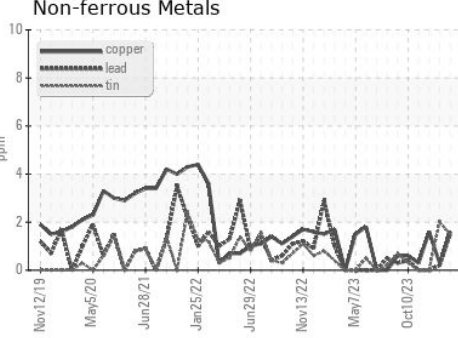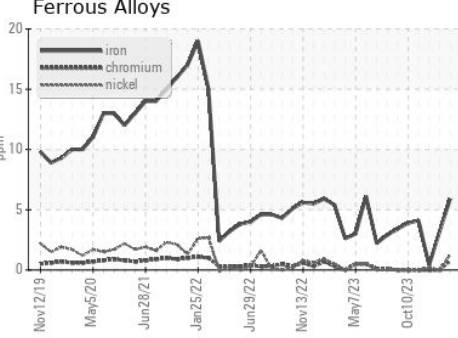

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0003147  
**Lab Number** : 06146549  
**Unique Number** : 10976627  
**Test Package** : IND 2 ( Additional Tests: KV40 )  
**Received** : 11 Apr 2024  
**Tested** : 17 Apr 2024  
**Diagnosed** : 18 Apr 2024 - Jonathan Hester

**HILCORP NORTHSTAR FACILITY**  
 PRUDHOE BAY, AK  
 US 99734  
 Contact: PERRY NEEL  
 pneel@hilcorp.com  
 T: (907)670-3514  
 F: (907)659-5377

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)