


# PROBLEM SUMMARY

Sample Rating Trend




**WEAR**

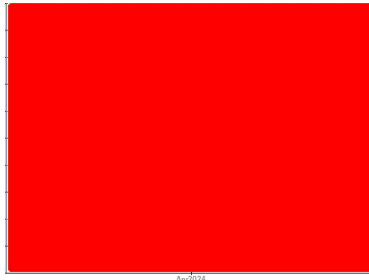


Machine Id  
**MDN 3985390 - MNO 4556 (S/N NO OTHER INFO PROVIDED)**  
Component  
**Hydraulic System**  
Fluid  
**COMP OIL (POE) ISO 220 (--- LTR)**

## COMPONENT CONDITION SUMMARY

### ▲ Ferrous Alloys

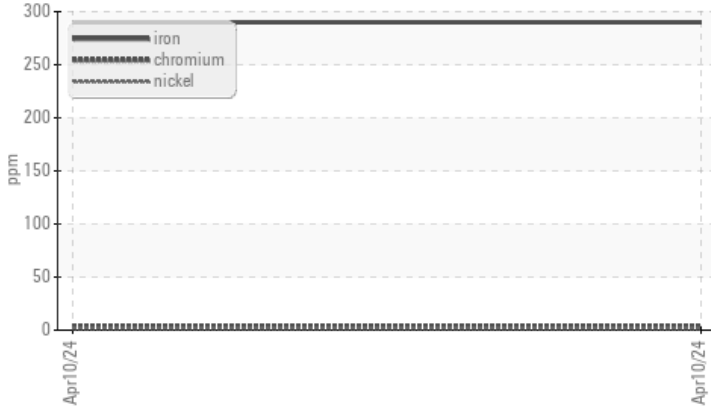

### ▲ Particle Trend

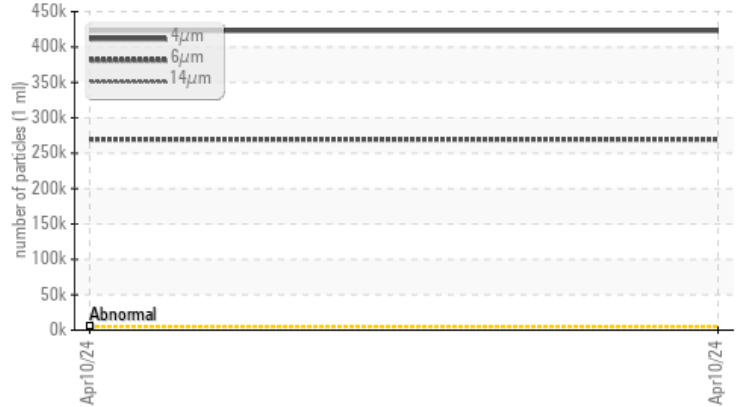

## RECOMMENDATION

Please specify the brand, type, and viscosity of the oil on your next sample. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

## PROBLEMATIC TEST RESULTS

Sample Status		SEVERE		---	---
Iron	ppm	ASTM D5185m	>20	▲ 290	---
Particles >4µm		ASTM D7647	>5000	▲ 423085	---
Particles >6µm		ASTM D7647	>1300	▲ 269469	---
Particles >14µm		ASTM D7647	>160	▲ 5314	---
Particles >21µm		ASTM D7647	>40	▲ 220	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 26/25/20	---

Customer Id: STAUFFUS  
Sample No.: ST44666  
Lab Number: 06146587  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Contact Required	---	---	?	Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

## HISTORICAL DIAGNOSIS

# OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

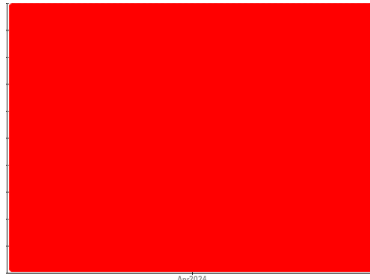

Machine Id  
**MDN 3985390 - MNO 4556 (S/N NO OTHER INFO PROVIDED)**  
 Component  
**Hydraulic System**  
 Fluid  
**COMP OIL (POE) ISO 220 (--- LTR)**

## DIAGNOSIS

**▲ Recommendation**  
 Please specify the brand, type, and viscosity of the oil on your next sample. Due to an abnormal test result it is recommended to contact Stauff Corp at (201)-444-7800 for help resolving the issue.

**▲ Wear**  
 The iron level is severe.

**▲ Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>ST44666</b>	---	---
Sample Date	Client Info			<b>10 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>SEVERE</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>▲ 290</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>3</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>1</b>	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	5	<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185m	5	<b>2</b>	---	---
Manganese	ppm	ASTM D5185m		<b>4</b>	---	---
Magnesium	ppm	ASTM D5185m	5	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	5	<b>7</b>	---	---
Phosphorus	ppm	ASTM D5185m	400	<b>800</b>	---	---
Zinc	ppm	ASTM D5185m	5	<b>7</b>	---	---
Sulfur	ppm	ASTM D5185m	100	<b>832</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>3</b>	---	---
Sodium	ppm	ASTM D5185m		<b>1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304	>0.05	<b>0.00</b>	---	---
ppm Water	ppm	ASTM D6304	>500	<b>0</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>▲ 423085</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>▲ 269469</b>	---	---
Particles >14µm		ASTM D7647	>160	<b>▲ 5314</b>	---	---
Particles >21µm		ASTM D7647	>40	<b>▲ 220</b>	---	---
Particles >38µm		ASTM D7647	>10	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>▲ 26/25/20</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.40	<b>0.49</b>	---	---

# OIL ANALYSIS REPORT

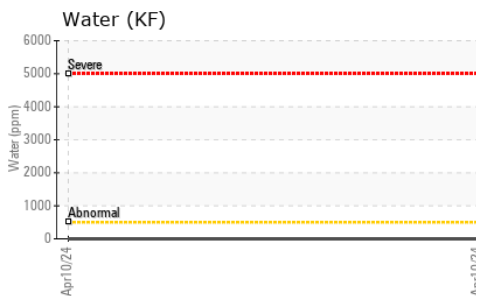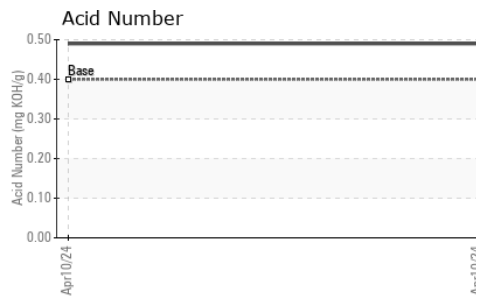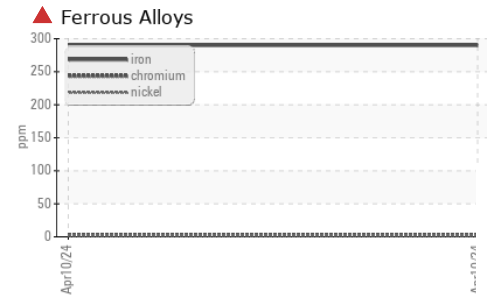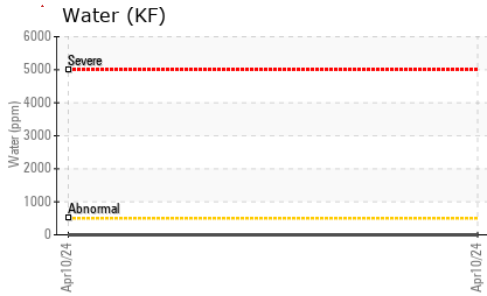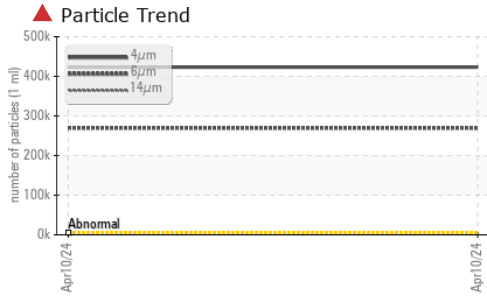





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	211	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

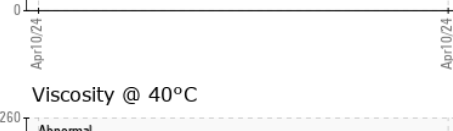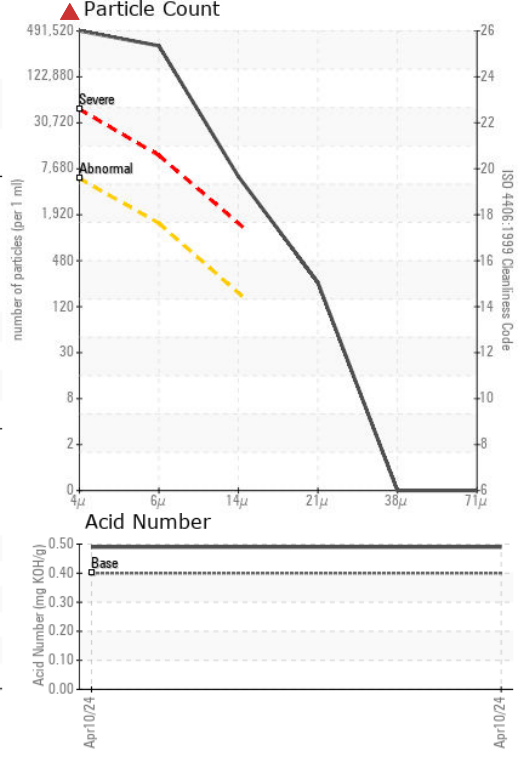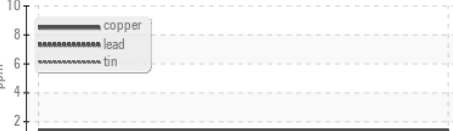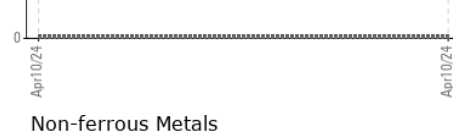

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : ST44666  
**Lab Number** : 06146587  
**Unique Number** : 10976665  
**Test Package** : IND 2 ( Additional Tests: KF )  
**Received** : 11 Apr 2024  
**Tested** : 12 Apr 2024  
**Diagnosed** : 15 Apr 2024 - Angela Borella

**STAUFF FILTRATION TECHNOLOGY**  
 42650 EXECUTIVE DR  
 CANTON, MI  
 US 48188  
 Contact: CAMERON MACNEIL  
 cmacneil@stauffusa.com  
 T: (734)747-7300  
 F: (734)747-7342

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)