

# **OIL ANALYSIS REPORT**

5/N 1012)

Sample Rating Trend

NORMAL

Machine Id

## KAESER SFC 37 4225074 (S/N 1012) Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- QTS)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


## Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KC120653	KC101629	KC79976
Sample Date		Client Info		21 Mar 2024	09 Mar 2023	21 Feb 2019
Machine Age	hrs	Client Info		55598	49122	30125
Oil Age	hrs	Client Info		0	21296	3905
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm		>10	1	<1	0
Lead	ppm	ASTM D5185m	>10	1	0	0
Copper	ppm		>50	7	4	6
Tin	ppm	ASTM D5185m	>10	1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
	PPIII		12			
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	<1	12	0
Molybdenum	ppm	ASTM D5185m		1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	2	35	9
Calcium	ppm	ASTM D5185m	2	4	0	0
Phosphorus	ppm	ASTM D5185m		3	0	<1
Zinc	ppm	ASTM D5185m		<1	8	21
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	8	0
Sodium	ppm	ASTM D5185m		0	12	4
Potassium	ppm	ASTM D5185m	>20	1	<1	<1
Water	%	ASTM D6304	>0.05	0.005	0.004	0.006
ppm Water	ppm	ASTM D6304	>500	53	48.6	60
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2199	2830	1540
Particles >6µm		ASTM D7647	>1300	610	1103	476
Particles >14µm		ASTM D7647	>80	55	91	49
Particles >21µm		ASTM D7647	>20	12	20	9
Particles >38µm		ASTM D7647	>4	1	2	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	9/17/14	16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.41	0.35	0.386





**OIL ANALYSIS REPORT** 













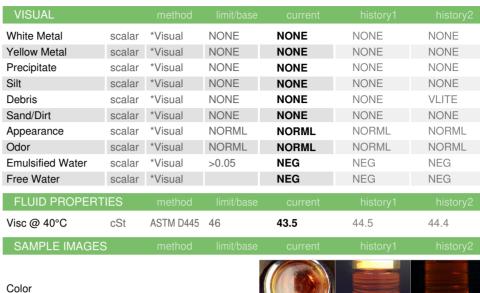

Bottom

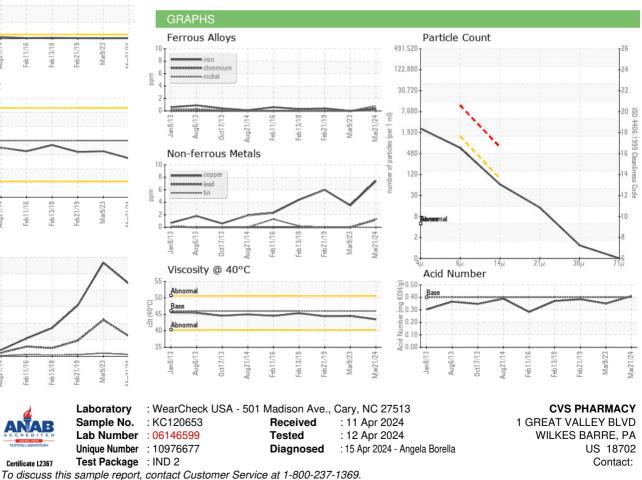

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: CVSWIL [WUSCAR] 06146599 (Generated: 04/15/2024 18:13:29) Rev: 1

Certificate 12367

Contact/Location: ? ? - CVSWIL Page 2 of 2

T:

F: