


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# KAESER ASD 30 4188519 (S/N 1042)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2013	Oct2013 Mar2017	Mar2018 Mar2019 Mar2023	Mar2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC120670	KC101628	KC76470
Sample Date		Client Info		21 Mar 2024	09 Mar 2023	14 Mar 2019
Machine Age	hrs	Client Info		40821	37275	23459
Oil Age	hrs	Client Info		0	2926	3044
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	0	5
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	1	<1	<1
Lead	ppm	ASTM D5185m	>10	1	0	0
Copper	ppm	ASTM D5185m	>50	10	6	8
Tin	ppm	ASTM D5185m	>10	1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	6
Molybdenum	ppm	ASTM D5185m		1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	2	0	20
Calcium	ppm	ASTM D5185m	2	3	0	0
Phosphorus	ppm	ASTM D5185m		2	0	0
Zinc	ppm	ASTM D5185m		5	0	28
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	4	<1
Sodium	ppm	ASTM D5185m		<1	0	8
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water	%	ASTM D6304	>0.05	0.005	0.004	0.010
ppm Water	ppm	ASTM D6304	>500	59	44.3	100
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5108		
Particles >6µm		ASTM D7647	>1300	1291		
Particles >14μm		ASTM D7647	>80	77		
Particles >21µm		ASTM D7647	>20	17		
Particles >38μm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.36	0.355



## **OIL ANALYSIS REPORT**

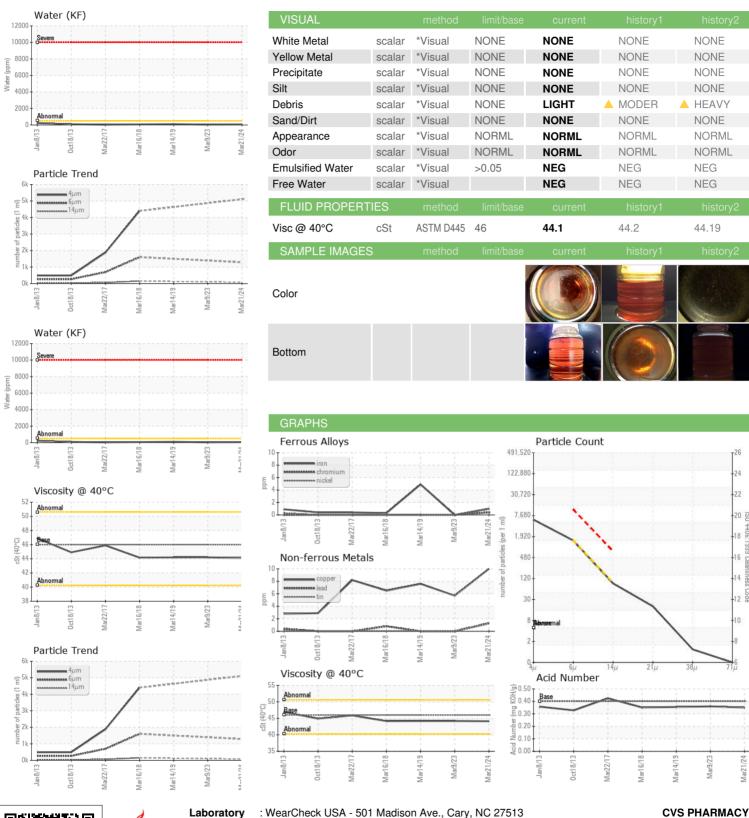



Certificate 12367

Laboratory Sample No. Lab Number : 06146600

: KC120670

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Apr 2024 **Tested** : 12 Apr 2024 Diagnosed : 15 Apr 2024 - Angela Borella

Unique Number : 10976678 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

1 GREAT VALLEY BLVD

WILKES BARRE, PA

US 18702

Contact: