




OIL ANALYSIS REPORT

Sample Rating Trend

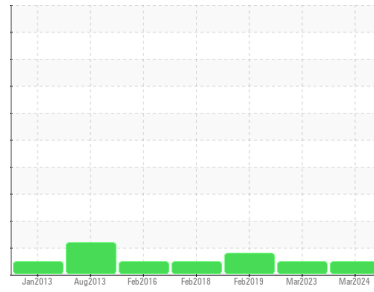

NORMAL



Machine Id
KAESER BSD 50 3894698 (S/N 2040)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | KC120654 | KC101625 | KC79977 |
| Sample Date | Client Info | | 21 Mar 2024 | 09 Mar 2023 | 21 Feb 2019 |
| Machine Age | hrs | Client Info | 11427 | 11385 | 10845 |
| Oil Age | hrs | Client Info | 0 | 290 | 12 |
| Oil Changed | Client Info | | N/A | Changed | Changed |
| Sample Status | | | NORMAL | NORMAL | ATTENTION |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | <1 | 0 | <1 |
| Chromium | ppm | ASTM D5185m >10 | <1 | 0 | 0 |
| Nickel | ppm | ASTM D5185m >3 | <1 | 0 | 0 |
| Titanium | ppm | ASTM D5185m >3 | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185m >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >10 | 1 | <1 | <1 |
| Lead | ppm | ASTM D5185m >10 | 1 | 0 | 0 |
| Copper | ppm | ASTM D5185m >50 | <1 | <1 | 0 |
| Tin | ppm | ASTM D5185m >10 | 1 | 0 | 0 |
| Antimony | ppm | ASTM D5185m | --- | --- | 0 |
| Vanadium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | <1 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|----------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | <1 |
| Barium | ppm | ASTM D5185m 90 | 46 | 4 | 51 |
| Molybdenum | ppm | ASTM D5185m | 1 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m 90 | 76 | 71 | 86 |
| Calcium | ppm | ASTM D5185m 2 | 7 | <1 | 1 |
| Phosphorus | ppm | ASTM D5185m | 3 | 0 | 0 |
| Zinc | ppm | ASTM D5185m | 2 | 3 | 1 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | 2 | <1 |
| Sodium | ppm | ASTM D5185m | 10 | 15 | 6 |
| Potassium | ppm | ASTM D5185m >20 | 3 | 3 | 2 |
| Water | % | ASTM D6304 >0.05 | 0.016 | 0.009 | 0.015 |
| ppm Water | ppm | ASTM D6304 >500 | 164 | 92.9 | 150 |






FLUID CLEANLINESS

| | method | limit/base | current | history1 | history2 |
|-----------------|------------------|------------|-----------------|----------|----------|
| Particles >4µm | ASTM D7647 | | 1103 | 1615 | 3875 |
| Particles >6µm | ASTM D7647 >1300 | | 248 | 315 | 1056 |
| Particles >14µm | ASTM D7647 >80 | | 22 | 20 | 99 |
| Particles >21µm | ASTM D7647 >20 | | 9 | 4 | 25 |
| Particles >38µm | ASTM D7647 >4 | | 0 | 1 | 3 |
| Particles >71µm | ASTM D7647 >3 | | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >--/17/13 | 17/15/12 | 18/15/11 | 17/14 |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.4 | 0.38 | 0.36 | 0.332 |


OIL ANALYSIS REPORT

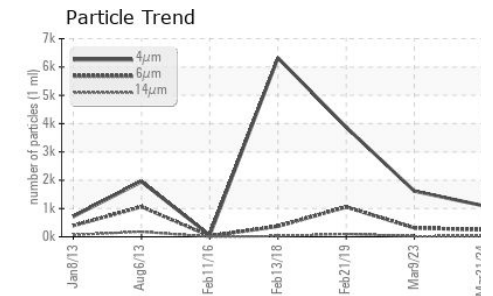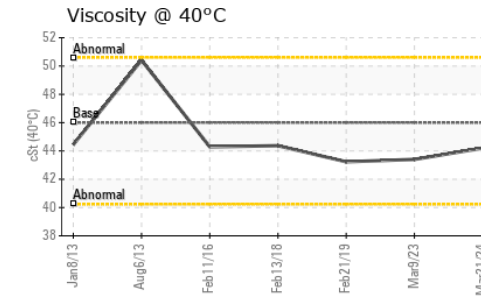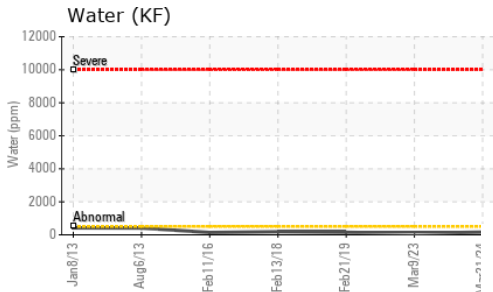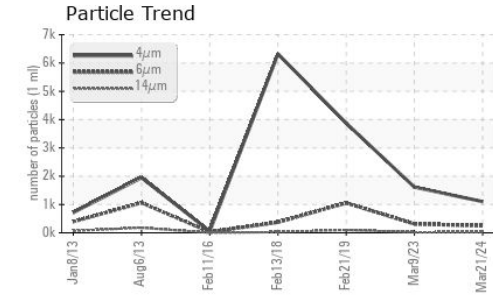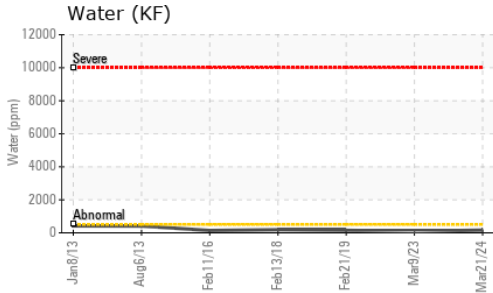






| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 46 | 44.2 | 43.4 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

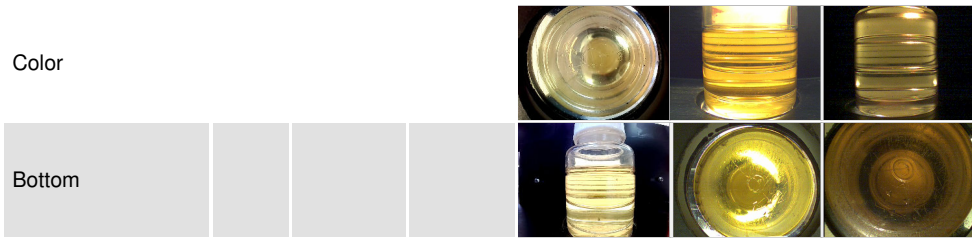

GRAPHS

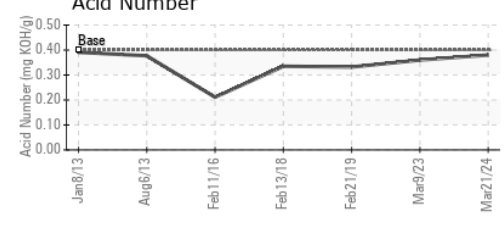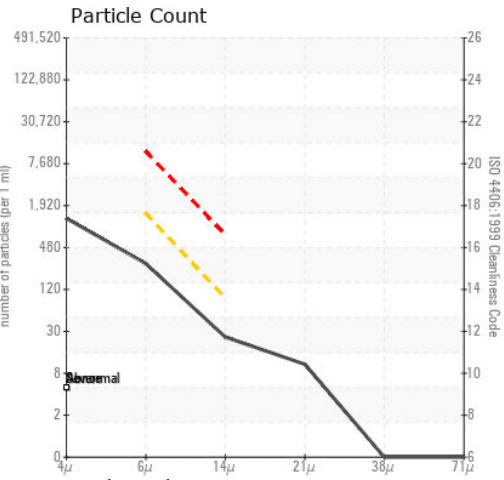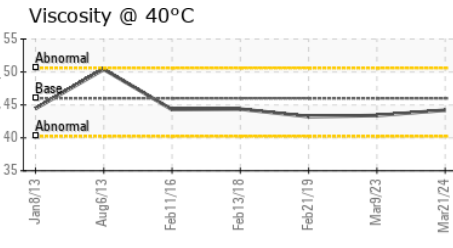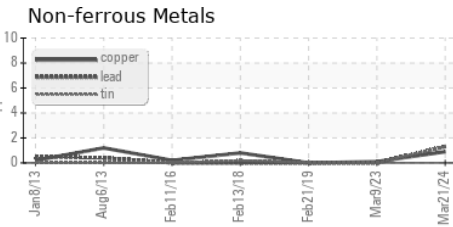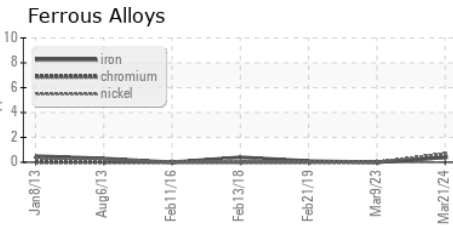

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC120654
Lab Number : 06146601
Unique Number : 10976679
Test Package : IND 2
Received : 11 Apr 2024
Tested : 12 Apr 2024
Diagnosed : 15 Apr 2024 - Angela Borella

CVS PHARMACY
 1 GREAT VALLEY BLVD
 WILKES BARRE, PA
 US 18702
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)