


# **OIL ANALYSIS REPORT**

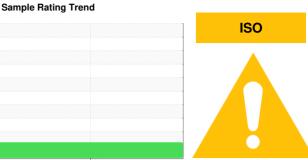

Machine Id

# KAESER 8859374 (S/N 1349)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

## **DIAGNOSIS**

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013764		
Sample Date		Client Info		27 Mar 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	ou want	history1	history2
				current	HISTORY	HIStoryZ
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	15		
Tin	ppm	ASTM D5185m	>10	1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	1		
Calcium	ppm	ASTM D5185m	0	4		
Phosphorus	ppm	ASTM D5185m	0	4		
Zinc	ppm	ASTM D5185m	0	8		
Sulfur	ppm	ASTM D5185m	23500	18546		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.005		
ppm Water	ppm	ASTM D6304	>500	52		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4421		
Particles >6µm		ASTM D7647	>1300	1224		
Particles >14μm		ASTM D7647	>80	<b>142</b>		
Particles >21µm		ASTM D7647	>20	<b>43</b>		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>19/17/14</b>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.31		



## **OIL ANALYSIS REPORT**





Certificate 12367

Laboratory Sample No.

Lab Number : 06146603 Unique Number : 10976681

: KCPA013764

Received : 11 Apr 2024 **Tested** Diagnosed

: 12 Apr 2024

: 15 Apr 2024 - Angela Borella

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: GARY ALEXANDER - KAEELK

200 STANLEY ST

US 60006

T:

F:

ELK GROVE VILLAGE, IL

Contact: GARY ALEXANDER

gary.alexander@kaeser.com