

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER BSD 50T 6244679 (S/N 1427)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		L				
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016901		
Sample Date		Client Info		02 Apr 2024		
Machine Age	hrs	Client Info		26501		
Oil Age	hrs	Client Info		0		
Oil Changed	1110	Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	1		
Copper	ppm	ASTM D5185m	>50	10		
Tin	ppm	ASTM D5185m	>10	1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	9		
Calcium	ppm	ASTM D5185m	2	3		
Phosphorus	ppm	ASTM D5185m		3		
Zinc	ppm	ASTM D5185m		3		
Sulfur	ppm	ASTM D5185m		17710		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.006		
ppm Water	ppm	ASTM D6304	>500	70		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2021		
Particles >6µm		ASTM D7647	>1300	434		
Particles >14µm		ASTM D7647	>80	24		
Particles >21µm		ASTM D7647	>20	6		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOU/~	VCTM DOUVE	0.4	0.20		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.38



OIL ANALYSIS REPORT

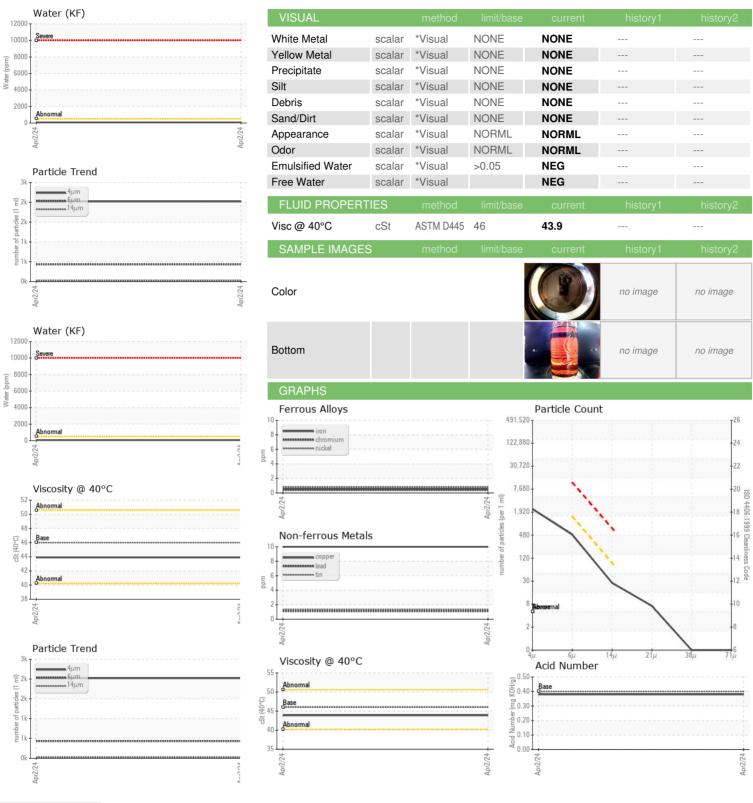



Laboratory Sample No.

Lab Number : 06146615

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA016901 Unique Number : 10976693

Received : 11 Apr 2024 **Tested** Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 12 Apr 2024

: 16 Apr 2024 - Angela Borella

US 37086 Contact: SERVICE MANAGER

INGRAM BOOK COMPANY

ONE INGRAM BLVD.

LAVERGNE, TN

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: INGLAV [WUSCAR] 06146615 (Generated: 04/16/2024 08:38:49) Rev: 1

Contact/Location: SERVICE MANAGER - INGLAV

T:

F: