


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id LT-1 Component Refrigeration Compressor USPI 1009-68 SC (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
		Client Info		USP0007839		
Sample Number Sample Date		Client Info				
Machine Age	hvo	Client Info		09 Apr 2024 207029		
	hrs	Client Info				
Oil Age	hrs			0 N/A		
Oil Changed		Client Info		N/A NORMAL		
Sample Status				NORWAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1		
Chromium	ppm	ASTM D5185m	>2	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	1		
Lead	ppm	ASTM D5185m	>2	1		
Copper	ppm	ASTM D5185m	>8	<1		
Tin	ppm	ASTM D5185m	>4	1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m	50	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	4		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304		0.002		
ppm Water	ppm	ASTM D6304	>100	17		
FLUID CLEANLIN	ESS _	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2071		
Particles >6µm		ASTM D7647	>2500	304		
Particles >14µm		ASTM D7647	>320	8		
Particles >21µm		ASTM D7647	>80	1		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>/18/15	18/15/10		
FLUID DEGRADA	LION -	method	limit/base	current	history1	history2
		ASTM D974	0.005	0.014		- HISTOLYZ
Acid Number (AN)	mg KOH/g	79 IN D3/4	0.005	0.014		



OIL ANALYSIS REPORT

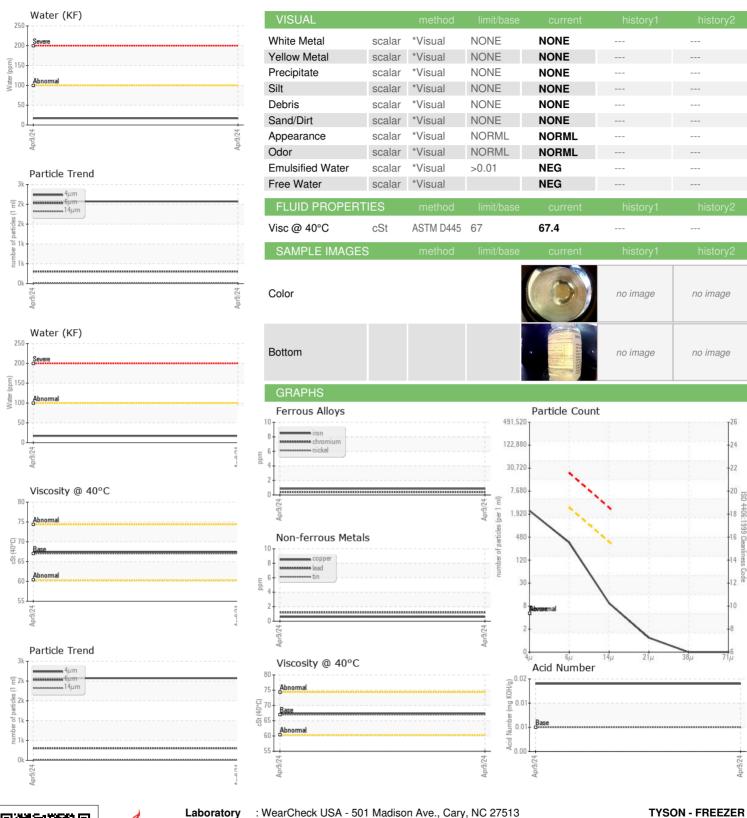



Certificate 12367

Laboratory Sample No.

Lab Number : 06146627 Unique Number : 10976705 Test Package : IND 2

: USP0007839

Received : 11 Apr 2024 **Tested** Diagnosed

: 12 Apr 2024 : 15 Apr 2024 - Doug Bogart 28424 38TH AVE N JOSLIN, IL US 61257

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (402)423-6661