




# OIL ANALYSIS REPORT

## Sample Rating Trend

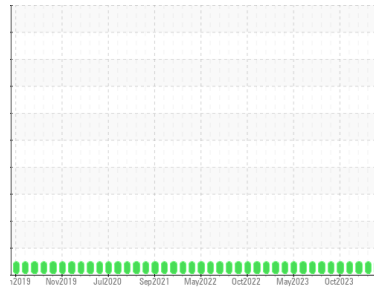

**NORMAL**



Area

## SEAWATER SUMP

Machine Id

## DDE-9101 (S/N FIRE WATER PUMP)

Component

## Diesel Engine

Fluid

## CHEVRON DELO 400 MULTIGRADE 15W40 (20 GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>HLC0003201</b>	HLC0003176	HLC0002092
Sample Date	Client Info	<b>01 Apr 2024</b>	13 Jan 2024	05 Dec 2023
Machine Age	hrs Client Info	<b>0</b>	0	525
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >5	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >100	<b>10</b>	9	10
Chromium	ppm ASTM D5185m >20	<b>1</b>	4	4
Nickel	ppm ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >20	<b>&lt;1</b>	1	2
Lead	ppm ASTM D5185m >40	<b>&lt;1</b>	3	2
Copper	ppm ASTM D5185m >330	<b>5</b>	6	6
Tin	ppm ASTM D5185m >15	<b>0</b>	4	1
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 151	<b>127</b>	146	122
Barium	ppm ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 250	<b>34</b>	32	32
Manganese	ppm ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm ASTM D5185m 0	<b>210</b>	214	228
Calcium	ppm ASTM D5185m 2046	<b>3137</b>	2829	2731
Phosphorus	ppm ASTM D5185m 1043	<b>1252</b>	1077	1012
Zinc	ppm ASTM D5185m 943	<b>1494</b>	1383	1362
Sulfur	ppm ASTM D5185m 5012	<b>6109</b>	4698	4838

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>4</b>	5	5
Sodium	ppm ASTM D5185m	<b>1</b>	<1	<1
Potassium	ppm ASTM D5185m >20	<b>1</b>	2	1

### INFRA-RED




method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >3	<b>0.2</b>	0.2	0.2
Nitration	Abs/cm *ASTM D7624 >20	<b>7.5</b>	7.4	7.3
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>22.1</b>	21.7	21.6

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>18.1</b>	17.5	17.1
Base Number (BN)	mg KOH/g ASTM D2896 12.5	<b>10.19</b>	11.18	11.32







# OIL ANALYSIS REPORT

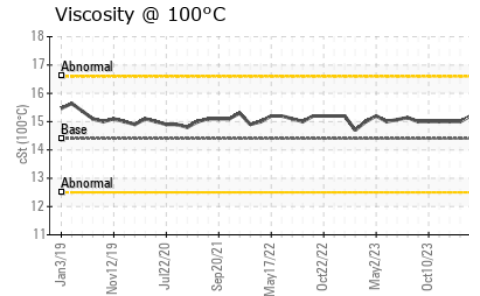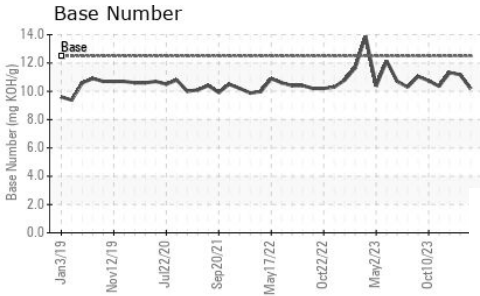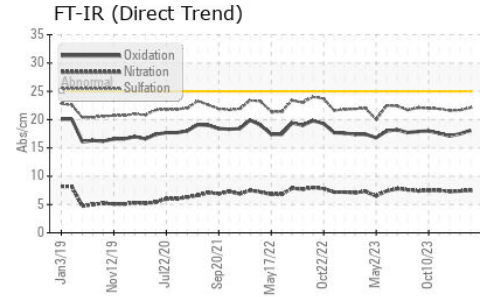

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	15.2	15.0

## GRAPHS

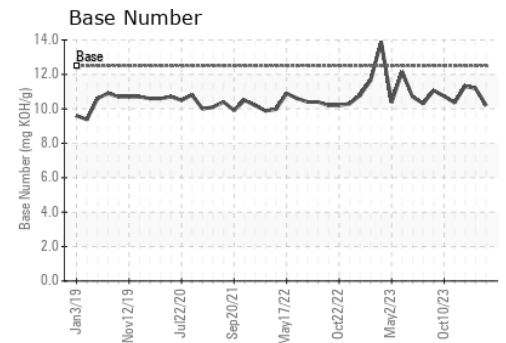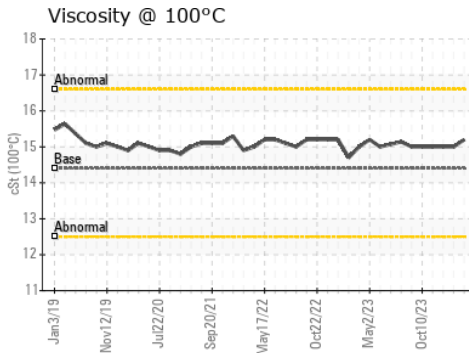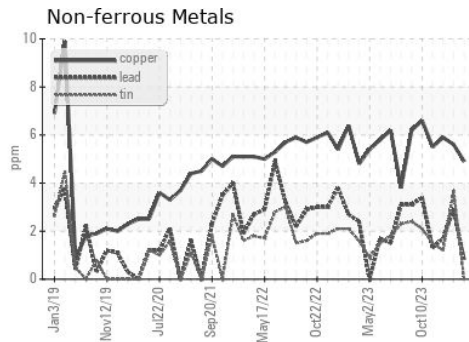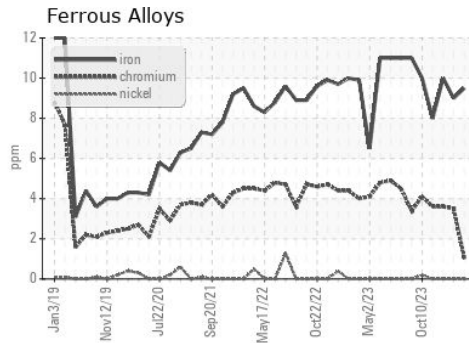

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0003201  
**Lab Number** : 06146755  
**Unique Number** : 10976833  
**Test Package** : IND 2  
**Received** : 11 Apr 2024  
**Tested** : 12 Apr 2024  
**Diagnosed** : 15 Apr 2024 - Sean Felton

**HILCORP NORTHSTAR FACILITY**

PRUDHOE BAY, AK  
 US 99734  
 Contact: PERRY NEEL  
 pneel@hilcorp.com  
 T: (907)670-3514  
 F: (907)659-5377

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)