




OIL ANALYSIS REPORT

Sample Rating Trend

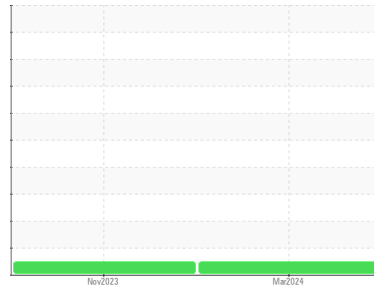

NORMAL



Area
RRHP Turbine Pit 699 Elevation
 Machine Id
029-200-422 Unit 2 TTB
 Component
Thrust Bearing
 Fluid
MOBIL DTE 26 (530 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0927629	WC0879259	---
Sample Date	Client Info		10 Mar 2024	20 Nov 2023	---
Machine Age	hrs	Client Info	7867	7480	---
Oil Age	hrs	Client Info	7867	7480	---
Oil Changed	Client Info		Not Chngd	Filtered	---
Sample Status			NORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >85	<1	0	---
Chromium	ppm	ASTM D5185m >20	<1	0	---
Nickel	ppm	ASTM D5185m >20	<1	0	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >40	1	0	---
Lead	ppm	ASTM D5185m >60	1	0	---
Copper	ppm	ASTM D5185m >7	1	<1	---
Tin	ppm	ASTM D5185m >40	1	0	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	<1	<1	---
Molybdenum	ppm	ASTM D5185m	<1	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	<1	0	---
Calcium	ppm	ASTM D5185m	126	107	---
Phosphorus	ppm	ASTM D5185m	499	453	---
Zinc	ppm	ASTM D5185m	670	653	---
Sulfur	ppm	ASTM D5185m	8847	7845	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >20	<1	<1	---
Sodium	ppm	ASTM D5185m	3	3	---
Potassium	ppm	ASTM D5185m >20	2	0	---
Water	%	ASTM D6304 >2	0.003	0.009	---
ppm Water	ppm	ASTM D6304	40	93	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	3335	712	---
Particles >6µm	ASTM D7647	>2500	292	251	---
Particles >14µm	ASTM D7647	>160	10	6	---
Particles >21µm	ASTM D7647	>40	3	2	---
Particles >38µm	ASTM D7647	>10	0	0	---
Particles >71µm	ASTM D7647	>3	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/14	19/15/10	17/15/10	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.616	0.69	---



OIL ANALYSIS REPORT

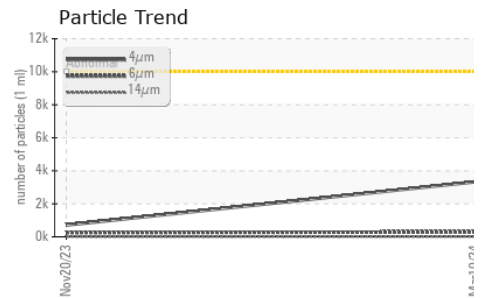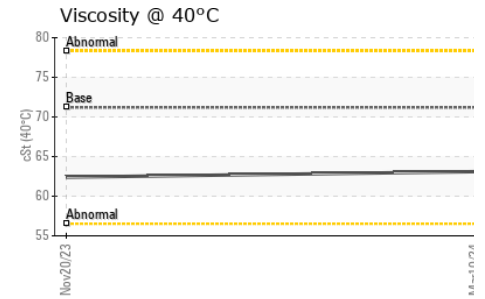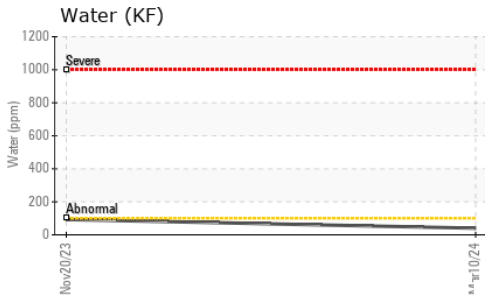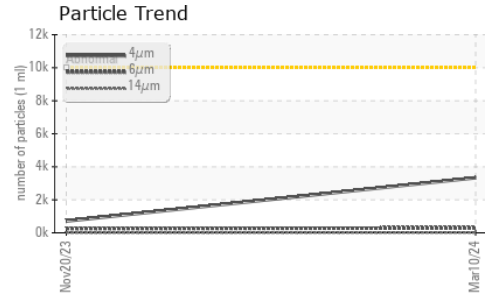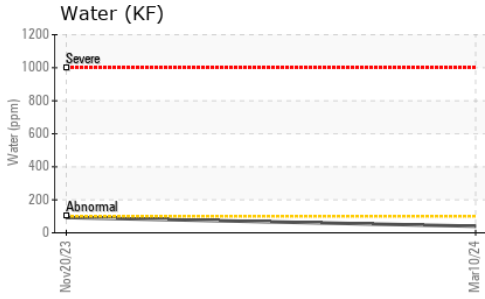






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	71.2	63.1	62.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color			no image
Bottom			no image
PrtFilter	no image	no image	no image

GRAPHS

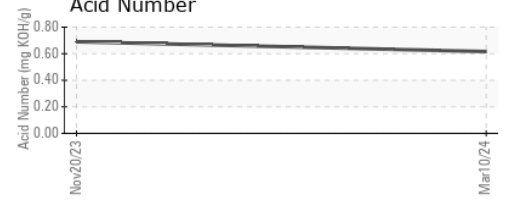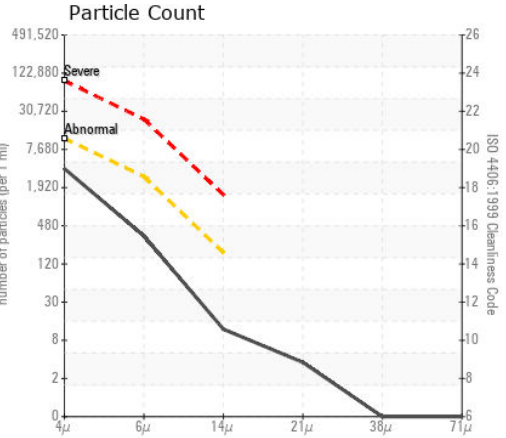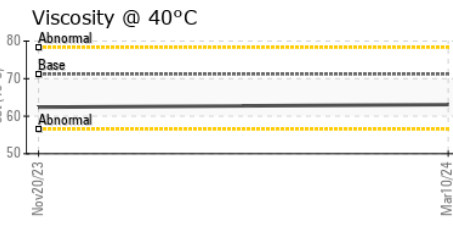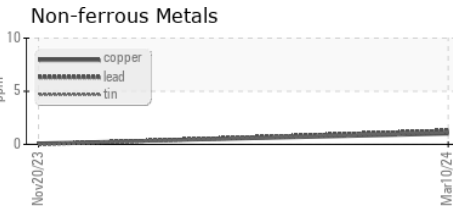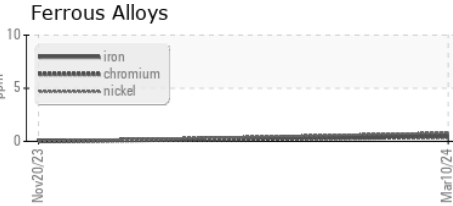

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0927629
Lab Number : 06147334
Unique Number : 10977412
Test Package : PLANT (Additional Tests: FilterPatch)

Missouri River Energy Services - Red Rock Hydro
 1004 216th Place
 Pella, IA
 CA 50219

Contact: Vern Cochran
 vern.cochran@mrenergy.com
 T: (605)357-6920

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)