




# OIL ANALYSIS REPORT

Sample Rating Trend

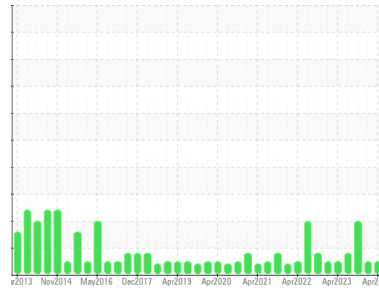

**NORMAL**



Machine Id  
**FES TYSNRH HS305 (S/N 2552905)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0006757</b>	USP0004980	USP0001217
Sample Date	Client Info	<b>11 Apr 2024</b>	15 Jan 2024	15 Oct 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >8	<b>&lt;1</b>	<1	0
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>1</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>1</b>	0	<1
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >4	<b>1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>1</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS






method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.002	0.003
ppm Water	ppm	ASTM D6304 >100	<b>5</b>	25	39.4

## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>6746</b>	8752	▲ 27667
Particles >6µm	ASTM D7647 >2500	<b>1498</b>	2143	▲ 9695
Particles >14µm	ASTM D7647 >320	<b>67</b>	114	▲ 575
Particles >21µm	ASTM D7647 >80	<b>9</b>	20	▲ 104
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	1
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>20/18/13</b>	20/18/14	▲ 22/20/16

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.015

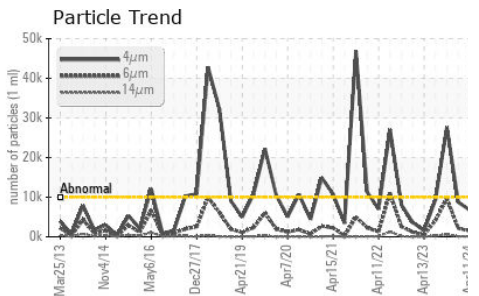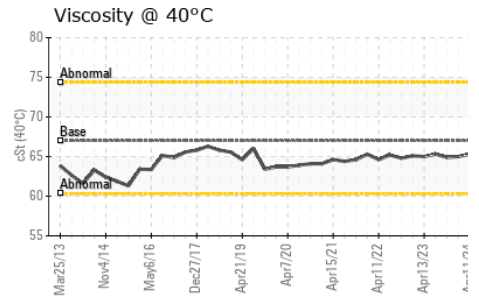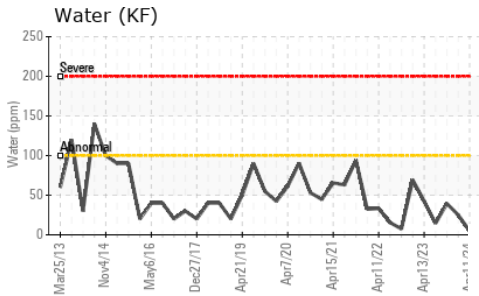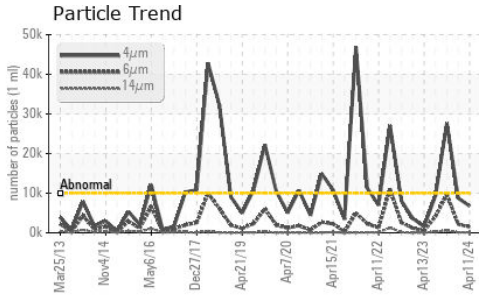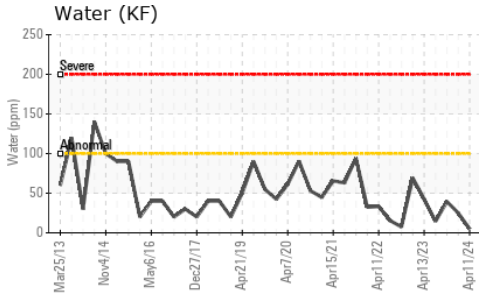


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	65.3	65.0







SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

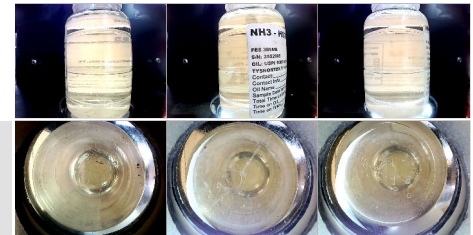

## GRAPHS

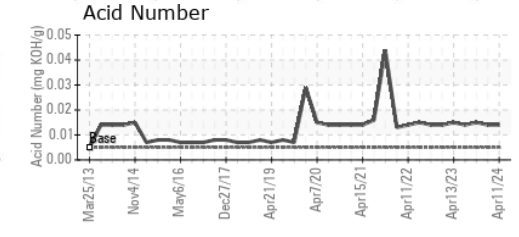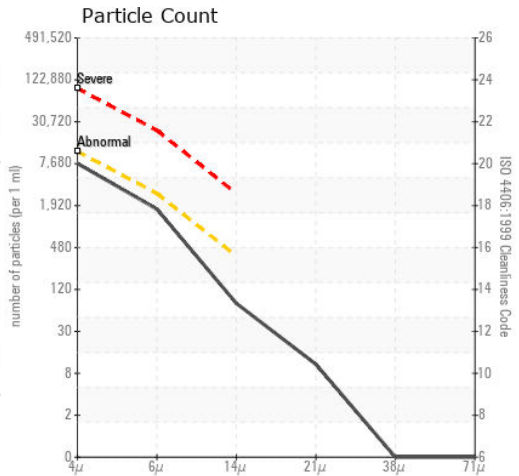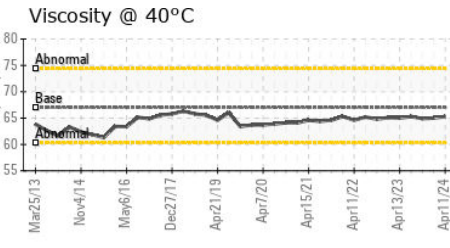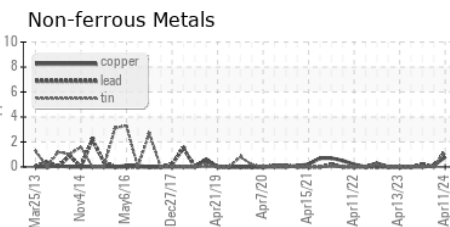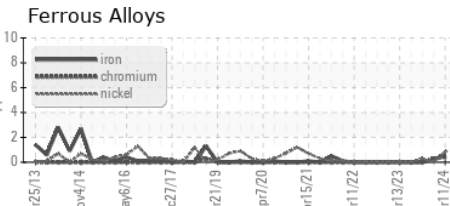

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USP006757  
 Lab Number : 06147381  
 Unique Number : 10977459  
 Test Package : IND 2

Received : 12 Apr 2024  
 Tested : 15 Apr 2024  
 Diagnosed : 15 Apr 2024 - Doug Bogart

**TYSON-NORTH RICHLAND HILLS-USP**  
 6350 BLOWN CT  
 NORTH RICHLAND HILLS, TX  
 US 76180  
 Contact: JOHN MORGAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (817)514-3519

F: