




# OIL ANALYSIS REPORT

## Sample Rating Trend

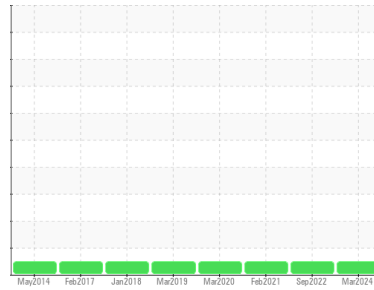

**NORMAL**



Machine Id  
**DAIKIN HERSHEY CHILLER 3 (S/N STNU121200027)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**MOBIL EAL ARTIC ISO 46 (5 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

Confirm oil type. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0812163</b>	WC0487287	WC0341165
Sample Date	Client Info		<b>14 Mar 2024</b>	30 Sep 2022	05 Feb 2021
Machine Age	hrs	Client Info	<b>65410</b>	57680	0
Oil Age	hrs	Client Info	<b>65410</b>	0	0
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	<b>0</b>	0	5
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >50	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >100	<b>0</b>	1	3
Tin	ppm	ASTM D5185m >4	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	1
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>2</b>	2	<1
Calcium	ppm	ASTM D5185m	<b>4</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>12</b>	7	4
Zinc	ppm	ASTM D5185m	<b>4</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>26</b>	0	11

### CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>7</b>	10	12
Sodium	ppm	ASTM D5185m	<b>0</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	6
Water	%	ASTM D6304 >0.02	<b>0.006</b>	0.017	0.006
ppm Water	ppm	ASTM D6304 >250	<b>65</b>	177.5	66.8

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.1	<b>0.028</b>	0.016	0.015




# OIL ANALYSIS REPORT

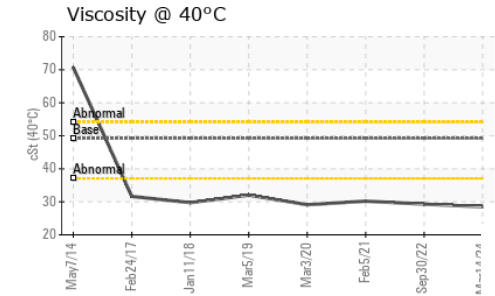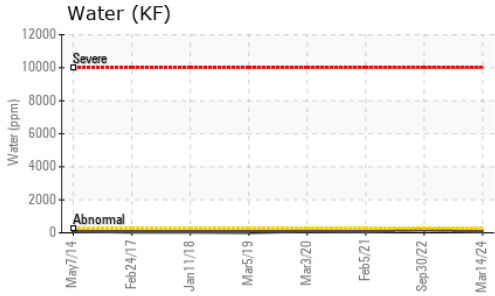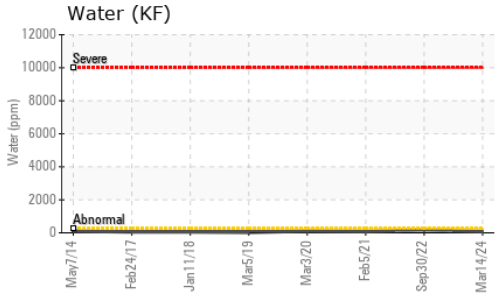





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	49.2	<b>28.5</b>	29.3	30.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

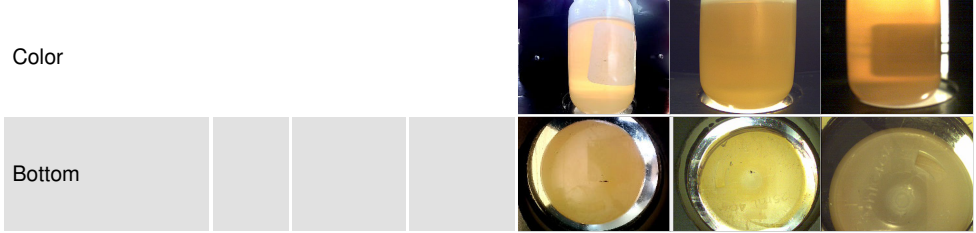

## GRAPHS

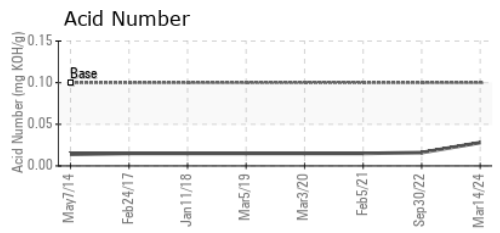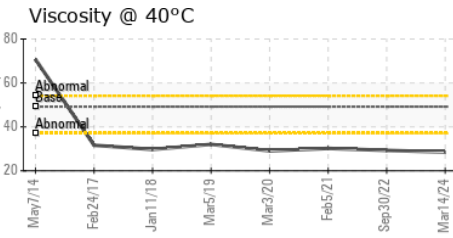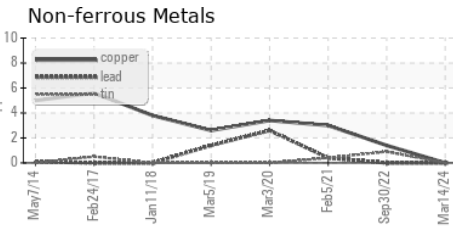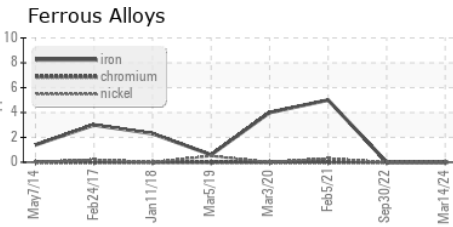

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0812163      **Received** : 12 Apr 2024  
**Lab Number** : **06147397**      **Tested** : 15 Apr 2024  
**Unique Number** : 10977475      **Diagnosed** : 16 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**DAIKIN APPLIED-RICHMOND**  
 8991 OLD STAPLES MILL ROAD  
 HENRICO, VA 23228  
 Contact: AMANDA CARRIER  
 amanda.carrier@daikinapplied.com  
 T: (804)747-4822  
 F: (804)747-6686

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)