



# OIL ANALYSIS REPORT



Machine Id  
**YORK SBXM-869320 - CH 1**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**YORK TYPE K (15 GAL)**

## Sample Rating Trend



**WEAR**



### DIAGNOSIS

#### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### ▲ Wear

The lead level is abnormal. All other component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0812087</b>	---	---
Sample Date	Client Info		<b>06 Mar 2024</b>	---	---
Machine Age	hrs	Client Info	<b>32868</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >2	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >2	<b>▲ 7</b>	---	---
Copper	ppm	ASTM D5185m >8	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m 5	<b>51</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>1</b>	---	---
Sulfur	ppm	ASTM D5185m 10	<b>0</b>	---	---

### CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.03	<b>0.028</b>	---	---
ppm Water	ppm	ASTM D6304 >300	<b>290</b>	---	---

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.03	<b>0.041</b>	---	---



# OIL ANALYSIS REPORT

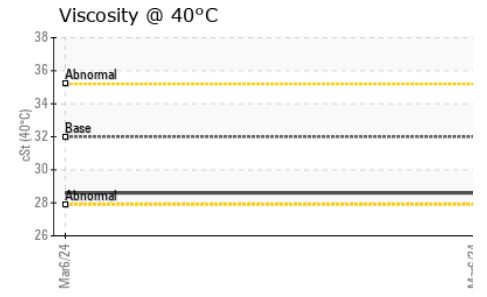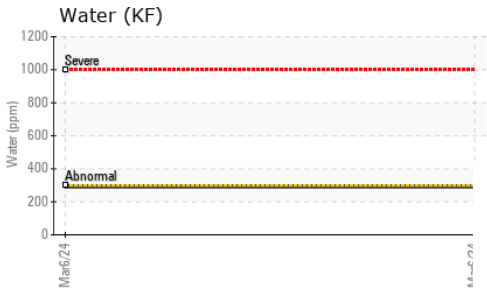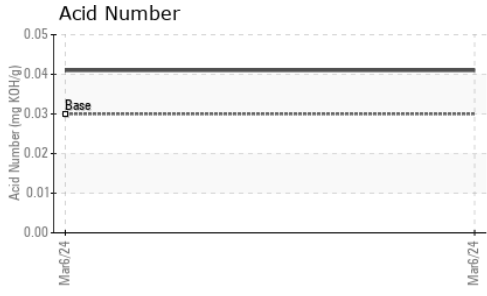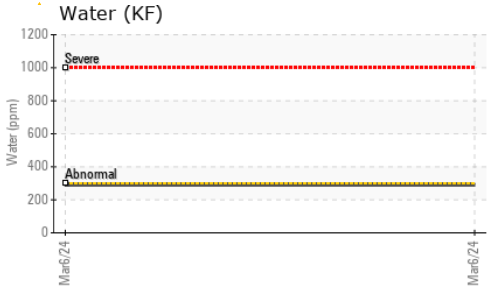





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.03	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32.0	<b>28.6</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

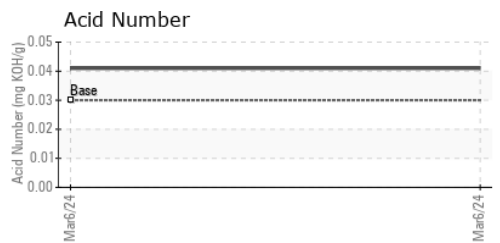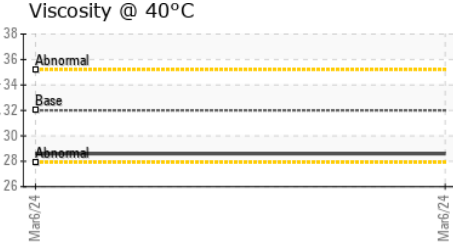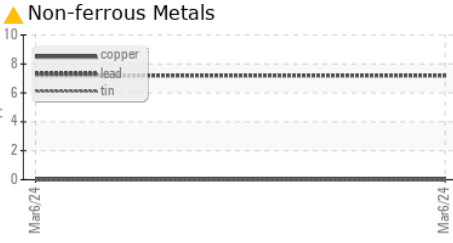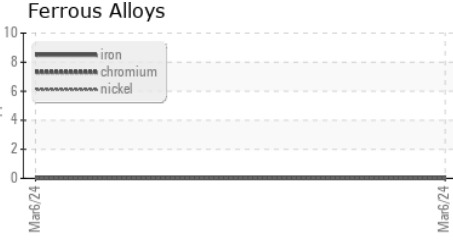

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0812087      **Received** : 12 Apr 2024  
**Lab Number** : **06147406**      **Tested** : 15 Apr 2024  
**Unique Number** : 10977484      **Diagnosed** : 16 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**DAIKIN APPLIED-RICHMOND**  
 8991 OLD STAPLES MILL ROAD  
 HENRICO, VA  
 US 23228  
 Contact: AMANDA CARRIER  
 amanda.carrier@daikinapplied.com  
 T: (804)747-4822  
 F: (804)747-6686

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)