


OIL ANALYSIS REPORT

KAESER S-460 [9186] KAESER 1070 - PARKER HANNAFIN CORP

Component Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06147450	UCH05450259	
Sample Date		Client Info		04 Apr 2024	15 Dec 2021	
Machine Age	hrs	Client Info		60402	40875	
Oil Age	hrs	Client Info		6419	6491	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	0	<1	
Tin	ppm	ASTM D5185m	>10	0	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	20	
Barium	ppm	ASTM D5185m	90	17	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	0	<1	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	5	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		18629	16306	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	
Sodium	ppm	ASTM D5185m		1	<1	
Potassium	ppm	ASTM D5185m	>20	<1	0	
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
	1/011/	10T11 D0015				

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.38


0.38





OIL ANALYSIS REPORT

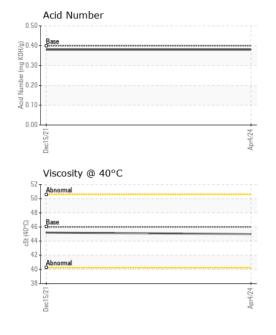













Certificate 12367

Laboratory Sample No.

Lab Number : 06147450

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UDI06147450

Unique Number : 10977528

Received : 12 Apr 2024 **Tested** : 15 Apr 2024 Diagnosed

: 16 Apr 2024 - Sean Felton

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL

US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931