

# **OIL ANALYSIS REPORT**


Sample Rating Trend



### Machine Id **Coopersville CAT 4 CPVM04BE** Biogas Engine

Fluid

CHEVRON HDAX 9500 GAS ENGINE OIL 40 (105 GAL)

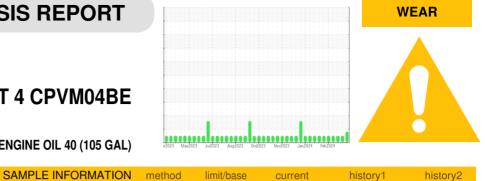

D	IAG	NO	SI	S

#### A Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### 🔺 Wear

The tin level is abnormal.

#### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sample Number		Client Info		WC0871560	WC0871588	WC0871505
Sample Date		Client Info		08 Apr 2024	28 Mar 2024	18 Mar 2024
Machine Age	hrs	Client Info		79844	79580	79392
Oil Age	hrs	Client Info		264	1	429
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ABNORMAL	NORMAL	NORMAL
·					-	-
CONTAMINATIO	N	method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>.11	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	1	1	1
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>6	2	2	2
Lead	ppm	ASTM D5185m	>9	3	0	1
Copper	ppm	ASTM D5185m		1	<1	1
Tin	ppm	ASTM D5185m	>4	4	<1	4
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	0	0
	ppm				-	-
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		2	3	2
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		3	3	3
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		7	6	8
Calcium	ppm	ASTM D5185m		1891	1715	1851
Phosphorus	ppm	ASTM D5185m		296	236	300
Zinc	ppm	ASTM D5185m		354	313	347
Sulfur	ppm	ASTM D5185m		2245	1946	2245
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>181	85	27	104
Sodium	ppm	ASTM D5185m	>21	2	2	2
Potassium	ppm	ASTM D5185m	>20	3	<1	3
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0.1
Nitration	Abs/cm	*ASTM D7624		7.1	5.2	7.2
Sulfation	Abs/.1mm	*ASTM D7415		18.4	15.4	19.6
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
<b>A</b>	AL / 4			14.0	8.7	15.4
Oxidation	Abs/.1mm	*ASTM D7414		14.0	0.7	10.4
Acid Number (AN)	Abs/.1mm mg KOH/g	ASTM D7414 ASTM D8045	1.0	1.27	0.46	1.23
			1.0 5.4			



## **OIL ANALYSIS REPORT**

limit/base

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>.11

13.4

eb29/24

current NONE

NONE

NONE

NONE

NONE

NONE


NORML

NORML

NEG

NEG



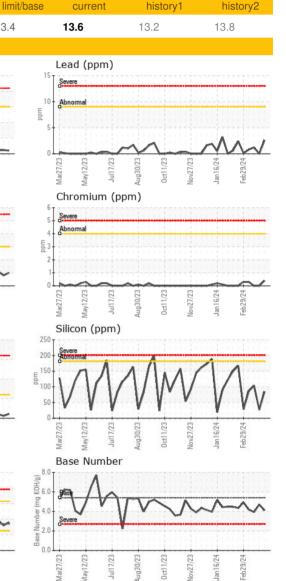

history1

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

history2

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG



Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : WC0871560 Received : 12 Apr 2024 Lab Number Tested : 15 Apr 2024 : 06147527 Unique Number : 10977605 Diagnosed : 16 Apr 2024 - Sean Felton Test Package : MOB 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Coopersville Powerstation, 15362 68th Avenue Coopersville, MI US 49404 Contact: Daniel Young daniel.young@edlenergy.com T: F:

**EDL NA Recips-Coopersville** 

Report Id: EDLCOO [WUSCAR] 06147527 (Generated: 04/17/2024 07:29:41) Rev: 1

Submitted By: Chad Conroy Page 2 of 2