




# OIL ANALYSIS REPORT



Machine Id  
**HANM02BE (S/N 3RC00182)**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (95 GAL)**

Sample Rating Trend

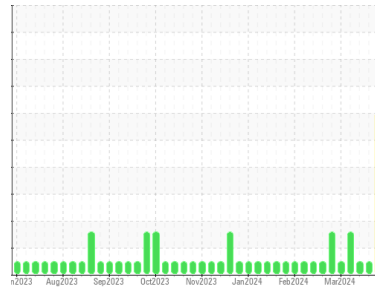

## DIAGNOSIS

### ▲ Recommendation

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

### ▲ Wear

The tin level is severe.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0898113</b>	WC0898110	WC0898122
Sample Date	Client Info		<b>10 Apr 2024</b>	03 Apr 2024	29 Mar 2024
Machine Age	hrs	Client Info	<b>72674</b>	72504	72384
Oil Age	hrs	Client Info	<b>524</b>	354	234
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>SEVERE</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>.11	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>&lt;1</b>	1	0
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >6	<b>2</b>	2	2
Lead	ppm	ASTM D5185m >9	<b>3</b>	0	0
Copper	ppm	ASTM D5185m >6	<b>&lt;1</b>	1	<1
Tin	ppm	ASTM D5185m >4	<b>▲ 6</b>	3	4
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>14</b>	14	10
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>5</b>	3	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>21</b>	18	8
Calcium	ppm	ASTM D5185m	<b>2103</b>	1762	1786
Phosphorus	ppm	ASTM D5185m	<b>338</b>	294	290
Zinc	ppm	ASTM D5185m	<b>429</b>	352	343
Sulfur	ppm	ASTM D5185m	<b>3030</b>	2669	2586

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	<b>119</b>	94	87
Sodium	ppm	ASTM D5185m >21	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>3</b>	0	<1

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	<b>7.1</b>	6.5	6.3
Sulfation	Abs/.1mm	*ASTM D7415	<b>21.1</b>	18.9	18.1


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	<b>16.4</b>	13.0	12.0
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>1.79</b>	1.05	0.72
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	<b>3.71</b>	4.36	4.13




# OIL ANALYSIS REPORT


## Non-ferrous Metals

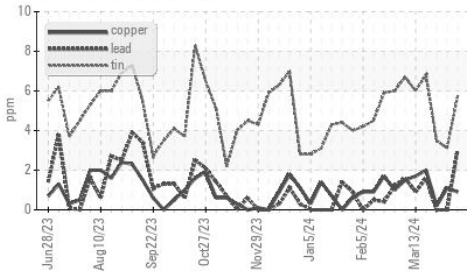


## FT-IR (Direct Trend)

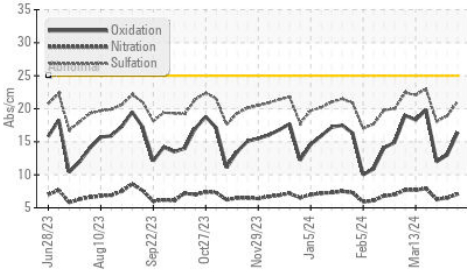


## Acid Number

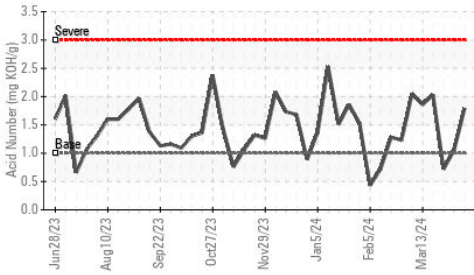

## Base Number

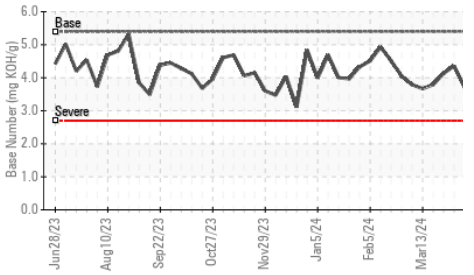

## Viscosity @ 100°C

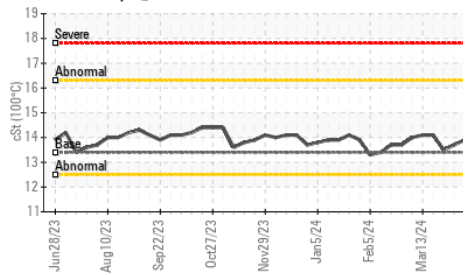


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.9	13.7

## GRAPHS


### Iron (ppm)

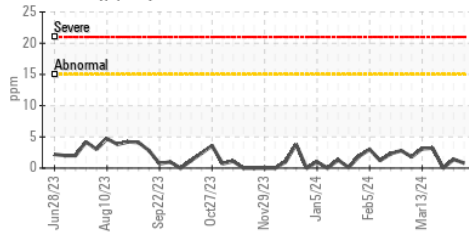


### Aluminum (ppm)

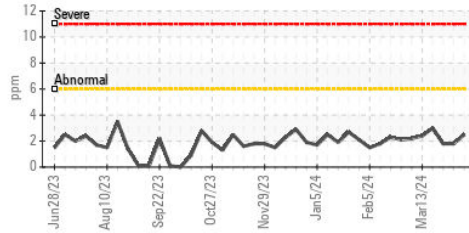


### Copper (ppm)

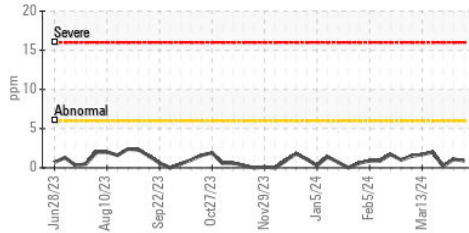


### Viscosity @ 100°C

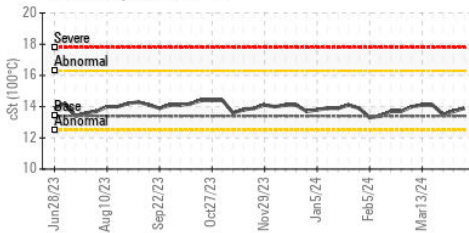


### Lead (ppm)

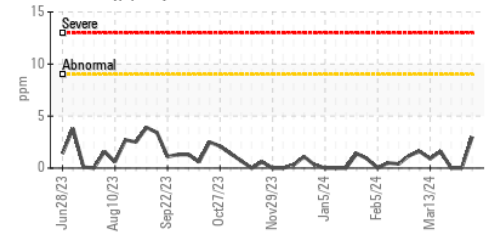


### Chromium (ppm)

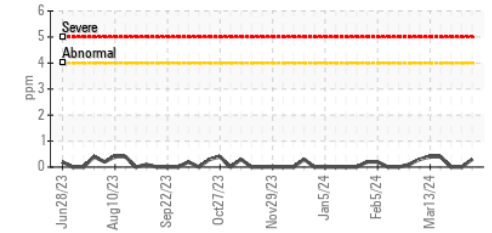

### Silicon (ppm)

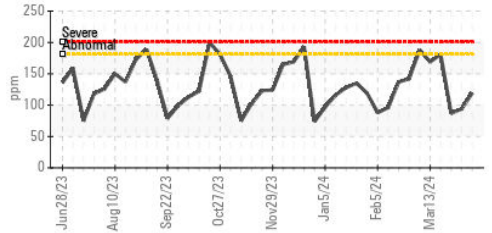

### Base Number

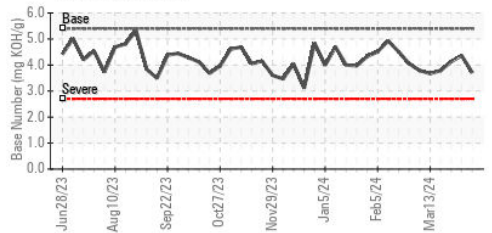

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0898113

Lab Number : 06147533

Unique Number : 10977611

Test Package : MOB 2

Received : 12 Apr 2024

Tested : 15 Apr 2024

Diagnosed : 16 Apr 2024 - Sean Felton

EDL NA Recips-Hancock County

HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142

FINDLAY, OH

US 45840

Contact: TIM CUSICK

tim.cusick@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)