



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
TANK A001
 Component
New (Unused) Oil
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TLC0001670	---	---
Sample Date	Client Info			01 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ATTENTION	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>5	0	---	---
Copper	ppm	ASTM D5185m	>5	0	---	---
Tin	ppm	ASTM D5185m	>5	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		2	---	---
Calcium	ppm	ASTM D5185m		13	---	---
Phosphorus	ppm	ASTM D5185m		8	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		67	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	---	---
Sodium	ppm	ASTM D5185m		0	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304		NEG	---	---


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	8190	---	---
Particles >6µm		ASTM D7647	>1300	2404	---	---
Particles >14µm		ASTM D7647	>160	75	---	---
Particles >21µm		ASTM D7647	>40	17	---	---
Particles >38µm		ASTM D7647	>10	1	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	20/18/13	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.051	---	---




OIL ANALYSIS REPORT


Particle Trend

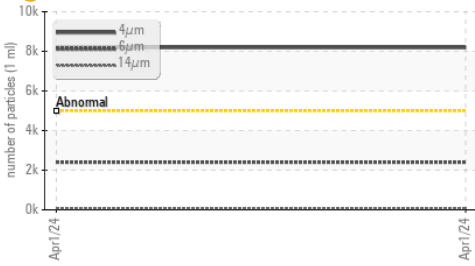


Particle Trend

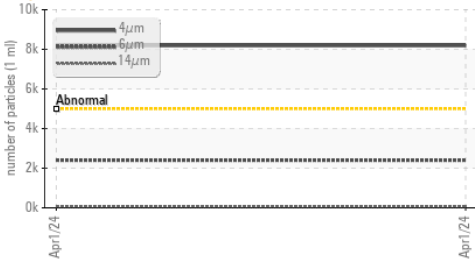

Acid Number

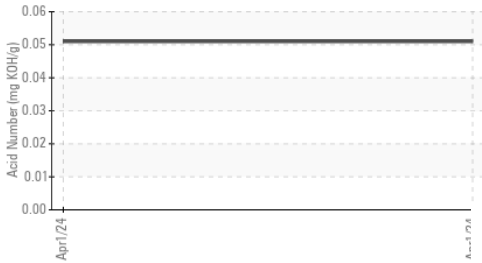

Viscosity @ 100°C

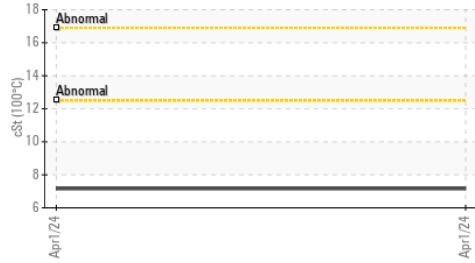

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.68	---	---
Visc @ 100°C	cSt	ASTM D445	7.16	---	---
Viscosity Index (VI)	Scale	ASTM D2270	116	---	---

SAMPLE IMAGES


SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

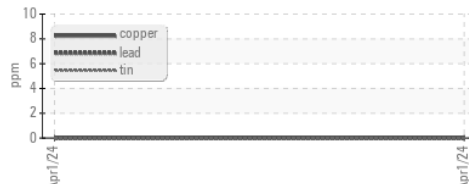


Viscosity @ 40°C

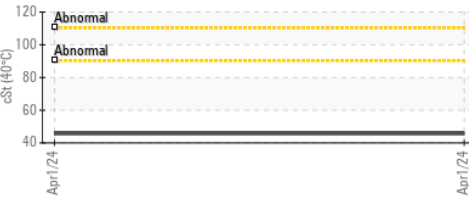

Particle Count

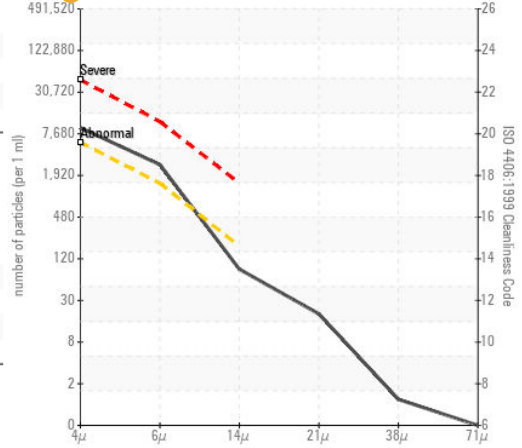

Acid Number

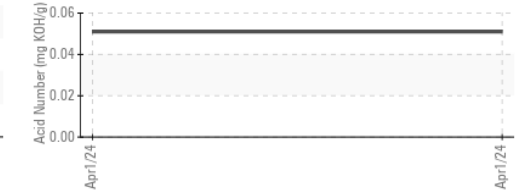

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : TLC0001670

Lab Number : 06147874

Unique Number : 10977952

Test Package : PLANT (Additional Tests: FT-IR, KV100, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 12 Apr 2024

Tested : 16 Apr 2024

Diagnosed : 16 Apr 2024 - Jonathan Hester

SUPPLY PRO

115 EMPIRE WAY

ATLANTA, GA

US 30354

Contact: MICHAEL JACKSON

mjackson@supplypro1.com

T: (470)991-1693

F: