




# OIL ANALYSIS REPORT

Sample Rating Trend

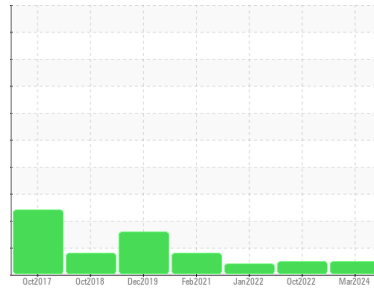

**NORMAL**



Machine Id  
**KAESER SK 26 1424103 (S/N 0268701)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA013476</b>	KCP50077	KCP48523
Sample Date	Client Info		<b>21 Mar 2024</b>	20 Oct 2022	17 Jan 2022
Machine Age	hrs	Client Info	<b>45745</b>	41099	37912
Oil Age	hrs	Client Info	<b>2594</b>	3187	1924
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	2
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>7</b>	6	6
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 100	<b>7</b>	4	9
Calcium	ppm	ASTM D5185m 0	<b>4</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	4	3
Zinc	ppm	ASTM D5185m 0	<b>122</b>	88	138
Sulfur	ppm	ASTM D5185m 23500	<b>22060</b>	22809	18601

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	2
Sodium	ppm	ASTM D5185m	<b>6</b>	<1	4
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	<1
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.022	0.006
ppm Water	ppm	ASTM D6304 >500	<b>56</b>	224.9	60.6






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>6388</b>	2114	---
Particles >6µm	ASTM D7647 >1300		<b>1158</b>	246	---
Particles >14µm	ASTM D7647 >80		<b>59</b>	14	---
Particles >21µm	ASTM D7647 >20		<b>16</b>	5	---
Particles >38µm	ASTM D7647 >4		<b>1</b>	0	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>20/17/13</b>	18/15/11	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.46</b>	0.46	0.43


# OIL ANALYSIS REPORT

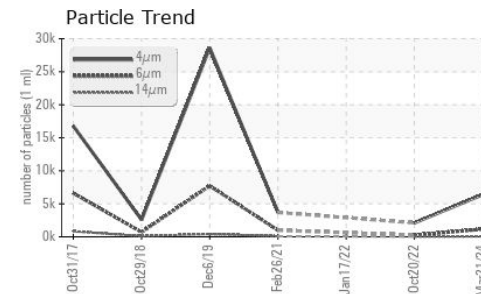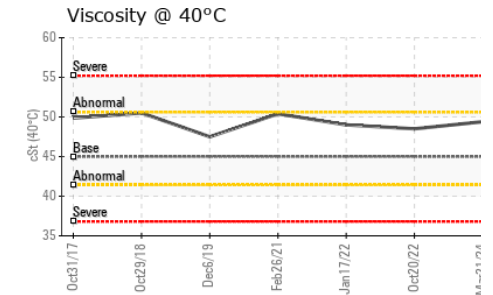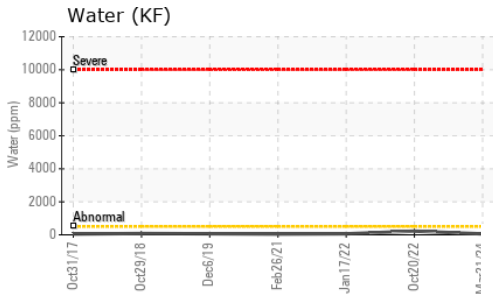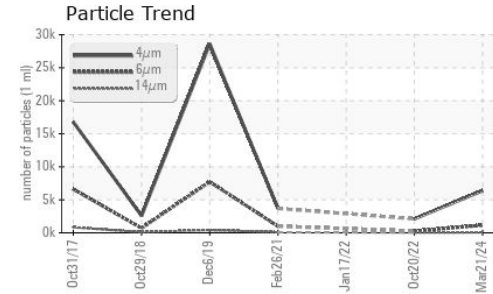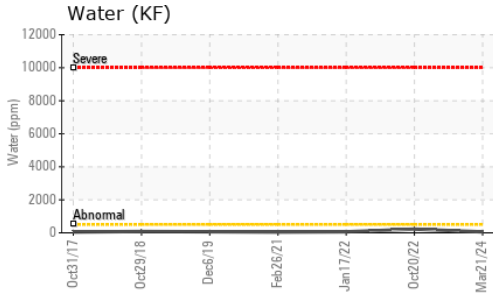






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE ▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.4	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

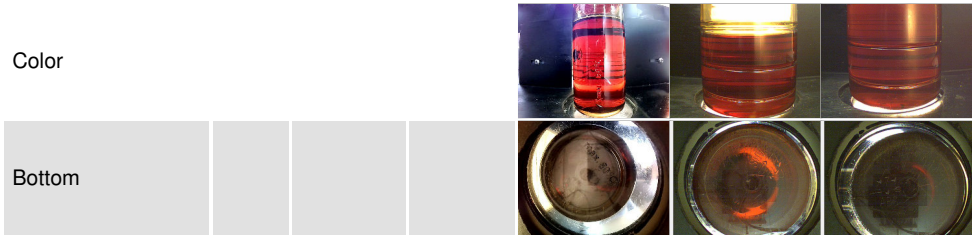

## GRAPHS

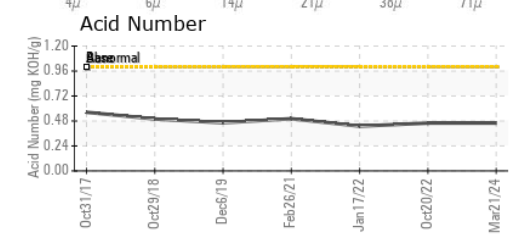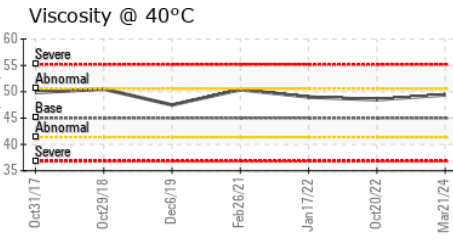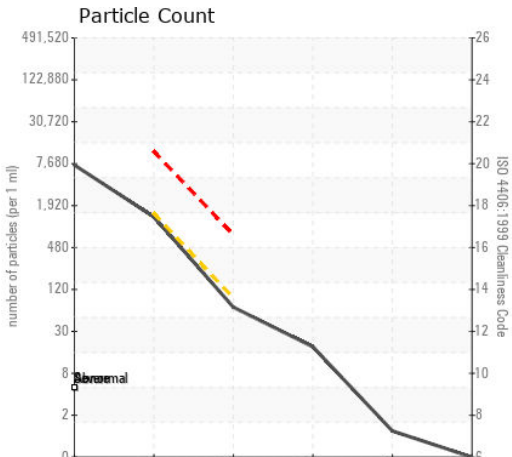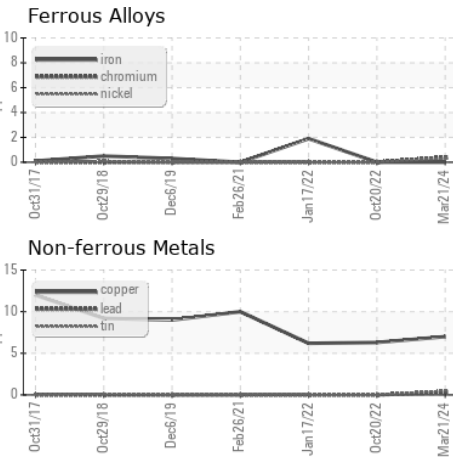

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA013476 **Received** : 12 Apr 2024  
**Lab Number** : 06148096 **Tested** : 15 Apr 2024  
**Unique Number** : 10978174 **Diagnosed** : 17 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**MASONICARE**  
 22 MASONIC AVE  
 WALLINGFORD, CT  
 US 06492  
 Contact: P MCCOY  
 PMCCOY@MASONICARE.ORG

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: