




# OIL ANALYSIS REPORT

Sample Rating Trend

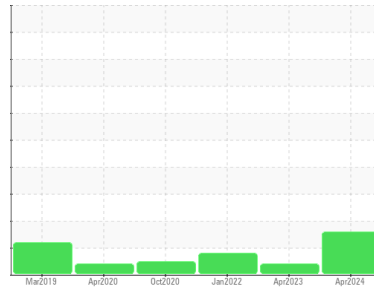

ISO



Machine Id  
**KAESER ASD40 6452570 (S/N 1004)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA017027</b>	KCPA001146	KCP34867
Sample Date	Client Info			<b>03 Apr 2024</b>	17 Apr 2023	10 Jan 2022
Machine Age	hrs	Client Info		<b>18898</b>	16065	12478
Oil Age	hrs	Client Info		<b>5000</b>	0	4000
Oil Changed	Client Info			<b>Changed</b>	N/A	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>14</b>	5	16
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	3	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>&lt;1</b>	39	0
Calcium	ppm	ASTM D5185m	2	<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>22</b>	<1	2
Zinc	ppm	ASTM D5185m		<b>0</b>	13	3
Sulfur	ppm	ASTM D5185m		<b>22852</b>	20397	18741

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	2	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	0
Water	%	ASTM D6304	>0.05	<b>0.007</b>	0.040	0.004
ppm Water	ppm	ASTM D6304	>500	<b>75</b>	401.9	40.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5129</b>	---	9485
Particles >6µm		ASTM D7647	>1300	<b>1598</b>	---	3626
Particles >14µm		ASTM D7647	>80	<b>143</b>	---	121
Particles >21µm		ASTM D7647	>20	<b>41</b>	---	18
Particles >38µm		ASTM D7647	>4	<b>2</b>	---	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>18/14</b>	---	19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.56</b>	0.36	0.46


# OIL ANALYSIS REPORT

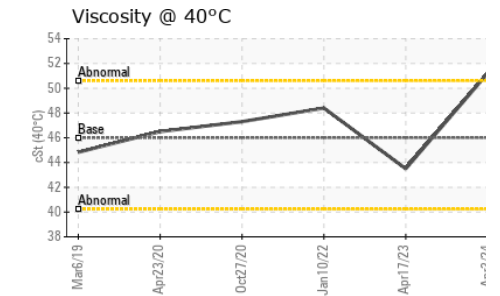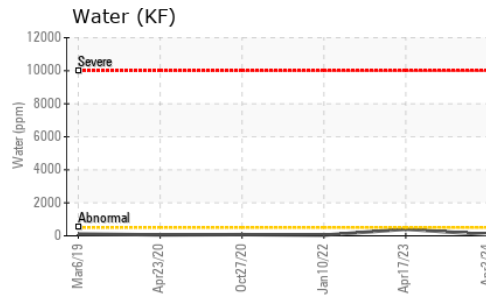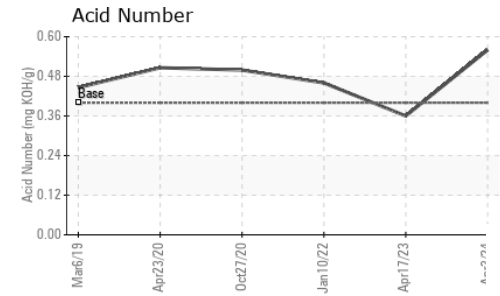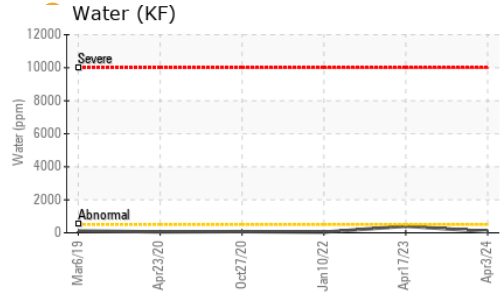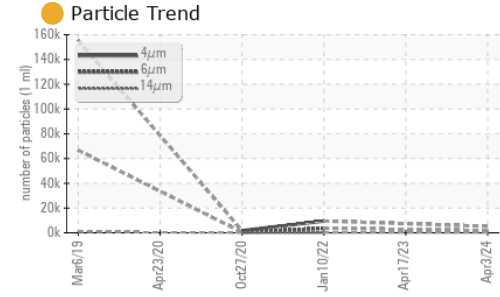





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	51.2	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

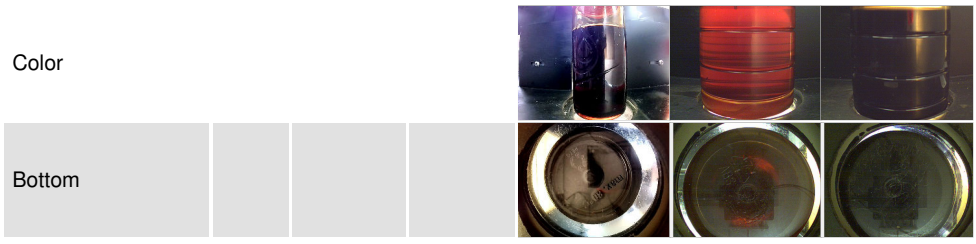

## GRAPHS

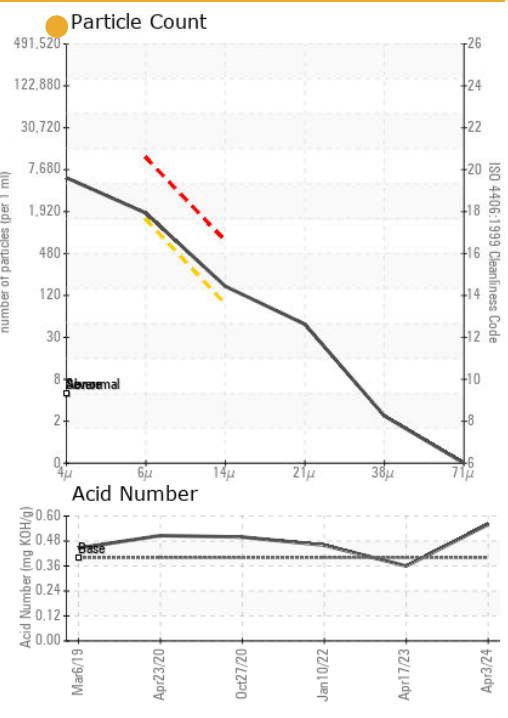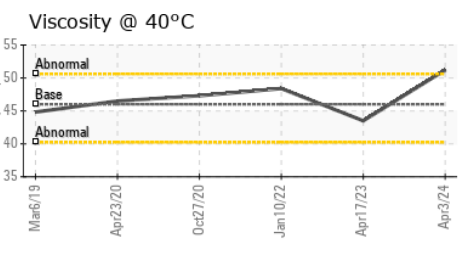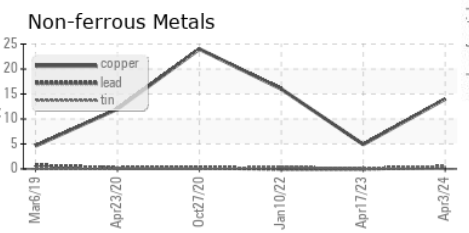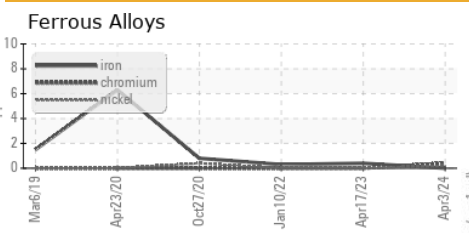

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017027  
**Lab Number** : 06148097  
**Unique Number** : 10978175  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 12 Apr 2024  
**Tested** : 15 Apr 2024  
**Diagnosed** : 17 Apr 2024 - Jonathan Hester

**TRUCK CENTERS INC**  
 2280 FORMOSA RD  
 TROY, IL  
 US 62294  
 Contact: T BERGMAN  
 TBERGMAN@TRUCKCENTERSINC.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)