

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER SM 10 6680366 (S/N 1105)

Component Compressor Fluid

KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

🔺 Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016908	KCP41625	
Sample Date		Client Info		08 Apr 2024	11 Aug 2021	
Machine Age	hrs	Client Info		12417	9153	
Oil Age	hrs	Client Info		413	2929	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	6	3	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<u> </u>	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>10	<1	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m		1	0	
Calcium	ppm	ASTM D5185m		4	0	
Phosphorus	ppm	ASTM D5185m	500	507	215	
Zinc	ppm	ASTM D5185m		189	253	
Sulfur	ppm	ASTM D5185m		2178	1325	
CONTAMINANTS	le le	method	limit/base	current	history1	history2
		ASTM D5185m				
Silicon	ppm		>25	0	0	
Sodium	ppm	ASTM D5185m ASTM D5185m	. 00	0	1	
Potassium	ppm		>20	1	<1	
Water	%	ASTM D6304		0.039	0.001	
ppm Water	ppm	ASTM D6304	>500	390	3.6	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	1000	3183	10297	
Particles >6µm		ASTM D7647		413	2162	
Particles >14µm		ASTM D7647	>80	24	147	
Particles >21µm		ASTM D7647		7	24	
Particles >38µm		ASTM D7647	>4	0	2	
Particles >71µm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/16/12	18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN) :29:37) Rev: 1	mg KOH/g	ASTM D8045	1.5 Coi	1.43 ntact/Location: S	0.531 Service Manage	r - ALASANTE


Report Id: ALASANTEX [WUSCAR] 06148101 (Generated: 04/18/2024 14:29:37) Rev: 1


Contact/Location: Service Manager - ALASANTEX




OIL ANALYSIS REPORT





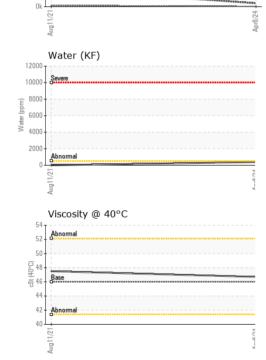

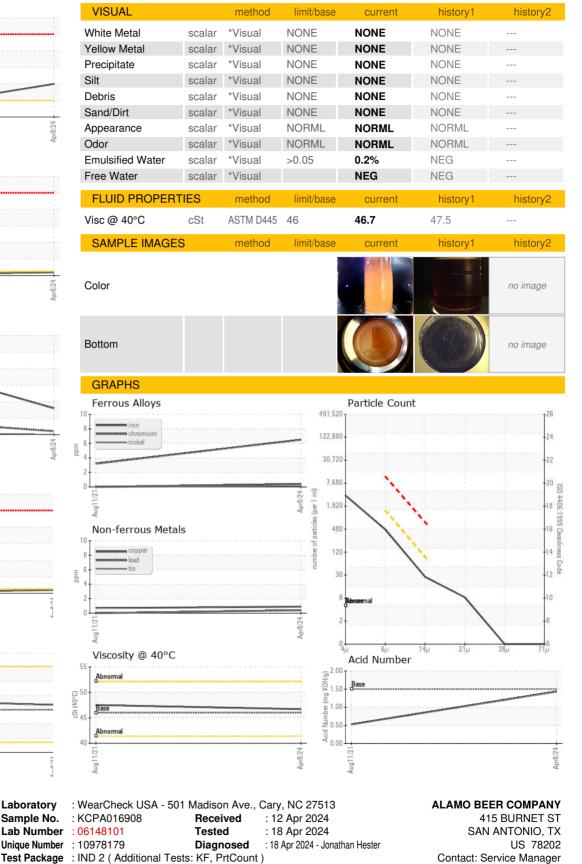



Report Id: ALASANTEX [WUSCAR] 06148101 (Generated: 04/18/2024 14:29:37) Rev: 1

Certificate 12367

Laboratory

Sample No.

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - ALASANTEX

T:

F: