

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



# AREA III [500319850] MARLEY U9496 (S/N CT #15) Gearbox

MOBIL SHC 629 (3 GAL)

וט	A١	Ġſ	ИC	S	IS	

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0908662	WC0844039	WC0780990
Sample Date		Client Info		07 Mar 2024	12 Sep 2023	09 Mar 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	SEVERE
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.2	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	5	5	6
Chromium	ppm	ASTM D5185m	>15	<1	0	0
Nickel	ppm	ASTM D5185m	>15	<1	0	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	0	<1
Lead	ppm	ASTM D5185m	>100	<1	0	0
Copper	ppm	ASTM D5185m	>200	<1	0	<1
Tin	ppm	ASTM D5185m	>25	<1	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		<1	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	<1
Calcium	ppm	ASTM D5185m		3	0	<1
Phosphorus	ppm	ASTM D5185m		484	453	509
Zinc	ppm	ASTM D5185m		0	0	1
Sulfur	ppm	ASTM D5185m		23	39	28
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	17	14	19
Sodium	ppm	ASTM D5185m		0	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	2	1
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2

0.48

0.42

Acid Number (AN)


mg KOH/g ASTM D8045

0.50




140 130 120

## **OIL ANALYSIS REPORT**



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	▲ HEAVY	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.2	NEG	0.2%	0.2%
Free Water	scalar	*Visual		NEG	NEG	▲ 5.0
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	142.8	159	158	156
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						
Bottom				30-3		

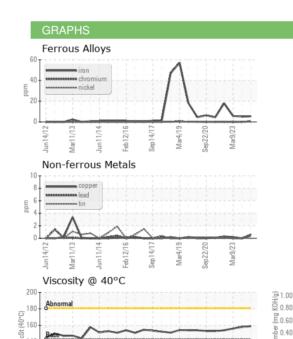





Certificate 12367

Laboratory Sample No.

Lab Number : 06148112 Unique Number : 10978190

120

: WC0908662

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 12 Apr 2024 **Tested** : 16 Apr 2024

Diagnosed : 17 Apr 2024 - Jonathan Hester

Mar9/23

SI GROUP INC - ALBEMARLE

725 CANNON BRIDGE RD ORANGEBURG, SC US 29115

Contact: ERIC PROVEAUX

eric.proveaux@contractors.siigroup.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (803)539-5228 F: (803)539-5426

Acid Number

툴 0.20 0.00 Acid

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: ALBORA [WUSCAR] 06148112 (Generated: 04/17/2024 15:51:18) Rev: 1

Submitted By: KIRK WILLIAMS