




OIL ANALYSIS REPORT

Sample Rating Trend

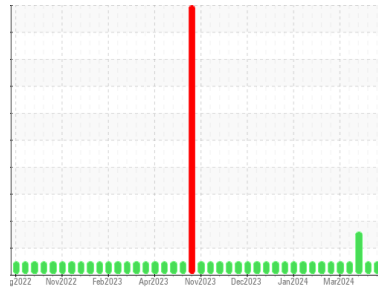

NORMAL



Machine Id

LGS00178

Component

Biogas Engine

Fluid

MAHLER Q8 Mahler G8 SAE 40 (141 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0880271	WC0880273	WC0880275
Sample Date	Client Info			11 Apr 2024	05 Apr 2024	26 Mar 2024
Machine Age	hrs	Client Info		66928	66849	66714
Oil Age	hrs	Client Info		173	94	430
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>0.1		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	<1	2	5
Chromium	ppm	ASTM D5185m	>2	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	<1	<1	<1
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	2	3
Lead	ppm	ASTM D5185m	>5	2	<1	3
Copper	ppm	ASTM D5185m	>14	5	3	11
Tin	ppm	ASTM D5185m	>13	2	<1	3
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		<1	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		6	5	6
Calcium	ppm	ASTM D5185m		2356	2176	2353
Phosphorus	ppm	ASTM D5185m		419	341	402
Zinc	ppm	ASTM D5185m		480	414	475
Sulfur	ppm	ASTM D5185m		4562	3699	5186

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	118	76	▲ 205
Sodium	ppm	ASTM D5185m		0	2	0
Potassium	ppm	ASTM D5185m	>20	1	0	2


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	4.8	4.8	5.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.3	18.9	22.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.1	8.9	10.5
Acid Number (AN)	mg KOH/g	ASTM D8045		1.18	1.12	1.60
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	5.72	6.01	4.14




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

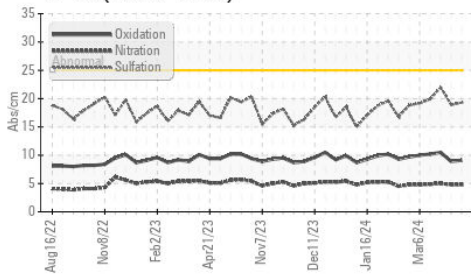


Acid Number

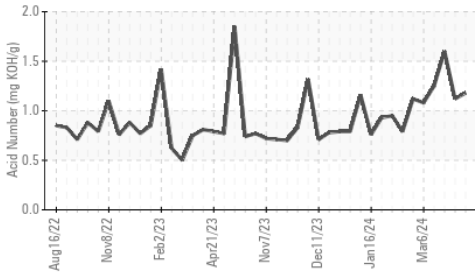

Base Number

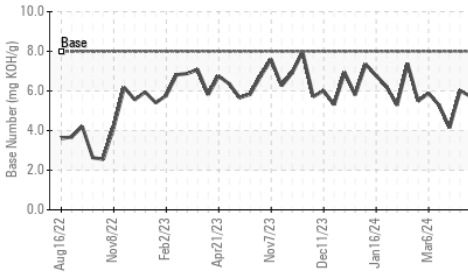









Viscosity @ 100°C

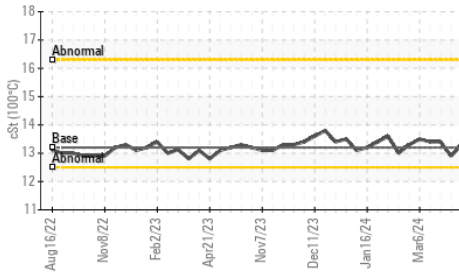

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	13.3	12.9

GRAPHS

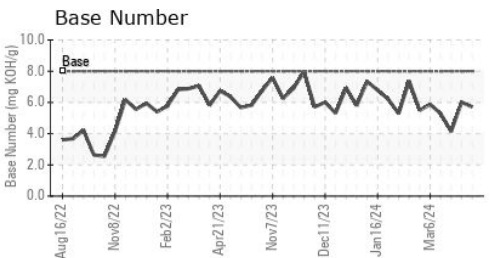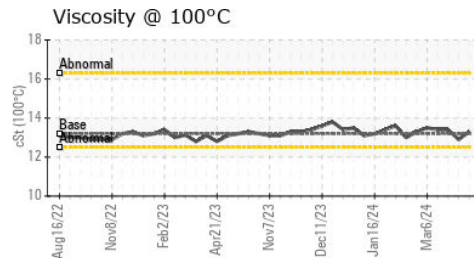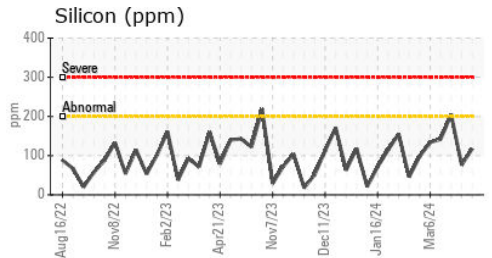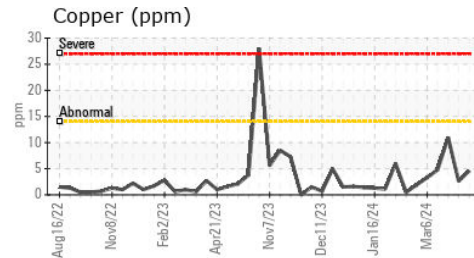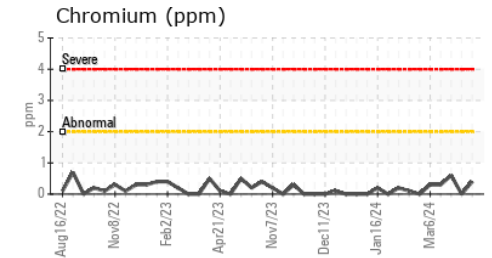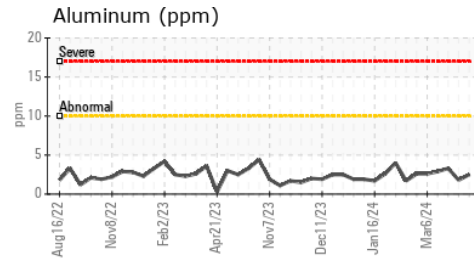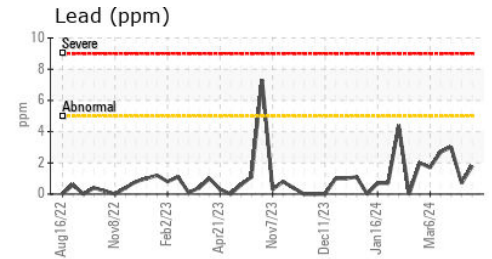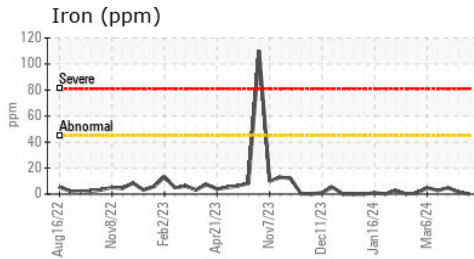

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0880271

Lab Number : 06148147

Unique Number : 10978225

Test Package : MOB 2

Received : 12 Apr 2024

Tested : 15 Apr 2024

Diagnosed : 16 Apr 2024 - Sean Felton

BI-COUNTY

3214 DOVER RD

WOODLAWN, TN

US 37191

Contact: KEVIN WEAVER

kevin.weaver@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)