




OIL ANALYSIS REPORT

Sample Rating Trend

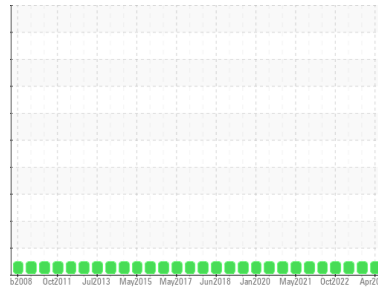

NORMAL



Area

BARRIER DEPARTMENT SAMPLES WEB 03 SD SUBSTRATE WEB 03 SD

Machine Id

Component

Fluid

TEXACO MEROPA 220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0757223	WC0869567	WC0757198
Sample Date	Client Info			14 Apr 2024	20 Nov 2023	04 Apr 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	57	57	40
Chromium	ppm	ASTM D5185m	>15	<1	1	<1
Nickel	ppm	ASTM D5185m	>15	0	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	2	0
Lead	ppm	ASTM D5185m	>100	0	<1	<1
Copper	ppm	ASTM D5185m	>200	1	1	1
Tin	ppm	ASTM D5185m	>25	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	3.2	2	3	3
Barium	ppm	ASTM D5185m	0.5	0	4	0
Molybdenum	ppm	ASTM D5185m	1.1	0	<1	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	0.1	1	<1	0
Calcium	ppm	ASTM D5185m	1.6	5	4	3
Phosphorus	ppm	ASTM D5185m	159	187	246	248
Zinc	ppm	ASTM D5185m	0.5	8	9	15
Sulfur	ppm	ASTM D5185m	10342	5170	5432	5518

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	2	4	3
Sodium	ppm	ASTM D5185m		2	1	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8761	1574	1275
Particles >6µm		ASTM D7647	>5000	975	294	274
Particles >14µm		ASTM D7647	>640	26	20	19
Particles >21µm		ASTM D7647	>160	6	5	3
Particles >38µm		ASTM D7647	>40	0	0	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/19/16	20/17/12	18/15/11	17/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.56	0.48	0.64




OIL ANALYSIS REPORT


Particle Trend

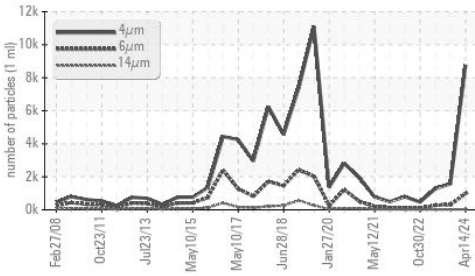


Acid Number

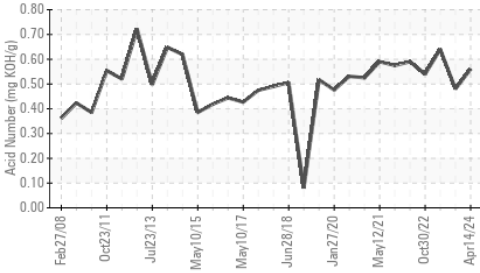

Viscosity @ 40°C

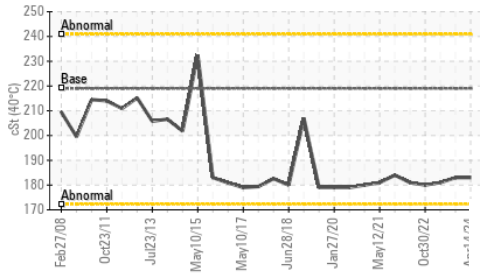

Particle Trend

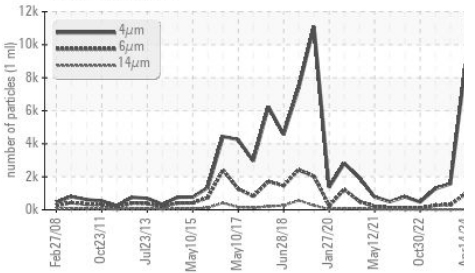

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 219	183	183	181

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

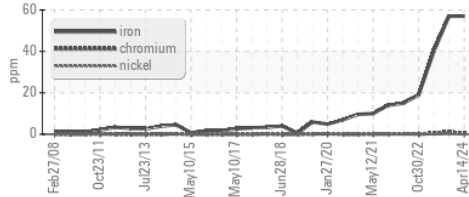


Non-ferrous Metals

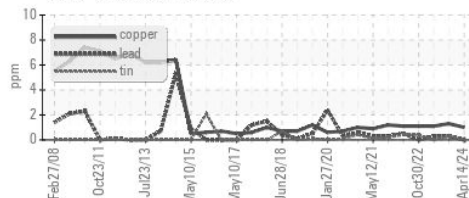


Viscosity @ 40°C

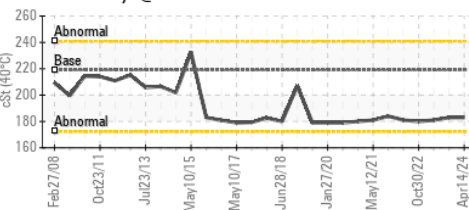

Particle Count

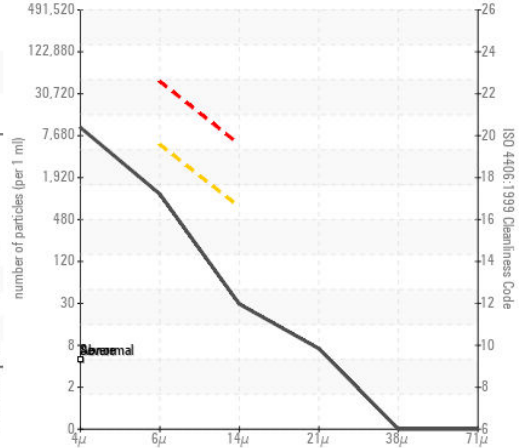

Acid Number

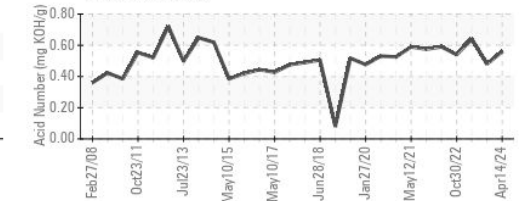

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0757223

Lab Number : 06148669

Unique Number : 10978747

Test Package : IND 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 15 Apr 2024

Tested : 16 Apr 2024

Diagnosed : 16 Apr 2024 - Wes Davis

SEALED AIR CORP - CRYOVAC DIVISION

1301 WEST MAGNOLIA AVE

IOWA PARK, TX

US 76367

Contact: KEVIN KETCHERSID

kevin.a.ketchersid@sealedair.com

T: (940)592-2111

F: (940)592-2513