




OIL ANALYSIS REPORT

Sample Rating Trend

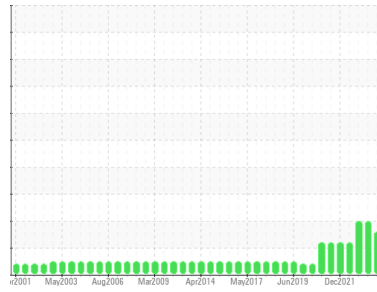

VISCOSITY



Area

BARRIER DEPARTMENT SAMPLES

Machine Id

DAVIS STAND WEB 05 SF SUBSTRATE (S/N M6191)

Component

Gearbox

Fluid

TEXACO MEROPA 220 (12 GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

● Fluid Condition

Viscosity of sample indicates oil is within ISO 320 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0913522	WC0806379	WC0757251
Sample Date	Client Info			14 Apr 2024	08 Oct 2023	04 Apr 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	25	29	34
Chromium	ppm	ASTM D5185m	>15	<1	0	<1
Nickel	ppm	ASTM D5185m	>15	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	0
Lead	ppm	ASTM D5185m	>100	0	<1	0
Copper	ppm	ASTM D5185m	>200	1	<1	<1
Tin	ppm	ASTM D5185m	>25	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	3.2	4	7	6
Barium	ppm	ASTM D5185m	0.5	0	0	1
Molybdenum	ppm	ASTM D5185m	1.1	4	5	6
Manganese	ppm	ASTM D5185m		1	2	2
Magnesium	ppm	ASTM D5185m	0.1	6	7	5
Calcium	ppm	ASTM D5185m	1.6	13	16	13
Phosphorus	ppm	ASTM D5185m	159	148	182	182
Zinc	ppm	ASTM D5185m	0.5	15	17	21
Sulfur	ppm	ASTM D5185m	10342	3831	3941	4322

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	2	2	3
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	1	<1	1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	▲ 189450	▲ 149851	▲ 143512
Particles >6µm		ASTM D7647	>5000	▲ 27295	▲ 43340	▲ 34850
Particles >14µm		ASTM D7647	>640	411	▲ 674	▲ 882
Particles >21µm		ASTM D7647	>160	48	92	135
Particles >38µm		ASTM D7647	>40	1	2	2
Particles >71µm		ASTM D7647	>10	0	2	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	▲ 25/22/16	▲ 24/23/17	▲ 24/22/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.49	0.47	0.43


OIL ANALYSIS REPORT

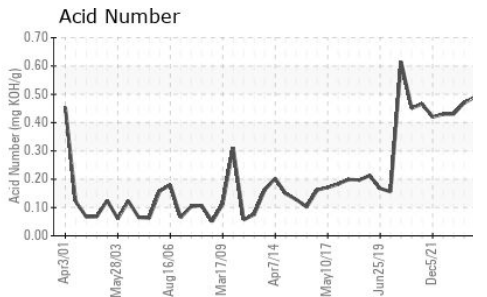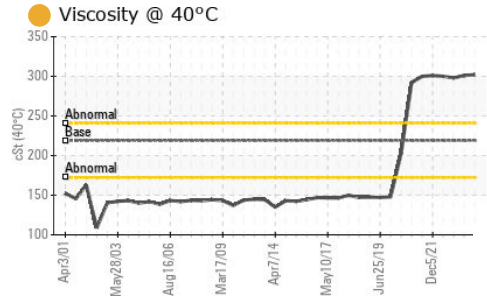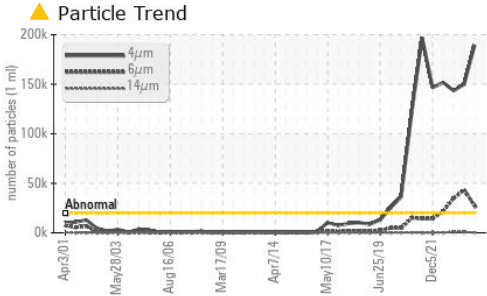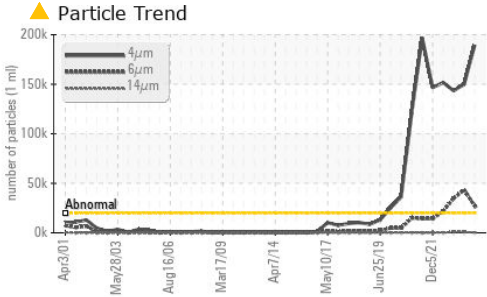





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 219	302	301	298

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

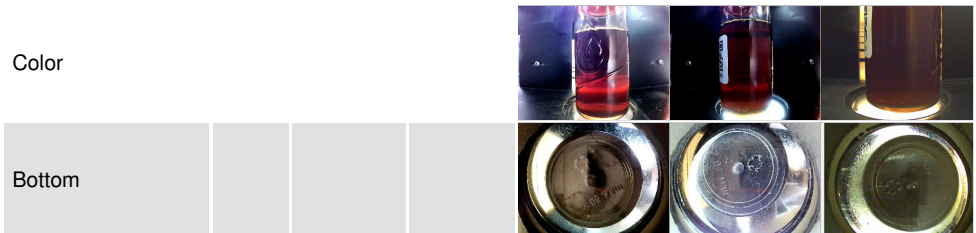

GRAPHS

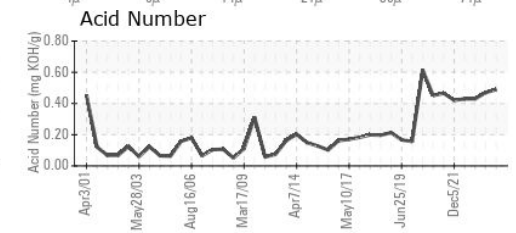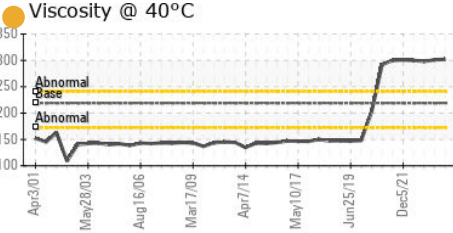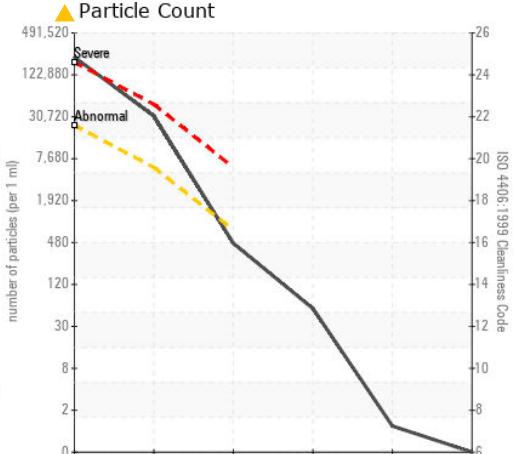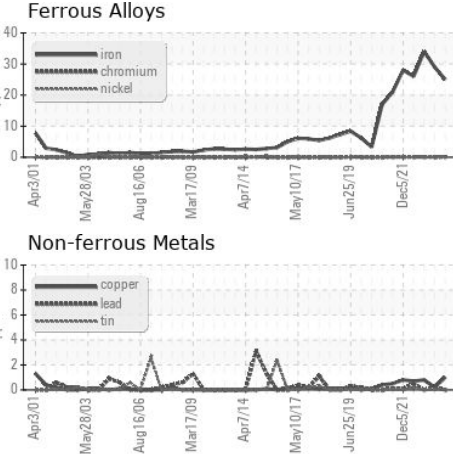

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0913522 **Received** : 15 Apr 2024
Lab Number : 06148685 **Tested** : 16 Apr 2024
Unique Number : 10978763 **Diagnosed** : 17 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

SEALED AIR CORP - CRYOVAC DIVISION
 1301 WEST MAGNOLIA AVE
 IOWA PARK, TX
 US 76367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)