




OIL ANALYSIS REPORT

Sample Rating Trend

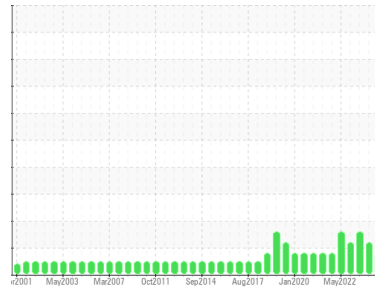

ISO



Area

BARRIER DEPARTMENT SAMPLES

Machine Id

DAVIS STAND WEB 04 SF SUBSTRATE (S/N M6192)

Component

Gearbox

Fluid

TEXACO MEROPA 220 (12 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | WC0913523 | WC0820999 | WC0757250 |
| Sample Date | Client Info | | | 14 Apr 2024 | 08 Oct 2023 | 04 Apr 2023 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | ABNORMAL | ABNORMAL | ABNORMAL |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|------------|----------|----------|
| Water | WC Method | | >0.2 | NEG | NEG | NEG |





| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >200 | 7 | 7 | 14 |
| Chromium | ppm | ASTM D5185m | >15 | <1 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >15 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | <1 | 0 | 0 |
| Lead | ppm | ASTM D5185m | >100 | 0 | 0 | 3 |
| Copper | ppm | ASTM D5185m | >200 | <1 | 0 | 6 |
| Tin | ppm | ASTM D5185m | >25 | 0 | <1 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|-------------|----------|----------|
| Boron | ppm | ASTM D5185m | 3.2 | 0 | 0 | 4 |
| Barium | ppm | ASTM D5185m | 0.5 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 1.1 | 2 | 1 | <1 |
| Manganese | ppm | ASTM D5185m | | 0 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 0.1 | 2 | 3 | 5 |
| Calcium | ppm | ASTM D5185m | 1.6 | 9 | 14 | 7 |
| Phosphorus | ppm | ASTM D5185m | 159 | 122 | 152 | 158 |
| Zinc | ppm | ASTM D5185m | 0.5 | 0 | 0 | 26 |
| Sulfur | ppm | ASTM D5185m | 10342 | 1214 | 1269 | 6434 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >50 | <1 | <1 | 18 |
| Sodium | ppm | ASTM D5185m | | <1 | 0 | 2 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | <1 | <1 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-------------------|------------|------------|
| Particles >4µm | | ASTM D7647 | >20000 | ▲ 67204 | ▲ 100959 | ▲ 79123 |
| Particles >6µm | | ASTM D7647 | >5000 | ▲ 4914 | ● 8333 | ▲ 14088 |
| Particles >14µm | | ASTM D7647 | >640 | 152 | 156 | ● 654 |
| Particles >21µm | | ASTM D7647 | >160 | 32 | 20 | 140 |
| Particles >38µm | | ASTM D7647 | >40 | 1 | 0 | 4 |
| Particles >71µm | | ASTM D7647 | >10 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >21/19/16 | ▲ 23/19/14 | ▲ 24/20/14 | ▲ 23/21/17 |


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.32 | 0.27 | 0.26 |

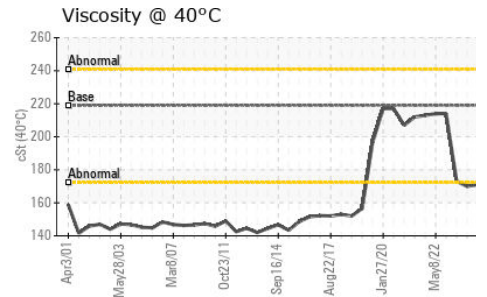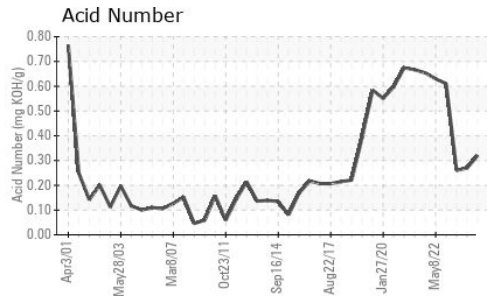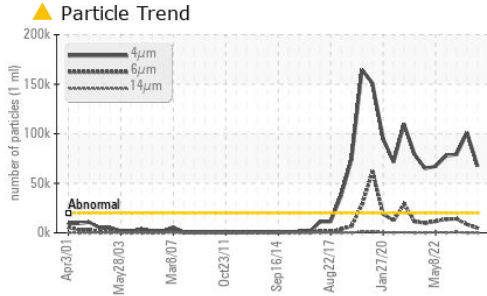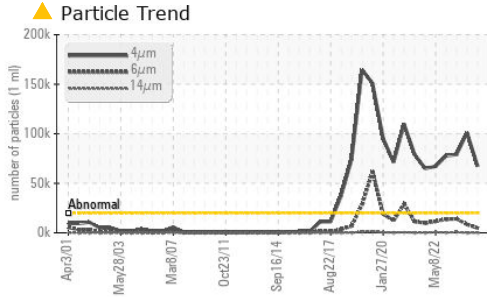






| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 219 | 171 | 170 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

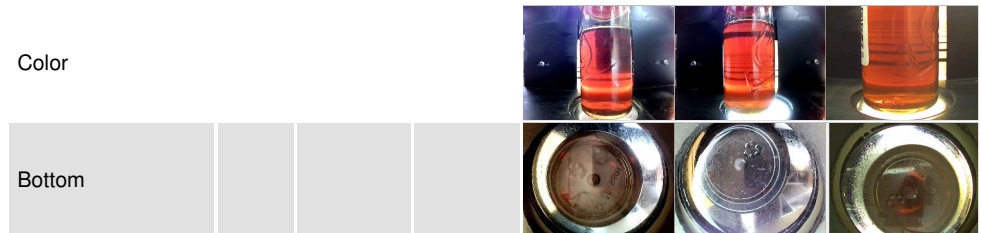

GRAPHS

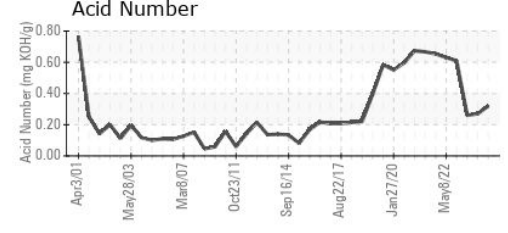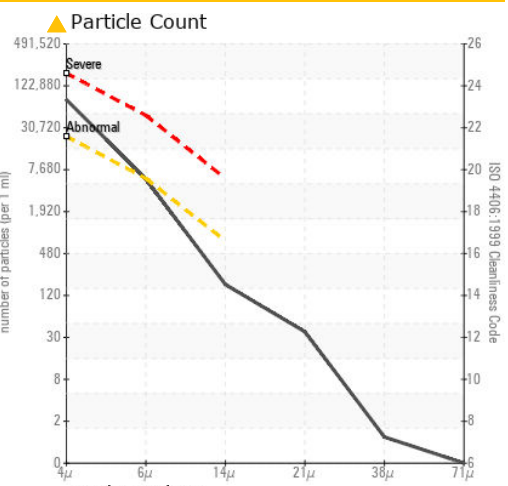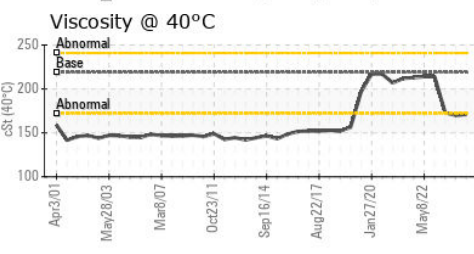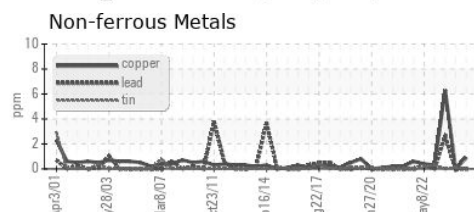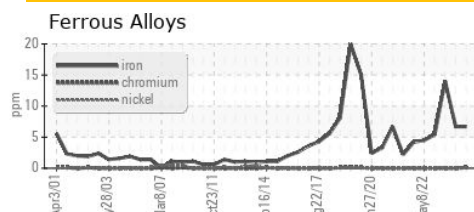

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0913523 **Received** : 15 Apr 2024
Lab Number : 06148696 **Tested** : 16 Apr 2024
Unique Number : 10978774 **Diagnosed** : 17 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

SEALED AIR CORP - CRYOVAC DIVISION
 1301 WEST MAGNOLIA AVE
 IOWA PARK, TX 76367
 Contact: KEVIN KETCHERSID
 kevin.a.ketchersid@sealedair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)