




# OIL ANALYSIS REPORT

## Sample Rating Trend

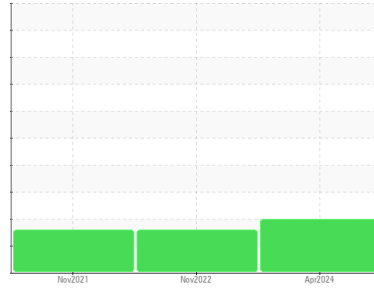

ISO



Machine Id  
**6238305 (S/N 1002)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC06148712</b>	KC107737	KC97506
Sample Date	Client Info			<b>08 Apr 2024</b>	17 Nov 2022	04 Nov 2021
Machine Age	hrs	Client Info		<b>12213</b>	10377	8170
Oil Age	hrs	Client Info		<b>0</b>	2000	3300
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>7</b>	9	14
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>17</b>	9	0
Calcium	ppm	ASTM D5185m	2	<b>48</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>10</b>	0	2
Zinc	ppm	ASTM D5185m		<b>20</b>	6	1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>7</b>	5	5
Sodium	ppm	ASTM D5185m		<b>5</b>	5	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.004</b>	0.011	0.007
ppm Water	ppm	ASTM D6304	>500	<b>46</b>	115.9	73.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>16009</b>	8295	43941
Particles >6µm		ASTM D7647	>1300	▲ <b>6624</b>	● 2115	▲ 11955
Particles >14µm		ASTM D7647	>80	▲ <b>772</b>	▲ 174	▲ 650
Particles >21µm		ASTM D7647	>20	▲ <b>228</b>	▲ 52	▲ 107
Particles >38µm		ASTM D7647	>4	▲ <b>10</b>	1	▲ 7
Particles >71µm		ASTM D7647	>3	▲ <b>1</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>21/20/17</b>	▲ 20/18/15	▲ 21/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.35</b>	0.33	0.309


# OIL ANALYSIS REPORT

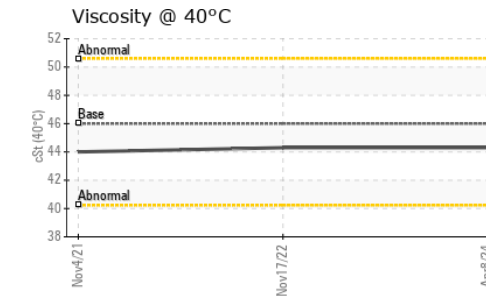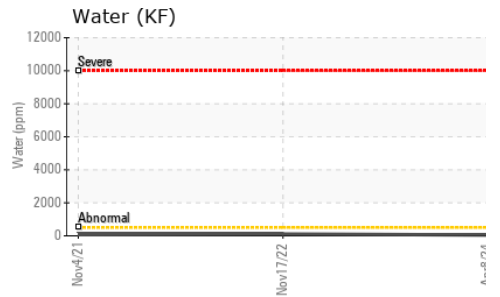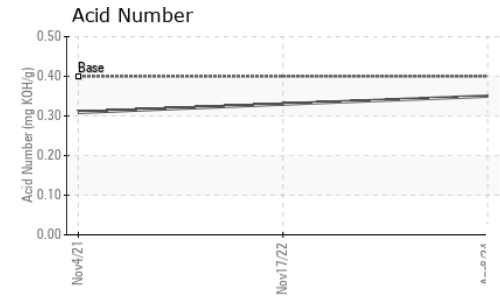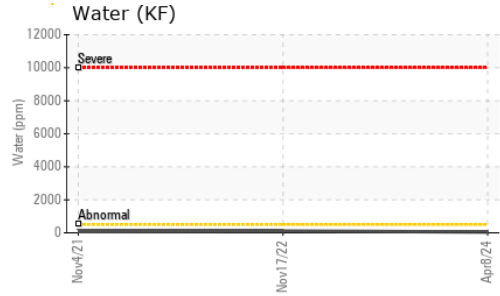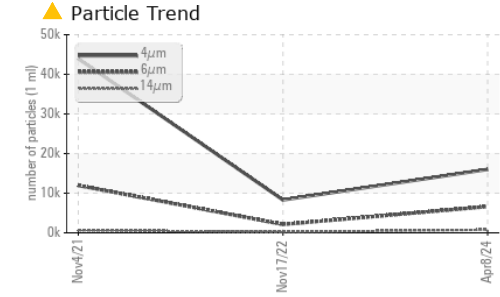





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	44.3	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

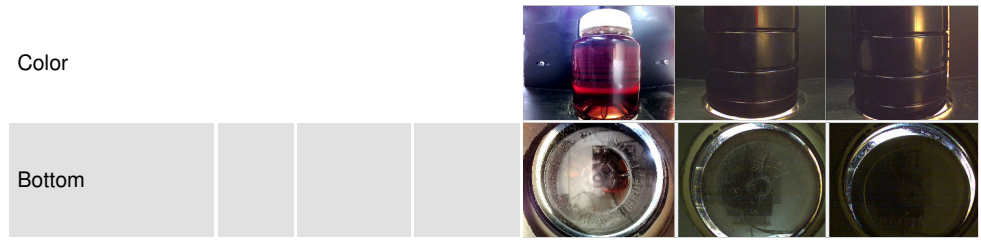

## GRAPHS

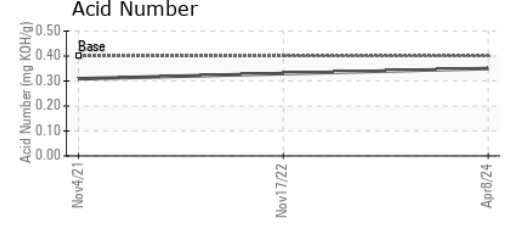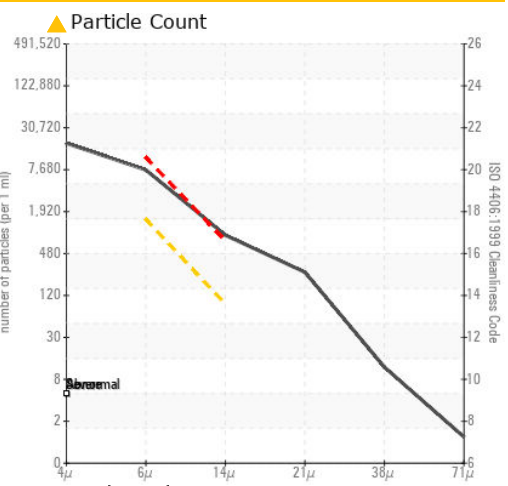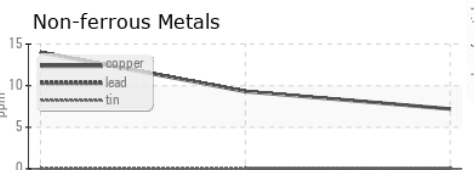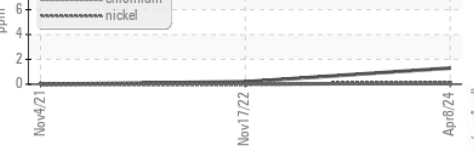

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06148712  
**Lab Number** : 06148712  
**Unique Number** : 10978790  
**Test Package** : IND 2  
**Received** : 15 Apr 2024  
**Tested** : 16 Apr 2024  
**Diagnosed** : 16 Apr 2024 - Doug Bogart

**RIIZE HOME**  
 31050 DIAMOND PKWY  
 GLENWILLOW, OH  
 US 44139  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)