

OIL ANALYSIS REPORT

Sample Rating Trend

DIRT

KAESER ASD 30T 8535604 (S/N 1163)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125809	KC106029	
Sample Date		Client Info		04 Apr 2024	20 Oct 2023	
Machine Age	hrs	Client Info		5469	2291	
Oil Age	hrs	Client Info		0	2291	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	5	
Tin	ppm		>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	<1	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	45	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	89	35	
Calcium	ppm	ASTM D5185m	2	4	0	
Phosphorus	ppm	ASTM D5185m		4	0	
Zinc	ppm	ASTM D5185m		17	35	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<u> </u>	6 9	
Sodium	ppm	ASTM D5185m		28	13	
Potassium	ppm	ASTM D5185m	>20	6	4	
Water	%	ASTM D6304	>0.05	0.021	0.016	
ppm Water	ppm	ASTM D6304	>500	217	167.8	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4491	12271	
Particles >6µm		ASTM D7647	>1300	984	2164	
Particles >14µm		ASTM D7647	>80	52	0100	
Particles >21µm		ASTM D7647	>20	9	20	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	21/18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.47	0.33	





Built for a lifetime

OIL ANALYSIS REPORT





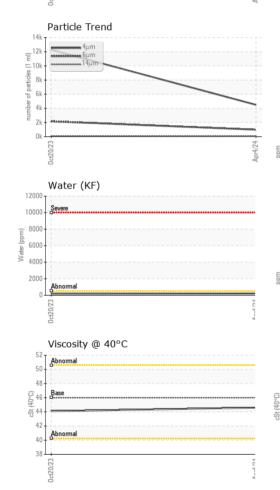

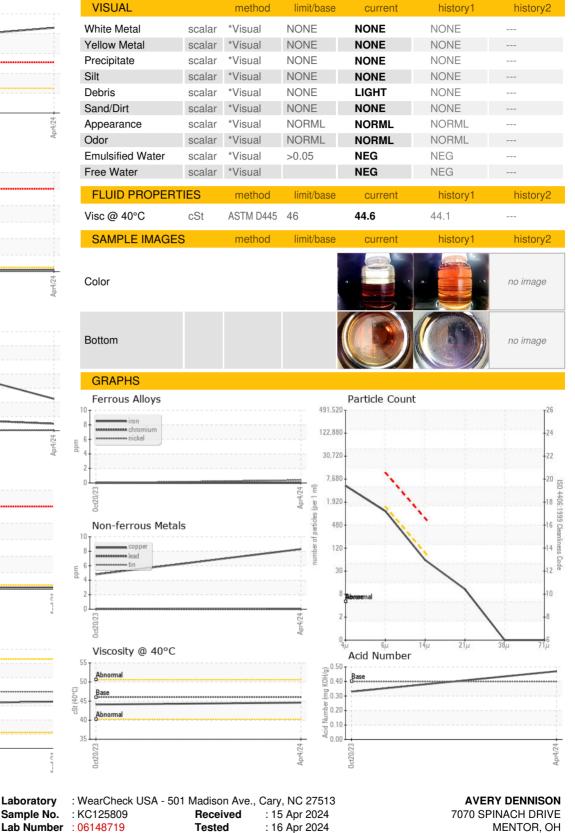

: 17 Apr 2024 - Don Baldridge

Laboratory

Sample No.

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

T: F:

Contact/Location: SERVICE MANAGER ? - AVEMEN

US 44060

Contact: SERVICE MANAGER