




# OIL ANALYSIS REPORT

## Sample Rating Trend

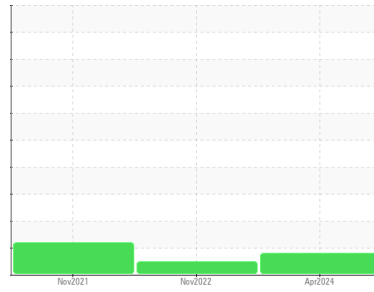

ISO



Machine Id  
**6339840 (S/N 1037)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC125804</b>	KC107736	KC97507
Sample Date	Client Info			<b>08 Apr 2024</b>	17 Nov 2022	04 Nov 2021
Machine Age	hrs	Client Info		<b>6731</b>	5281	5204
Oil Age	hrs	Client Info		<b>0</b>	77	334
Oil Changed		Client Info		<b>N/A</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>8</b>	3	8
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	12
Barium	ppm	ASTM D5185m	90	<b>&lt;1</b>	15	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>28</b>	54	9
Calcium	ppm	ASTM D5185m	2	<b>1</b>	<1	0
Phosphorus	ppm	ASTM D5185m		<b>1</b>	0	1
Zinc	ppm	ASTM D5185m		<b>6</b>	9	5

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>10</b>	4	2
Sodium	ppm	ASTM D5185m		<b>11</b>	12	3
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304	>0.05	<b>0.012</b>	0.039	0.009
ppm Water	ppm	ASTM D6304	>500	<b>128</b>	392.6	90.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3851</b>	2083	5704
Particles >6µm		ASTM D7647	>1300	<b>1434</b>	679	2127
Particles >14µm		ASTM D7647	>80	<b>46</b>	12	143
Particles >21µm		ASTM D7647	>20	<b>16</b>	2	29
Particles >38µm		ASTM D7647	>4	<b>2</b>	0	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/18/13</b>	18/17/11	18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.34	0.308


# OIL ANALYSIS REPORT

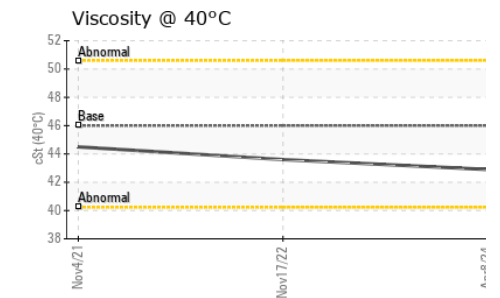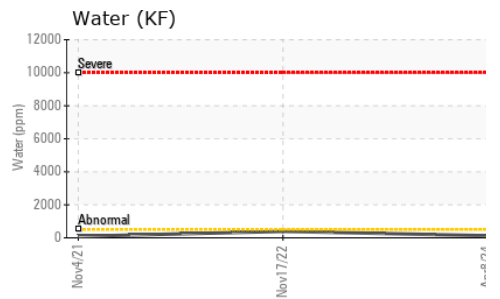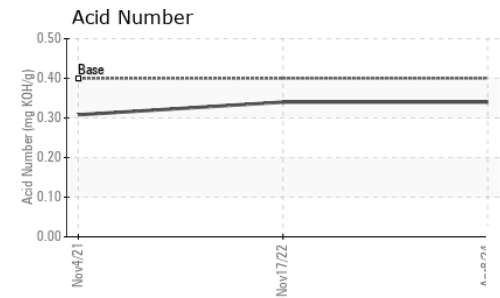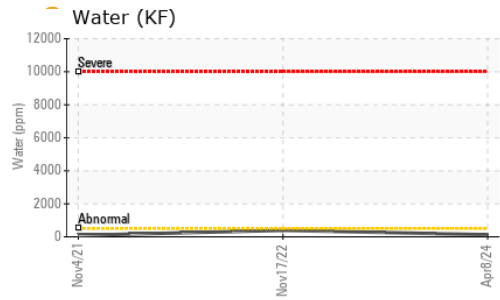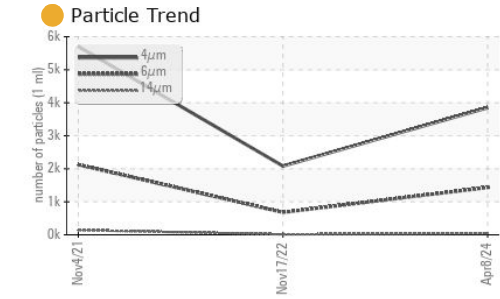




PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445 46	42.9	43.6	44.5

PARAMETER	method	limit/base	current	history1	history2
SAMPLE IMAGES					

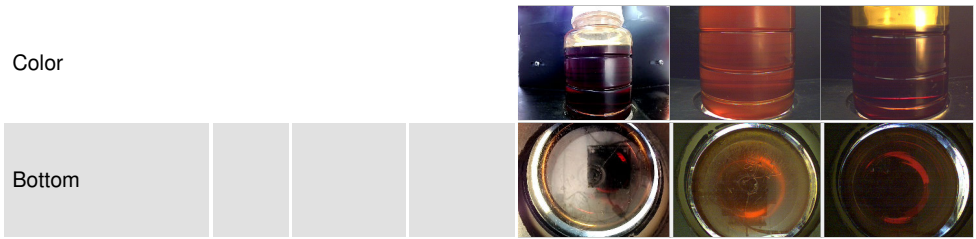

## GRAPHS

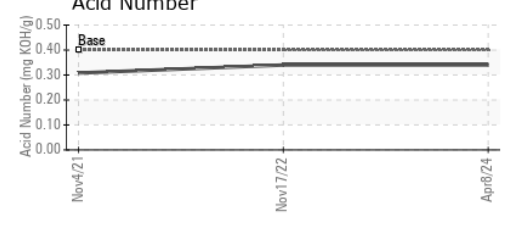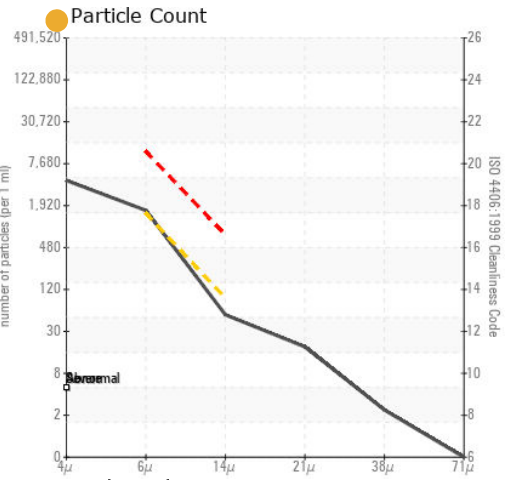

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC125804  
**Lab Number** : 06148722  
**Unique Number** : 10978800  
**Test Package** : IND 2  
**Received** : 15 Apr 2024  
**Tested** : 19 Apr 2024  
**Diagnosed** : 19 Apr 2024 - Jonathan Hester

**RIIZE HOME**  
 31050 DIAMOND PKWY  
 GLENWILLOW, OH  
 US 44139  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)