




OIL ANALYSIS REPORT

Sample Rating Trend

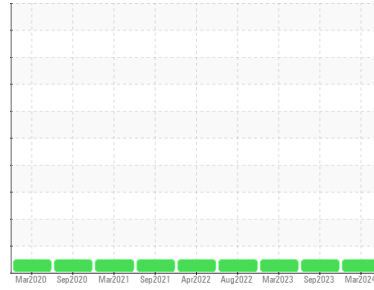

NORMAL



Area
Utility
 Machine Id
FDN98AB01
 Component
Gearbox
 Fluid
JAX FGH AW ISO 46 (5 GAL)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0883706	WC05944636	WC0697853
Sample Date	Client Info	27 Mar 2024	05 Sep 2023	15 Mar 2023
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >200	3	1	2
Chromium	ppm ASTM D5185m >15	0	0	0
Nickel	ppm ASTM D5185m >15	<1	0	0
Titanium	ppm ASTM D5185m	0	0	0
Silver	ppm ASTM D5185m	0	0	<1
Aluminum	ppm ASTM D5185m >25	0	0	<1
Lead	ppm ASTM D5185m >100	0	0	0
Copper	ppm ASTM D5185m >200	2	1	2
Tin	ppm ASTM D5185m >25	0	0	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	7	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	<1	0	<1
Magnesium	ppm ASTM D5185m	2	4	0
Calcium	ppm ASTM D5185m	2	0	2
Phosphorus	ppm ASTM D5185m	90	79	86
Zinc	ppm ASTM D5185m	10	17	11
Sulfur	ppm ASTM D5185m	696	706	617

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	4	3	3
Sodium	ppm ASTM D5185m	2	0	0
Potassium	ppm ASTM D5185m >20	<1	0	0
Water	% ASTM D6304 >0.2	0.007	0.003	0.003
ppm Water	ppm ASTM D6304 >2000	75	28.5	28.8

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	579	271	8806
Particles >6µm	ASTM D7647 >5000	151	87	2973
Particles >14µm	ASTM D7647 >640	26	13	244
Particles >21µm	ASTM D7647 >160	9	4	49
Particles >38µm	ASTM D7647 >40	1	0	4
Particles >71µm	ASTM D7647 >10	1	0	0
Oil Cleanliness	ISO 4406 (c) >21/19/16	16/14/12	15/14/11	20/19/15

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.27	0.25	0.24




OIL ANALYSIS REPORT

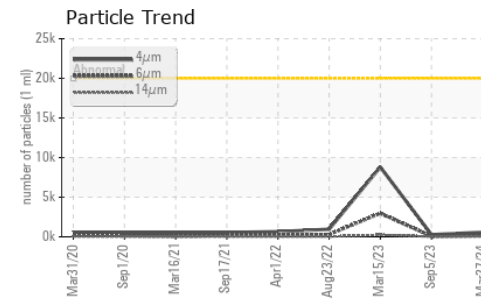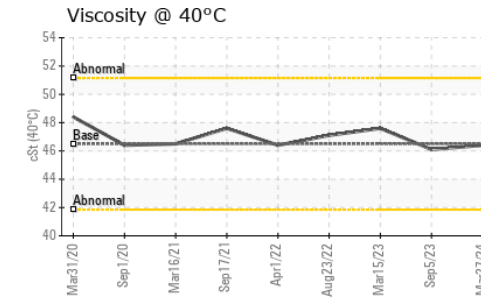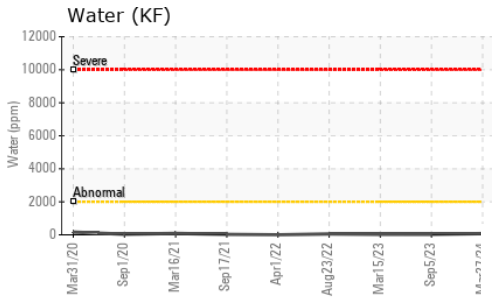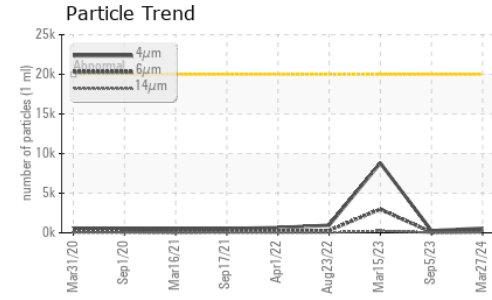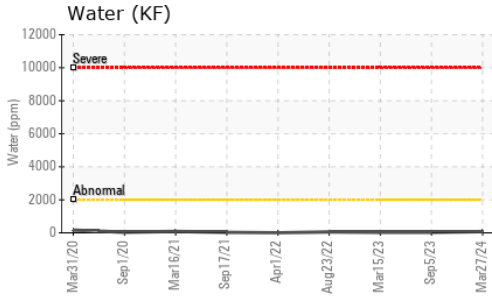






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.5	46.4	46.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

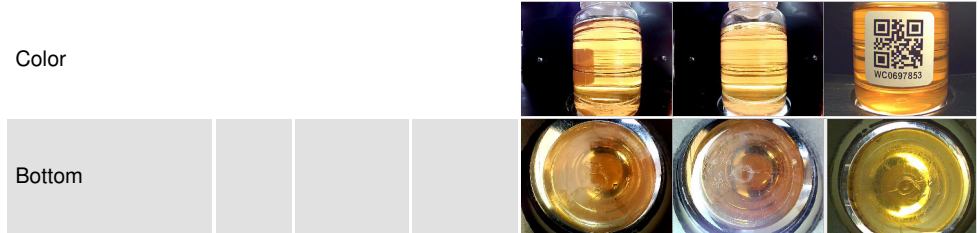

GRAPHS

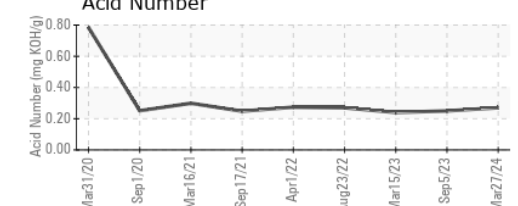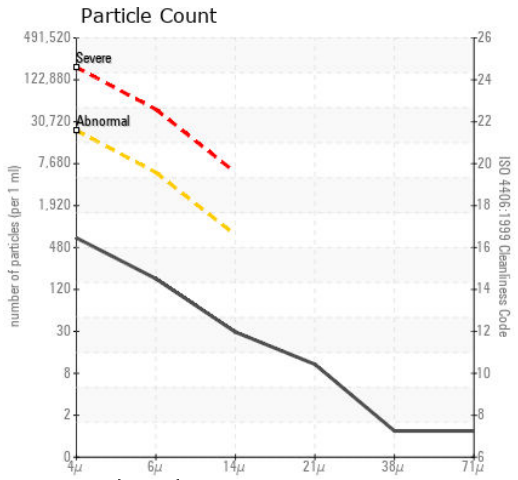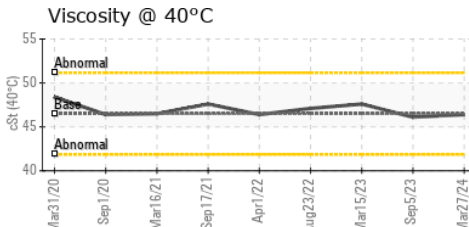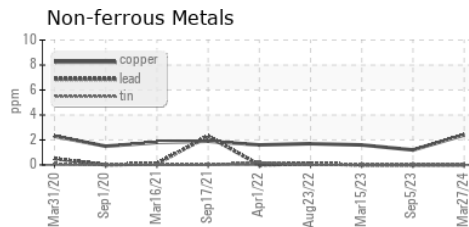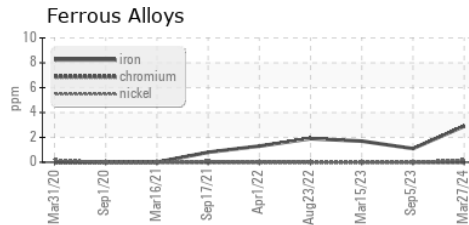

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0883706

Lab Number : 06148725

Unique Number : 10978803

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 15 Apr 2024

Tested : 16 Apr 2024

Diagnosed : 17 Apr 2024 - Don Baldrige

NOVOZYMES

P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD

FRANKLINTON, NC

US 27525

Contact: BRUCE THOMAS

brct@novozymes.com

T: (919)494-3146

F: (919)494-3456