



# OIL ANALYSIS REPORT

Sample Rating Trend



**WATER**



Area

**Granulation**

Machine Id

**FFN22KB01 Gearbox**

Component

**Agitator Gearbox**

Fluid

**JAX FGG-AW ISO 220 (2 LTR)**

## DIAGNOSIS

### Recommendation

We advise that you check for the source of water entry. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0883705</b>	---	---
Sample Date	Client Info		<b>10 Apr 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >150	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >10	<b>1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>1</b>	---	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>2</b>	---	---
Calcium	ppm	ASTM D5185m	<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>524</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>699</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	---	---
Water	%	ASTM D6304 >0.1	<b>▲ 0.365</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>▲ 3653</b>	---	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>1449</b>	---	---
Particles >6µm	ASTM D7647	>5000	<b>298</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>43</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>18</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>2</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>18/15/13</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.83</b>	---	---




# OIL ANALYSIS REPORT

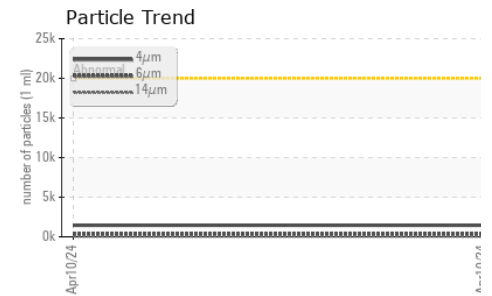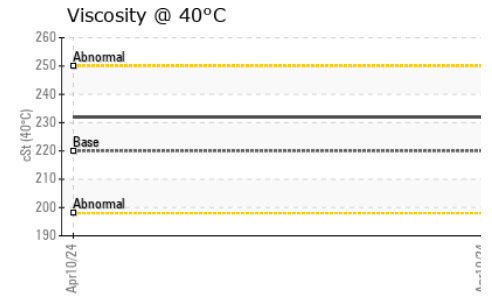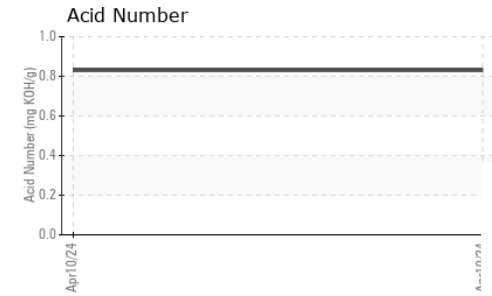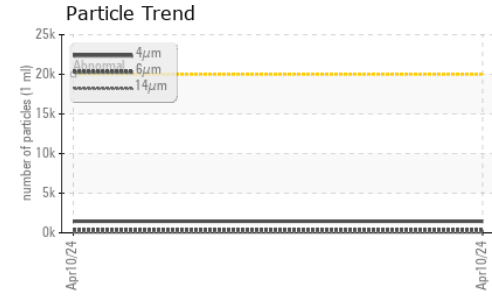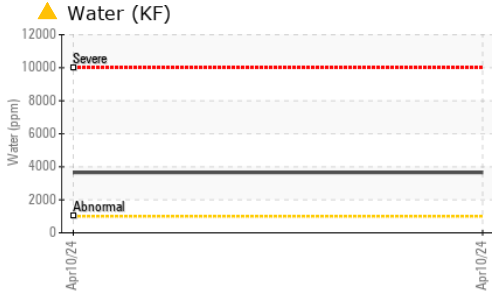





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	232	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

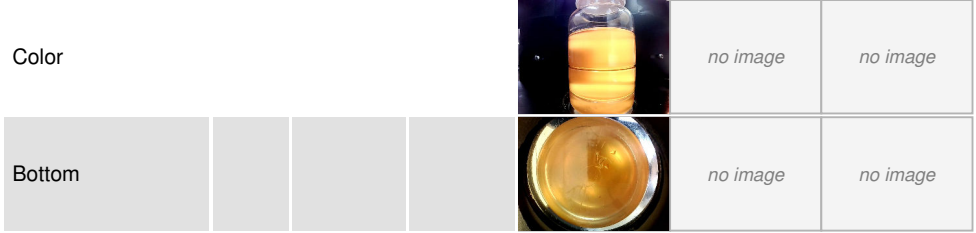

## GRAPHS

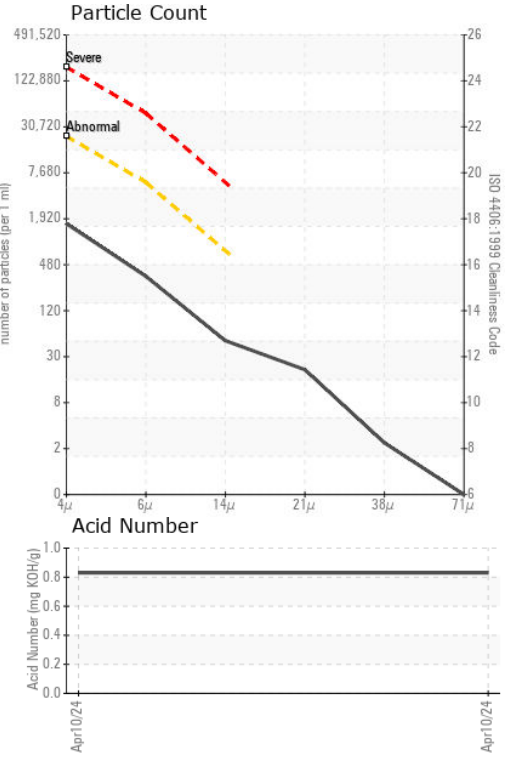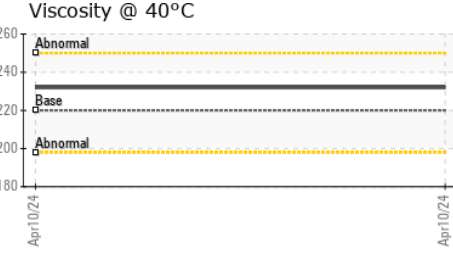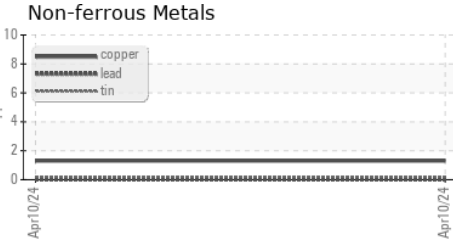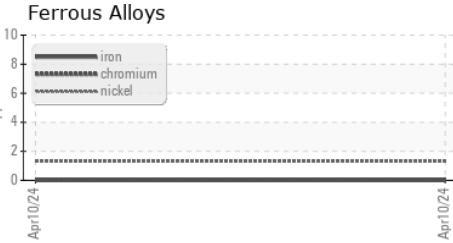

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0883705 **Received** : 15 Apr 2024  
**Lab Number** : 06148726 **Tested** : 18 Apr 2024  
**Unique Number** : 10978804 **Diagnosed** : 18 Apr 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NOVOZYMES**  
P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD  
FRANKLINTON, NC  
US 27525  
Contact: BRUCE THOMAS  
brct@novozymes.com  
T: (919)494-3146  
F: (919)494-3456

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)