




# OIL ANALYSIS REPORT

Sample Rating Trend

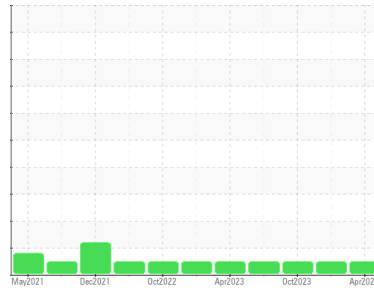

**NORMAL**



Machine Id

## COMPRESSOR 3 (S/N 8152876010)

Component

Air Compressor

Fluid

USPI MAX FG AIR 46 (--- GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM36684</b>	USPM30713	USPM29975
Sample Date	Client Info		<b>04 Apr 2024</b>	03 Jan 2024	09 Oct 2023
Machine Age	hrs	Client Info	<b>26396</b>	24444	23888
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >70	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >6	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >80	<b>1</b>	<1	0
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	<1	1
Calcium	ppm	ASTM D5185m 0	<b>1</b>	1	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	2

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >12	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>1</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.1	<b>0.008</b>	0.007	0.012
ppm Water	ppm	ASTM D6304 >1000	<b>86</b>	76	121.7

### FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>1994</b>	246	1671
Particles >6µm	ASTM D7647	>2500	<b>822</b>	63	639
Particles >14µm	ASTM D7647	>640	<b>63</b>	6	53
Particles >21µm	ASTM D7647	>160	<b>16</b>	2	8
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/16	<b>18/17/13</b>	15/13/10	18/16/13

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.16	<b>0.33</b>	0.37	0.35




# OIL ANALYSIS REPORT

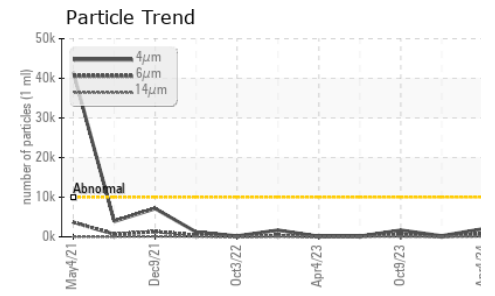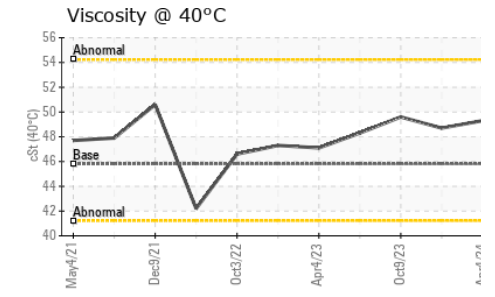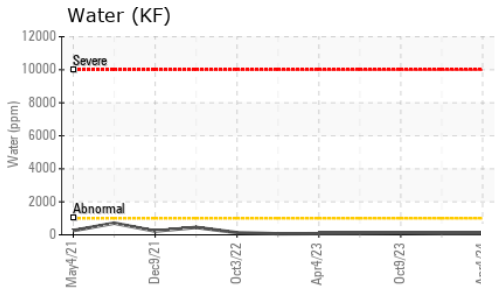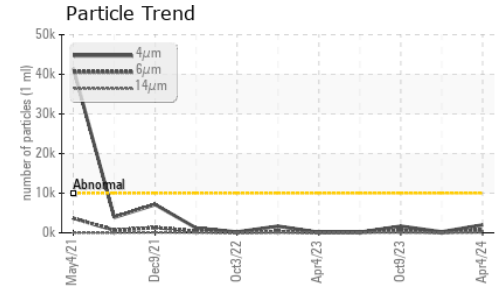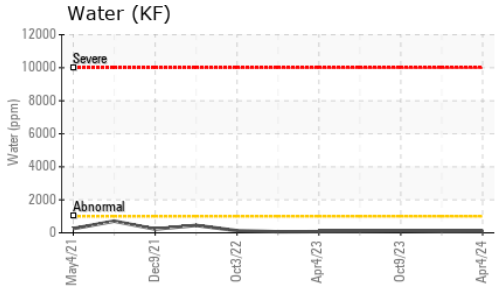





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	49.3	48.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

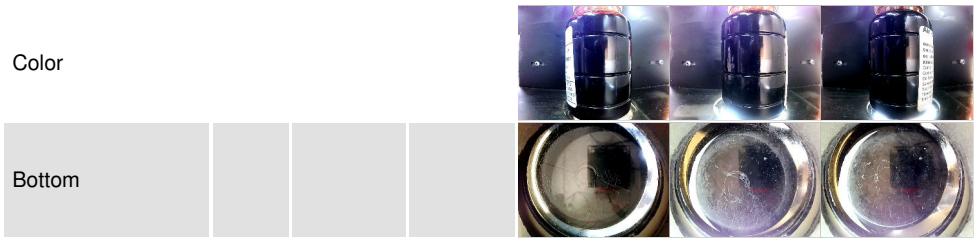

## GRAPHS

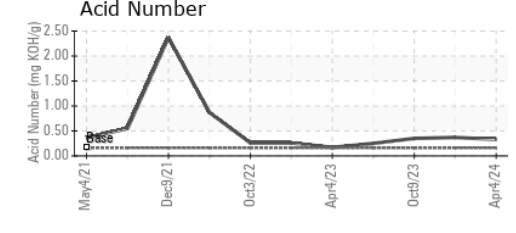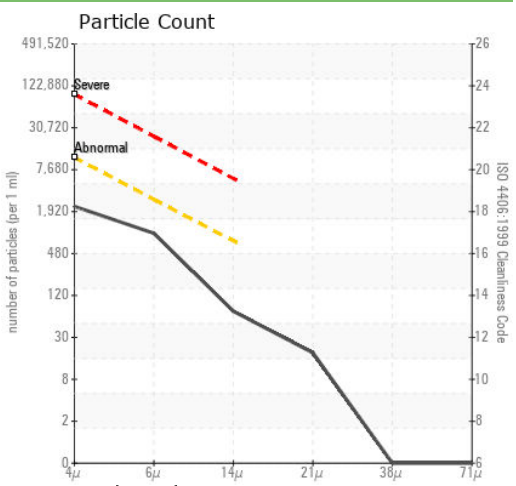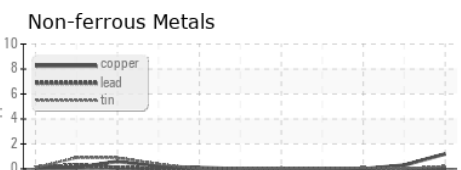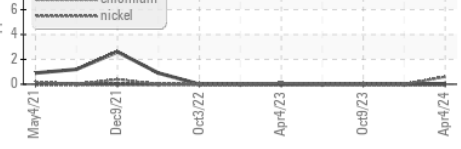

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36684  
**Lab Number** : 06148734  
**Unique Number** : 10978812  
**Test Package** : IND 2  
**Received** : 15 Apr 2024  
**Tested** : 16 Apr 2024  
**Diagnosed** : 16 Apr 2024 - Doug Bogart

**KraftHeinz - Holland - Plant 8385**  
 431 W 16TH ST  
 HOLLAND, MI  
 US 49423  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)