




# OIL ANALYSIS REPORT

Sample Rating Trend

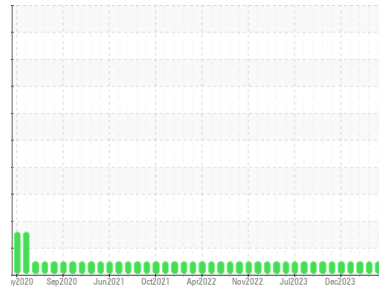

**NORMAL**



Machine Id  
**RECYCLED NH3 OIL (S/N 100502975)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI ALT-68 SC (--- QTS)**

## DIAGNOSIS

### Recommendation

This is a baseline read-out on the submitted sample.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0006772</b>	USP0006062	USP0007515
Sample Date	Client Info			<b>09 Apr 2024</b>	11 Mar 2024	26 Feb 2024
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m		<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>8	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>4	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	0
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	50	<b>10</b>	20	0






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>1</b>	2	2
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Water	%	ASTM D6304	>0.01	<b>0.004</b>	0.007	0.002
ppm Water	ppm	ASTM D6304	>100	<b>41</b>	74	18

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>466</b>	401	447
Particles >6µm		ASTM D7647	>2500	<b>116</b>	68	133
Particles >14µm		ASTM D7647	>320	<b>22</b>	9	14
Particles >21µm		ASTM D7647	>80	<b>9</b>	1	4
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/18/15	<b>16/14/12</b>	16/13/10	16/14/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	<b>0.028</b>	0.015	0.014




# OIL ANALYSIS REPORT

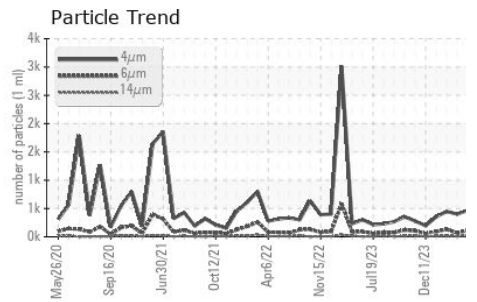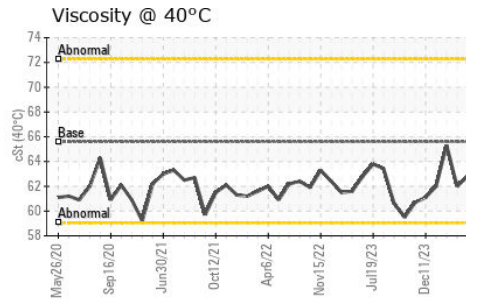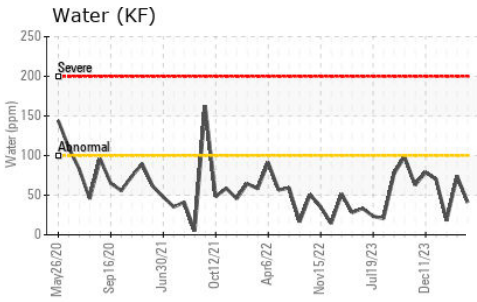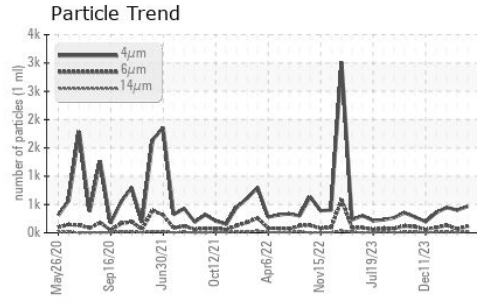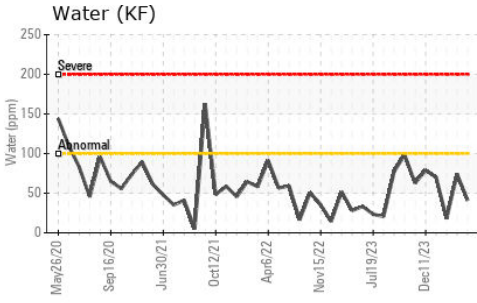






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	65.6	<b>62.8</b>	62.0	65.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

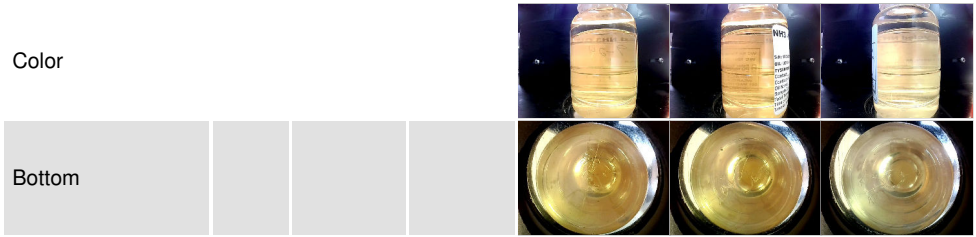

## GRAPHS

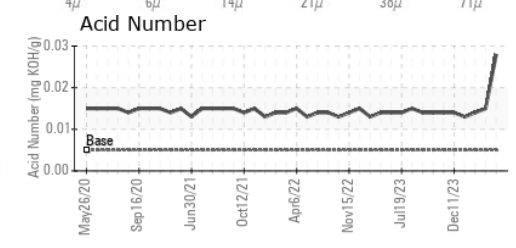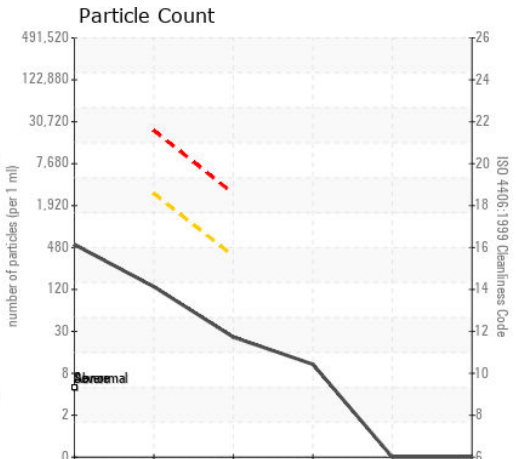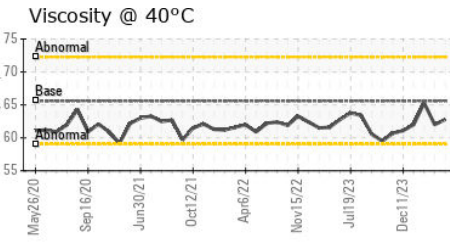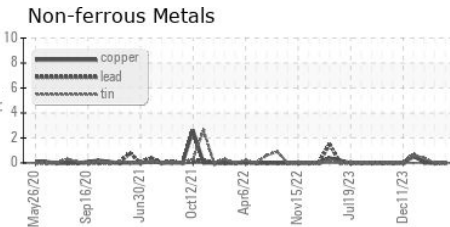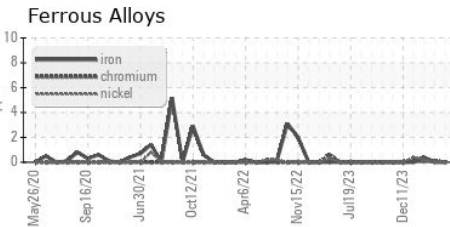

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0006772 **Received** : 15 Apr 2024  
**Lab Number** : **06148742** **Tested** : 16 Apr 2024  
**Unique Number** : 10978820 **Diagnosed** : 16 Apr 2024 - Doug Bogart  
**Test Package** : IND 2

**TYSON BS -SPRINGDALE-USP**  
 600 BERRY ST  
 SPRINGDALE, AR  
 US 72764  
 Contact: VERNON MARS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)