




# OIL ANALYSIS REPORT

Area  
**SYNOIL 8K**  
 Machine Id  
**QUINCY QSI 1500 93386J - KS KOLBENSCHMIDT**  
 Component  
**Compressor**

Sample Rating Trend

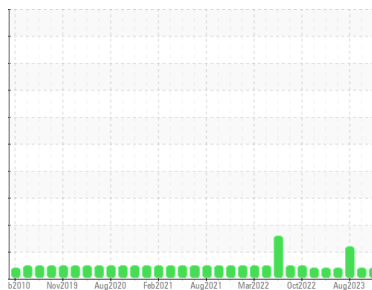

## VISCOSITY



### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ06148765</b>	UCZ06055965	UCZ05937940
Sample Date	Client Info			<b>08 Apr 2024</b>	03 Jan 2024	24 Aug 2023
Machine Age	hrs	Client Info		<b>179119</b>	176837	174088
Oil Age	hrs	Client Info		<b>6199</b>	4000	1168
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	ATTENTION	ATTENTION

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	1
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>65	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>65	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	<b>2</b>	0	0
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0.9	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	0.2	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	429	<b>355</b>	454	490
Zinc	ppm	ASTM D5185m	0.3	<b>6</b>	19	1
Sulfur	ppm	ASTM D5185m	1336	<b>468</b>	547	811

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	<b>1.10</b>	1.25	● 1.85




# OIL ANALYSIS REPORT

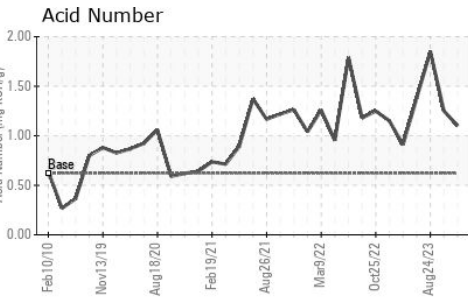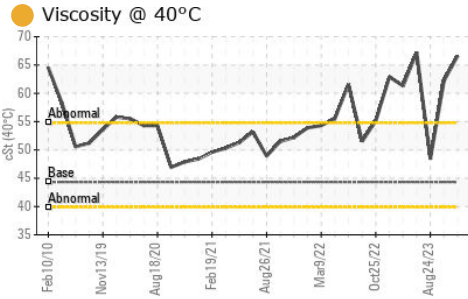





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.32	<span style="color: orange;">●</span> 66.6	<span style="color: orange;">●</span> 62.2	48.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

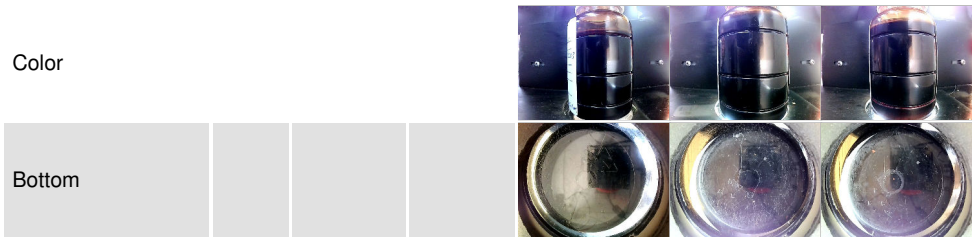

## GRAPHS

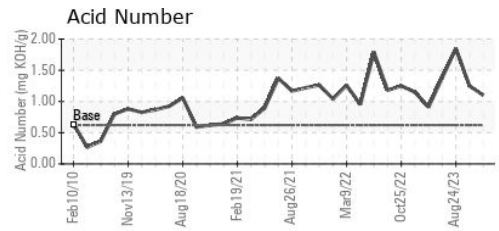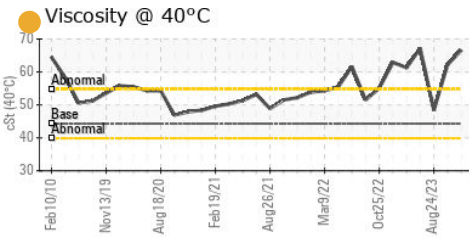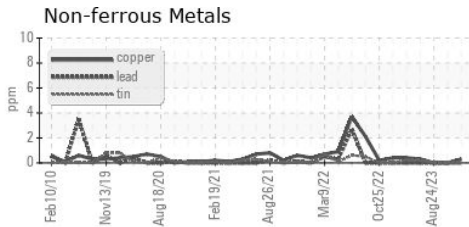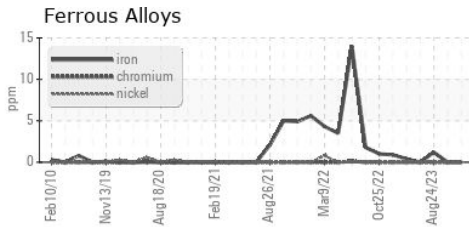

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06148765      **Received** : 15 Apr 2024  
**Lab Number** : 06148765      **Tested** : 16 Apr 2024  
**Unique Number** : 10978843      **Diagnosed** : 17 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**ZORN COMP & EQUIPMENT CO (GB)**  
 733 POTTS AVE  
 GREEN BAY, WI  
 US 54304  
 Contact: DEAN SCHAD  
 dean.schad@zornair.com  
 T: (920)391-8121  
 F: (920)499-1168

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)