


OIL ANALYSIS REPORT

Area
SULLUBE

SULLAIR 200809270052 - EPSILYTE J-ACP-A/PACK WAREHOUSE





Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06148842	UCH05966462	
Sample Date		Client Info		06 Mar 2024	12 Sep 2023	
Machine Age	hrs	Client Info		677803	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	ATTENTION	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	4	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	<1	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	<1	<1	
Lead	ppm	ASTM D5185m	>25	0	1	
Copper	ppm	ASTM D5185m	>50	1	3	
Tin	ppm	ASTM D5185m	>15	0	1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	<1	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	
Barium	ppm	ASTM D5185m	745	420	392	
Molybdenum	ppm	ASTM D5185m	0.0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	0.0	<1	<1	
Calcium	ppm	ASTM D5185m	1	4	2	
Phosphorus	ppm	ASTM D5185m	3	5	7	
Zinc	ppm	ASTM D5185m	0.1	10	0	
Sulfur	ppm	ASTM D5185m	240	252	227	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	1	
Sodium	ppm	ASTM D5185m		70	20	
Potassium	ppm	ASTM D5185m	>20	2	4	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.06	0.17	0.12	




OIL ANALYSIS REPORT

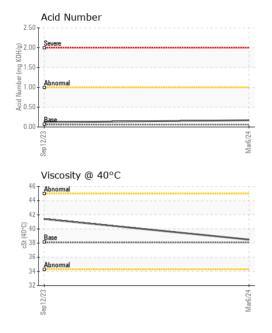











Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06148842 Unique Number : 10978920

Sep12/23

: UCH06148842 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Received **Tested**

: 15 Apr 2024 : 16 Apr 2024

Diagnosed : 17 Apr 2024 - Sean Felton

HTE TECHNOLOGIES 2021 CONGRESSIONAL DR ST LOUIS, MO US 63146

Contact: JOSH DYRLAND josh.dyrland@htetech.com T: (314)731-4444

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (314)731-4424