OIL ANALYSIS REPORT

Sample Rating Trend

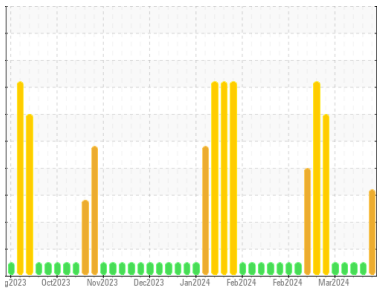

DEGRADATION

Machine Id
WVTM01BE
Component
Biogas Engine
Fluid
MOBIL Pegasus™ 605 Ultra 40 (--- GAL)

DIAGNOSIS

▲ Recommendation
We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

▲ Fluid Condition
The BN level is low. The AN level is acceptable for this fluid. The oil is no longer serviceable.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0895536**	WC0895562	WC0895555
Sample Date		Client Info		**11 Apr 2024**	02 Apr 2024	29 Mar 2024
Machine Age	hrs	Client Info		**115404**	115189	115094
Oil Age	hrs	Client Info		**572**	357	262
Oil Changed		Client Info		**Not Changd**	Not Changd	Not Changd
Sample Status				**SEVERE**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method		**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>14	**5**	4	3
Chromium	ppm	ASTM D5185m	>3	**0**	0	0
Nickel	ppm	ASTM D5185m		**<1**	0	0
Titanium	ppm	ASTM D5185m		**0**	<1	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>5	**2**	2	2
Lead	ppm	ASTM D5185m	>8	**<1**	0	0
Copper	ppm	ASTM D5185m	>5	**1**	1	<1
Tin	ppm	ASTM D5185m	>3	**2**	2	2
Vanadium	ppm	ASTM D5185m		**<1**	<1	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**62**	44	66
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**2**	2	0
Manganese	ppm	ASTM D5185m		**0**	0	<1
Magnesium	ppm	ASTM D5185m		**14**	16	11
Calcium	ppm	ASTM D5185m		**1659**	1647	1635
Phosphorus	ppm	ASTM D5185m		**369**	333	386
Zinc	ppm	ASTM D5185m		**503**	546	550
Sulfur	ppm	ASTM D5185m		**4699**	5256	5269

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>180	**158**	127	101
Sodium	ppm	ASTM D5185m	>20	**2**	1	1
Potassium	ppm	ASTM D5185m	>20	**0**	0	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0**	0	0
Nitration	Abs/cm	*ASTM D7624		**3.8**	3.7	3.4
Sulfation	Abs/.1mm	*ASTM D7415		**24.6**	23.6	21.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**12.6**	12.2	10.8
Acid Number (AN)	mg KOH/g	ASTM D8045		**2.19**	1.99	1.94
Base Number (BN)	mg KOH/g	ASTM D2896	5.7	▲ **2.29**	2.46	2.83

OIL ANALYSIS REPORT

FT-IR (Direct Trend)

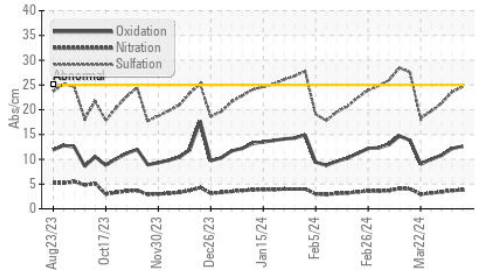

Acid Number

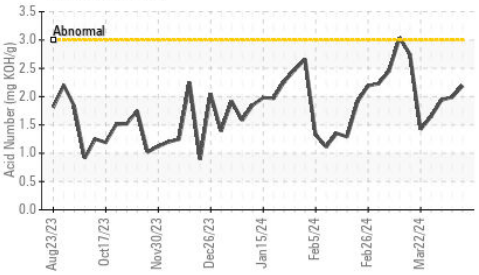

Acid Number

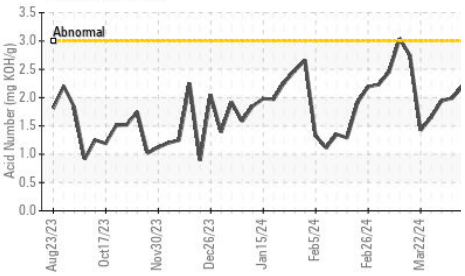

Viscosity @ 100°C

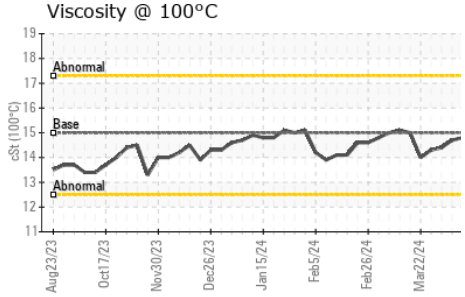

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual		**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15	**14.8**	14.7	14.4

GRAPHS

Iron (ppm)

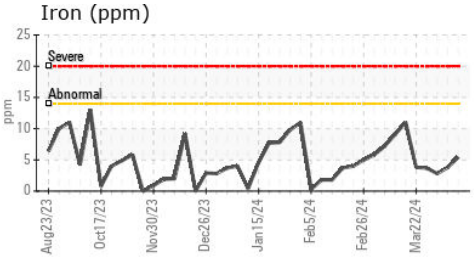

Lead (ppm)

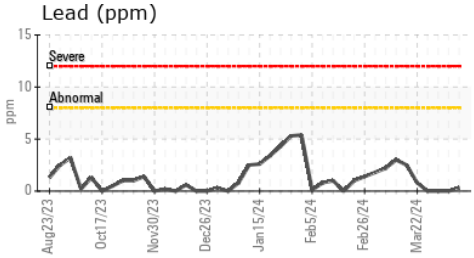

Aluminum (ppm)

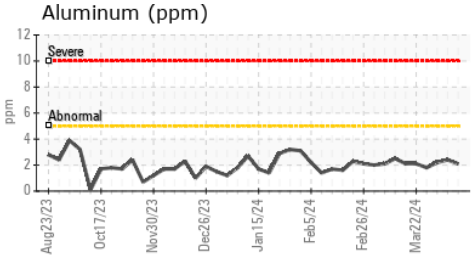

Chromium (ppm)

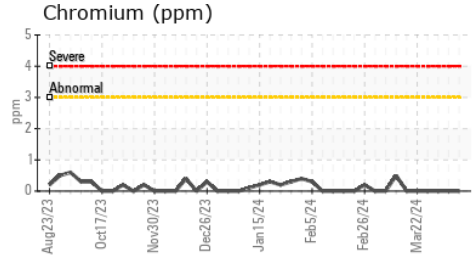

Copper (ppm)

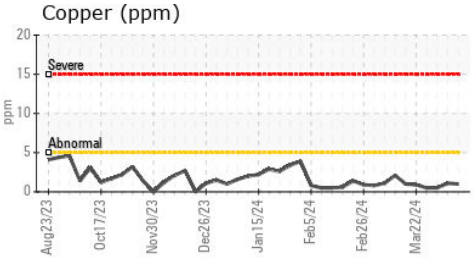

Silicon (ppm)

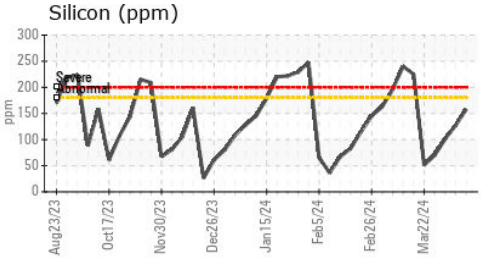

Viscosity @ 100°C

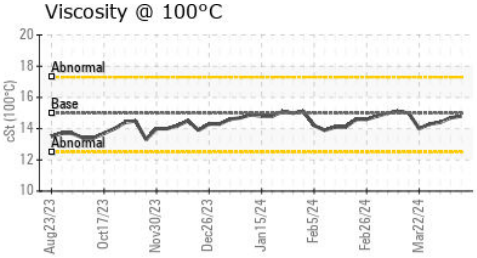

Base Number

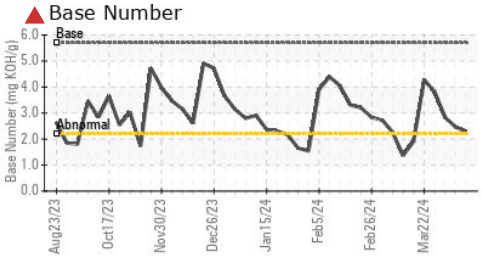

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0895536
Lab Number : 06148892
Unique Number : 10978970
Test Package : MOB 2

Received : 15 Apr 2024
Tested : 19 Apr 2024
Diagnosed : 19 Apr 2024 - Jonathan Hester

EDL NA Recips-Watervliet
Watervliet Powerstation, 3563 Hennessey Road
Watervliet, MI
US 49098
Contact: Scott Eastman
scott.eastman@edlenergy.com
T:
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)