




OIL ANALYSIS REPORT



Machine Id
Byron Center CAT 3 BYCM03BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

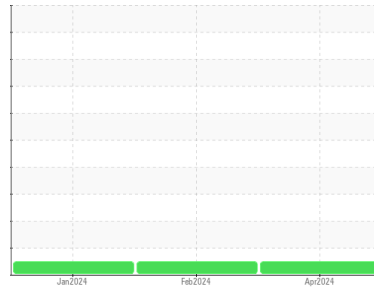

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0877016	WC0877006	WC0877086
Sample Date	Client Info		12 Apr 2024	11 Feb 2024	30 Jan 2024
Machine Age	hrs	Client Info	67039	66804	66593
Oil Age	hrs	Client Info	235	469	264
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	2	<1	0
Chromium	ppm	ASTM D5185m >3	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	1	<1	2
Lead	ppm	ASTM D5185m >8	0	0	0
Copper	ppm	ASTM D5185m >5	1	<1	<1
Tin	ppm	ASTM D5185m >3	<1	1	2
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0	<1
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	2	<1	<1
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	23	6	8
Calcium	ppm	ASTM D5185m	1590	1816	1595
Phosphorus	ppm	ASTM D5185m	241	261	240
Zinc	ppm	ASTM D5185m	263	320	295
Sulfur	ppm	ASTM D5185m	2237	2341	1805

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	85	122	67
Sodium	ppm	ASTM D5185m >20	2	<1	0
Potassium	ppm	ASTM D5185m >20	<1	<1	<1

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624	4.9	5.0	4.8
Sulfation	Abs/.1mm	*ASTM D7415	17.2	17.6	16.2


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	8.3	8.4	7.9
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.808	0.84	1.44
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	3.87	3.65	4.46




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

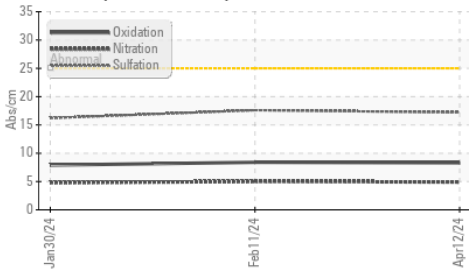


Acid Number

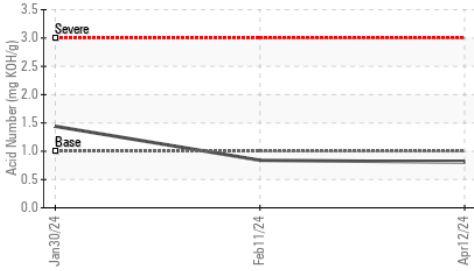

Base Number

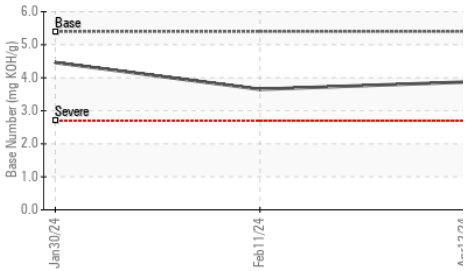


Viscosity @ 100°C

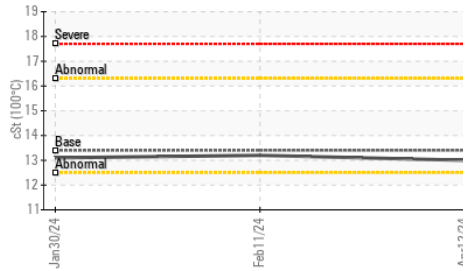

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.0	13.2

GRAPHS

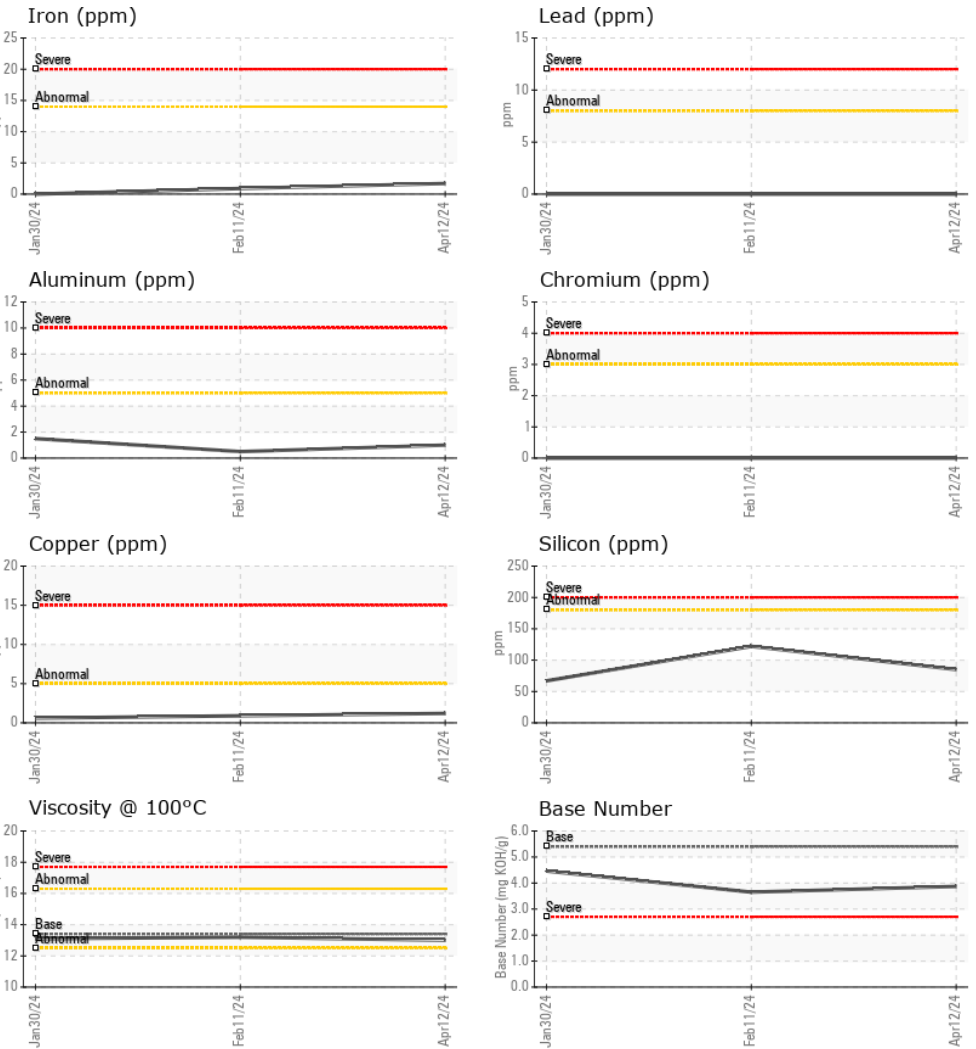

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0877016

Lab Number : 06148895

Unique Number : 10978973

Test Package : MOB 2

Received : 15 Apr 2024

Tested : 16 Apr 2024

Diagnosed : 18 Apr 2024 - Jonathan Hester

EDL NA Recips-Byron Center

Byron Center Powerstation, 10310 South Kent Road

Byron Center, MI

US 49315

Contact: Jake Ripke

Jake.Ripke@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)