




OIL ANALYSIS REPORT



Machine Id
SJNM01BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

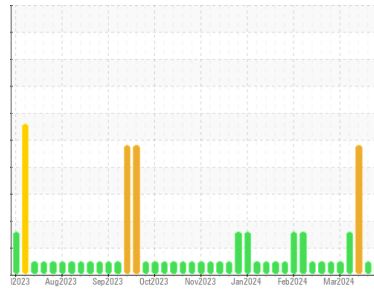

NORMAL

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0865740	WC0865719	WC0865721
Sample Date	Client Info		11 Apr 2024	04 Apr 2024	28 Mar 2024
Machine Age	hrs	Client Info	71672	71518	71352
Oil Age	hrs	Client Info	320	166	990
Oil Changed	Client Info		Not Chngd	Not Chngd	Changed
Sample Status			NORMAL	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	2	0	2
Chromium	ppm	ASTM D5185m >3	0	0	<1
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	2	1	2
Lead	ppm	ASTM D5185m >8	<1	<1	4
Copper	ppm	ASTM D5185m >5	<1	0	<1
Tin	ppm	ASTM D5185m >3	<1	1	4
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	3	3
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	5	4	5
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	22	31	31
Calcium	ppm	ASTM D5185m	1902	1897	2188
Phosphorus	ppm	ASTM D5185m	258	282	338
Zinc	ppm	ASTM D5185m	299	350	415
Sulfur	ppm	ASTM D5185m	2025	1717	2892

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	119	77	▲ 187
Sodium	ppm	ASTM D5185m >20	2	1	2
Potassium	ppm	ASTM D5185m >20	0	0	2

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0	0.1
Nitration	Abs/cm	*ASTM D7624	7.2	6.4	8.5
Sulfation	Abs/.1mm	*ASTM D7415	20.3	18.9	24.2


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	15.5	12.2	22.0
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	1.32	0.84	▲ 3.23
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	4.01	4.43	3.67




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

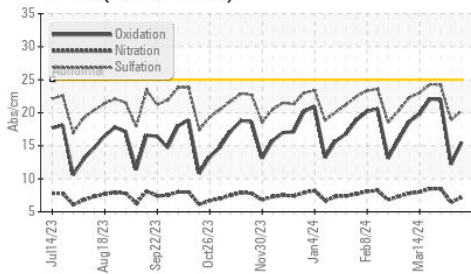


Acid Number

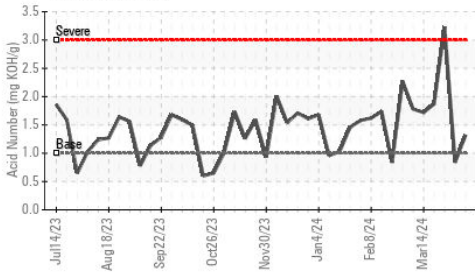

Base Number

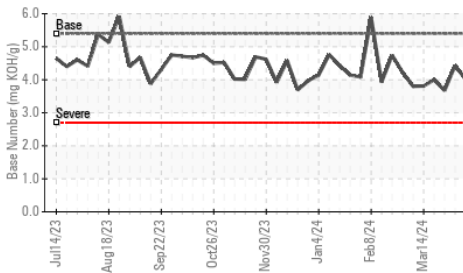









Viscosity @ 100°C

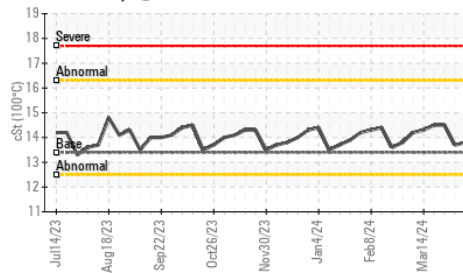

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.8	13.7

GRAPHS

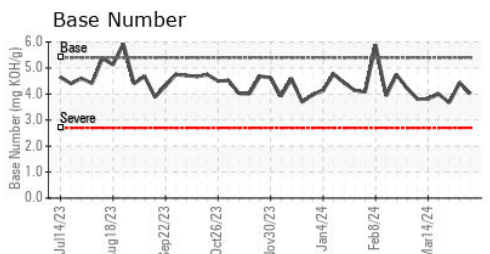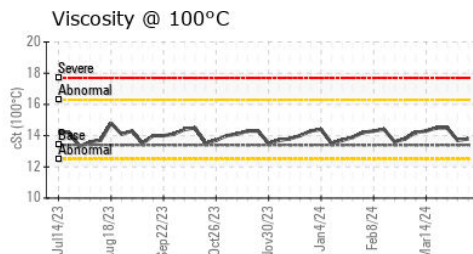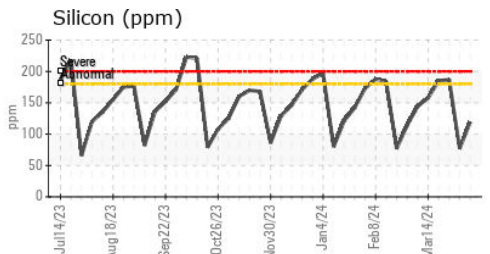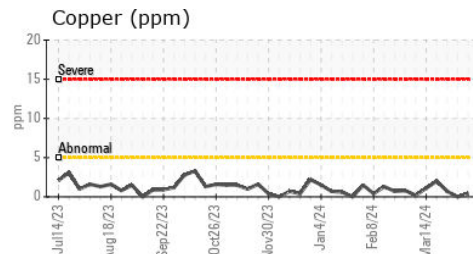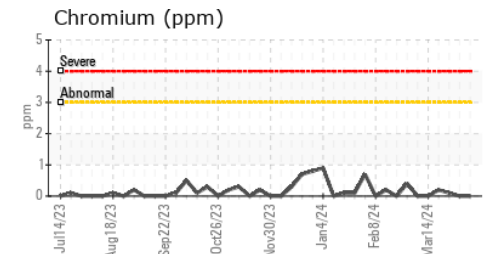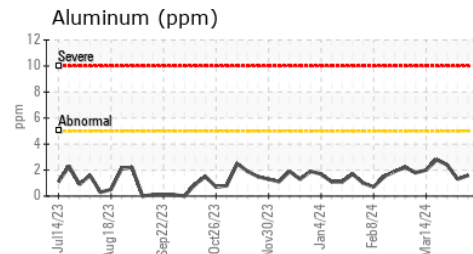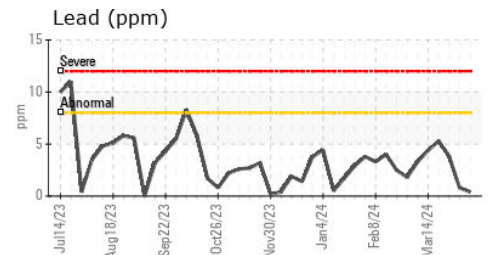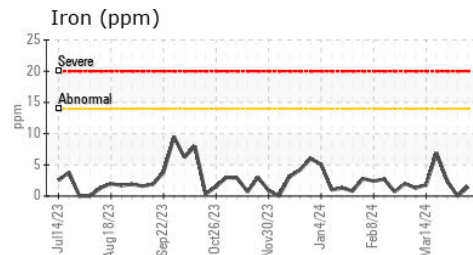

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0865740
 Lab Number : 06148898
 Unique Number : 10978976
 Test Package : MOB 2

Received : 15 Apr 2024
 Tested : 16 Apr 2024
 Diagnosed : 17 Apr 2024 - Sean Felton

EDL NA Recips-South Jordan
 South Jordan Powerstation, 10473 S. Bacchus Hwy.
 South Jordan, UT
 US 84095

Contact: Aaron Klein
 aaron.klein@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: