




# FUEL REPORT

## Sample Rating Trend

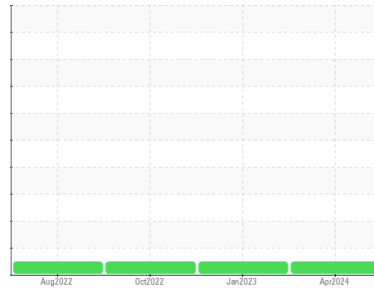

**NORMAL**



Machine Id

**CR1227**

Component

**Diesel Fuel**

Fluid

**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time.

#### Corrosion

All metal levels are normal indicating no corrosion in the system.

#### Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

#### Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0892945</b>	WC0610429	WC0746612
Sample Date	Client Info			<b>08 Apr 2024</b>	22 Jan 2023	07 Oct 2022
Machine Age	hrs	Client Info		<b>1994</b>	1477	678
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	3.0	<b>2.57</b>	2.67	2.57


SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<b>0</b>	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Water	%	ASTM D6304	<0.05	<b>0.003</b>	0.005	0.004
ppm Water	ppm	ASTM D6304	<500	<b>29</b>	54.3	49.1


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	<1
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<0.1	<b>4</b>	0	0
Magnesium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	<b>3</b>	0	6
Zinc	ppm	ASTM D5185m	<0.1	<b>3</b>	0	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color







Bottom





# FUEL REPORT

## GRAPHS

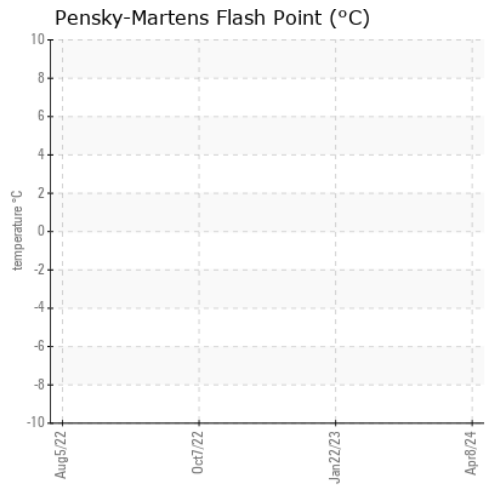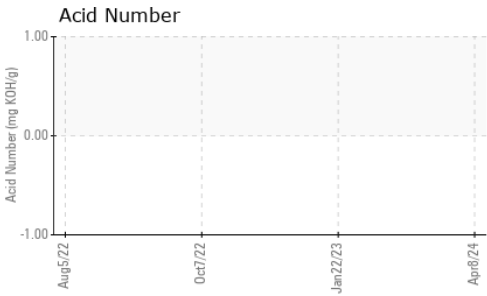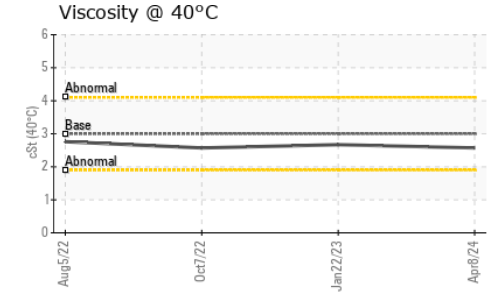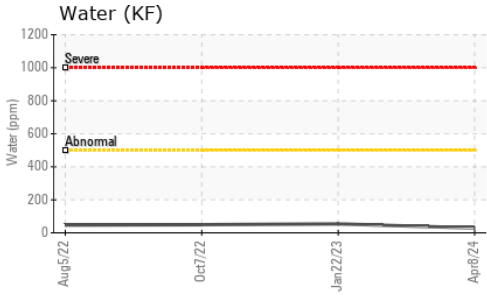

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0892945      **Received** : 15 Apr 2024  
**Lab Number** : 06149223      **Tested** : 18 Apr 2024  
**Unique Number** : 10979301      **Diagnosed** : 18 Apr 2024 - Jonathan Hester  
**Test Package** : CONST ( Additional Tests: KF )

**BUCKNER HEAVY LIFT**  
 4732 NC 54 EAST  
 GRAHAM, NC  
 US 27253-9215

Contact: MICHAEL LAWSON  
 michael@bucknercompanies.com

T: (336)376-8888

F: (336)376-4090