




# OIL ANALYSIS REPORT

Sample Rating Trend

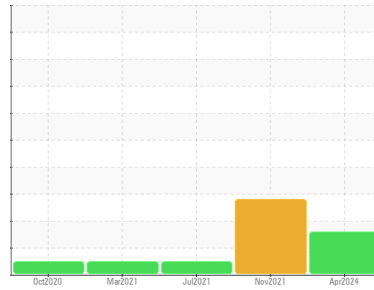

ISO



Machine Id  
**7236600 (S/N 1217)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC129719</b>	KC73489	KC86584
Sample Date	Client Info			<b>09 Apr 2024</b>	04 Nov 2021	30 Jul 2021
Machine Age	hrs	Client Info		<b>11455</b>	4531	3802
Oil Age	hrs	Client Info		<b>0</b>	730	1983
Oil Changed	Client Info			<b>Changed</b>	Not Changd	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>7</b>	4	15
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	2	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>17</b>	45	15
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>1</b>	6	12
Zinc	ppm	ASTM D5185m		<b>14</b>	6	47

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>10</b>	11	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	3	<1
Water	%	ASTM D6304	>0.05	<b>0.011</b>	▲ 0.292	0.016
ppm Water	ppm	ASTM D6304	>500	<b>111</b>	▲ 2920	167.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>8934</b>	---	2685
Particles >6µm		ASTM D7647	>1300	▲ <b>3130</b>	---	974
Particles >14µm		ASTM D7647	>80	▲ <b>243</b>	---	61
Particles >21µm		ASTM D7647	>20	▲ <b>53</b>	---	14
Particles >38µm		ASTM D7647	>4	<b>3</b>	---	1
Particles >71µm		ASTM D7647	>3	<b>1</b>	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>20/19/15</b>	---	17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.40</b>	0.195	0.384

# OIL ANALYSIS REPORT

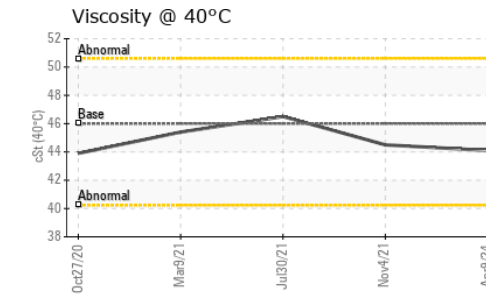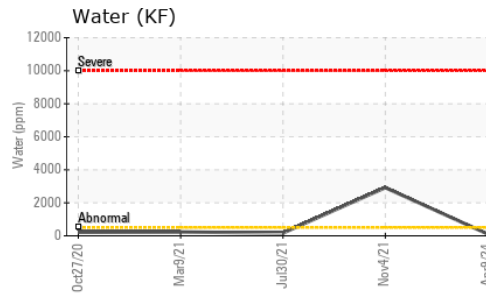
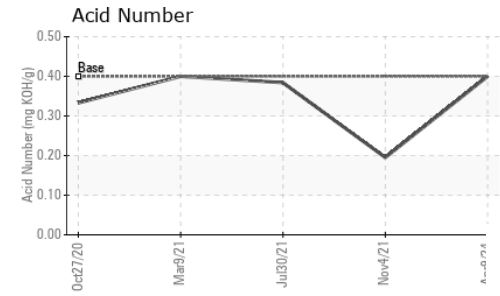
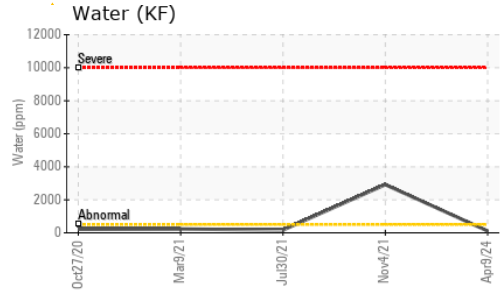
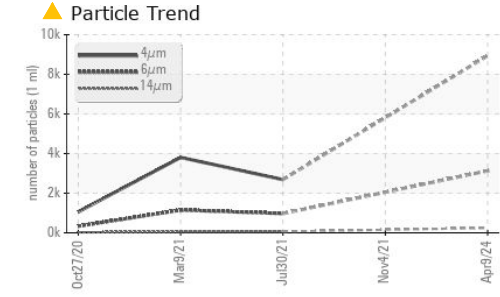


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	● HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

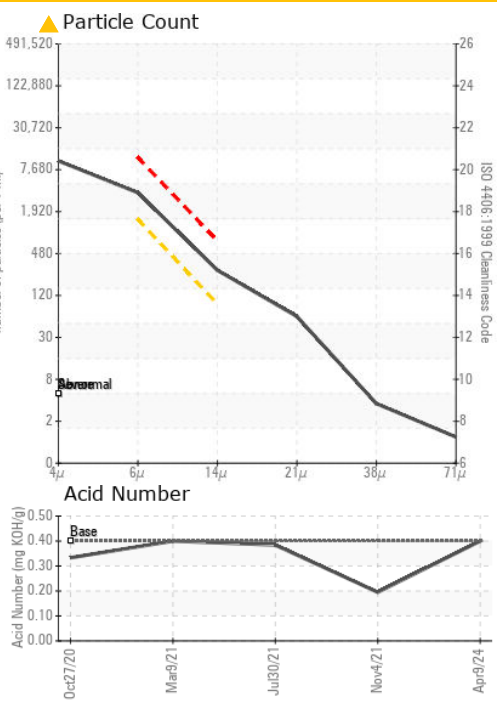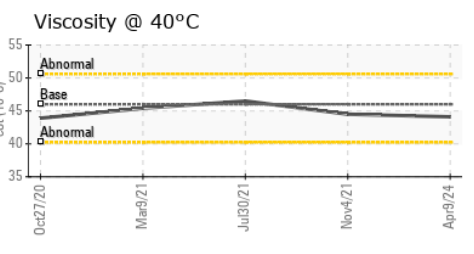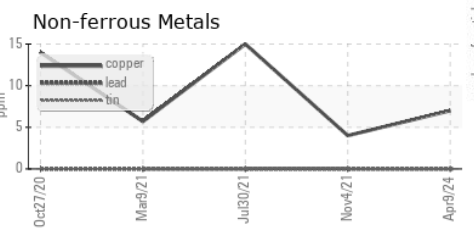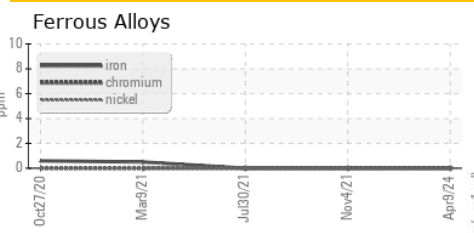

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129719  
**Lab Number** : 06149514  
**Unique Number** : 10979592  
**Test Package** : IND 2  
**Received** : 15 Apr 2024  
**Tested** : 16 Apr 2024  
**Diagnosed** : 17 Apr 2024 - Don Baldrige

**SUEZ**  
 55 OLD MILL RD  
 WEST NYACK, NY  
 US 10994  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)