




# OIL ANALYSIS REPORT

Sample Rating Trend

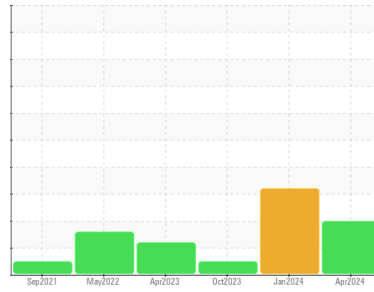

ISO



Machine Id

**KAESER 7260097**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA015344</b>	KCPA008812	KCPA007232
Sample Date	Client Info		<b>10 Apr 2024</b>	10 Jan 2024	12 Oct 2023
Machine Age	hrs	Client Info	<b>9435</b>	8863	8327
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Changed</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>1</b>	2	1
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>7</b>	26	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 100	<b>29</b>	70	44
Calcium	ppm	ASTM D5185m 0	<b>0</b>	1	2
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	11	2
Zinc	ppm	ASTM D5185m 0	<b>6</b>	2	27
Sulfur	ppm	ASTM D5185m 23500	<b>17509</b>	19706	18829

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>10</b>	10	13
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	3
Water	%	ASTM D6304 >0.05	<b>0.011</b>	▲ 0.077	0.021
ppm Water	ppm	ASTM D6304 >500	<b>116</b>	▲ 774	212.0






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>7643</b>	8395	3470
Particles >6µm	ASTM D7647	>1300	▲ <b>3723</b>	● 2380	837
Particles >14µm	ASTM D7647	>80	▲ <b>730</b>	● 137	33
Particles >21µm	ASTM D7647	>20	▲ <b>176</b>	● 36	6
Particles >38µm	ASTM D7647	>4	▲ <b>5</b>	2	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>20/19/17</b>	● 20/18/14	19/17/12

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.38</b>	0.42	0.32

# OIL ANALYSIS REPORT

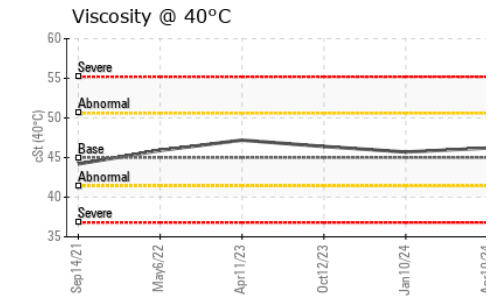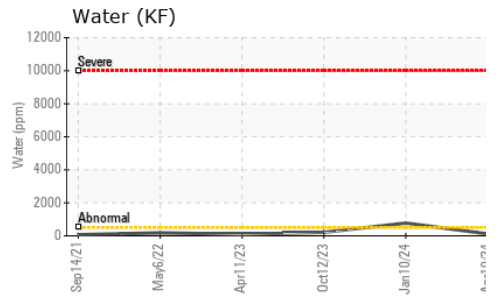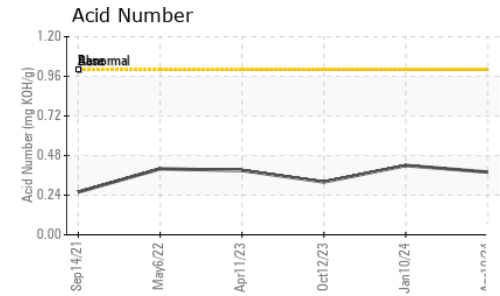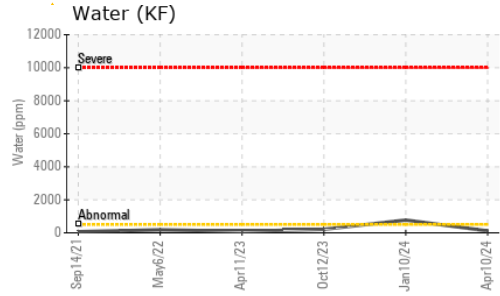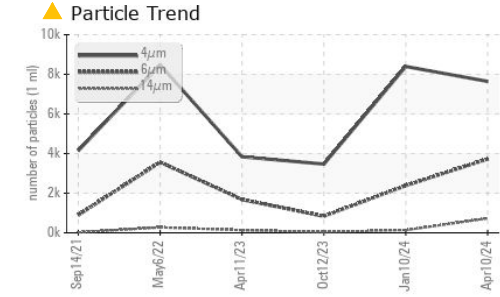





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.2	45.7

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

## GRAPHS

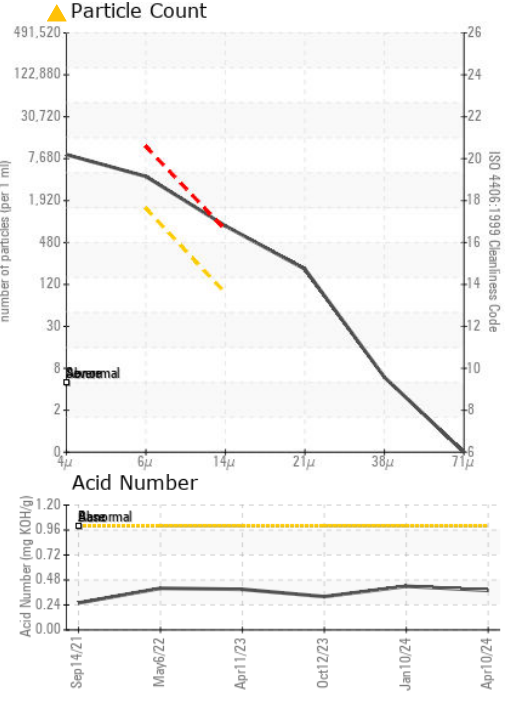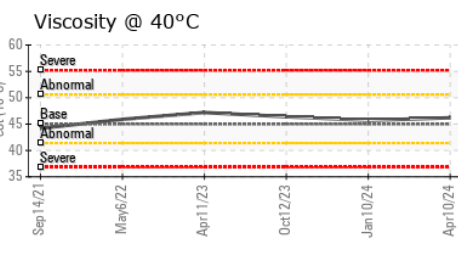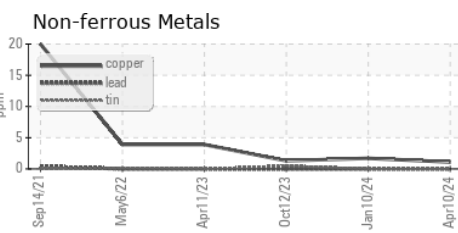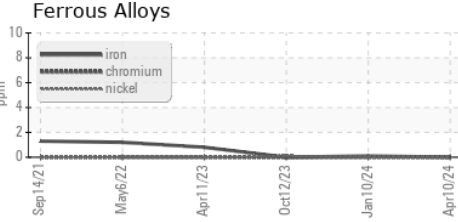

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015344  
**Lab Number** : 06149528  
**Unique Number** : 10979606  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 15 Apr 2024  
**Tested** : 16 Apr 2024  
**Diagnosed** : 17 Apr 2024 - Don Baldrige

**UPS**  
 423 LIBERATOR LN  
 SMYRNA, TN  
 US 37167  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)