


OIL ANALYSIS REPORT

Sample Rating Trend

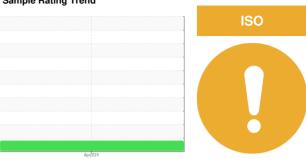

Machine Id

KAESER 1421208

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
OAMBLE INFORM	AATIONI		12 24 7		1111	1::
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017149		
Sample Date		Client Info		10 Apr 2024		
Machine Age	hrs	Client Info		63026		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	32		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	82		
Sulfur	ppm	ASTM D5185m	23500	17797		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	720	28		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.05	0.014		
ppm Water	ppm	ASTM D6304	>500	143		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		15596		
Particles >6µm		ASTM D7647	>1300	2003		
Particles >14µm		ASTM D7647	>80	53		
Particles >21µm		ASTM D7647	>20	10		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>21/18/13</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.35		



OIL ANALYSIS REPORT

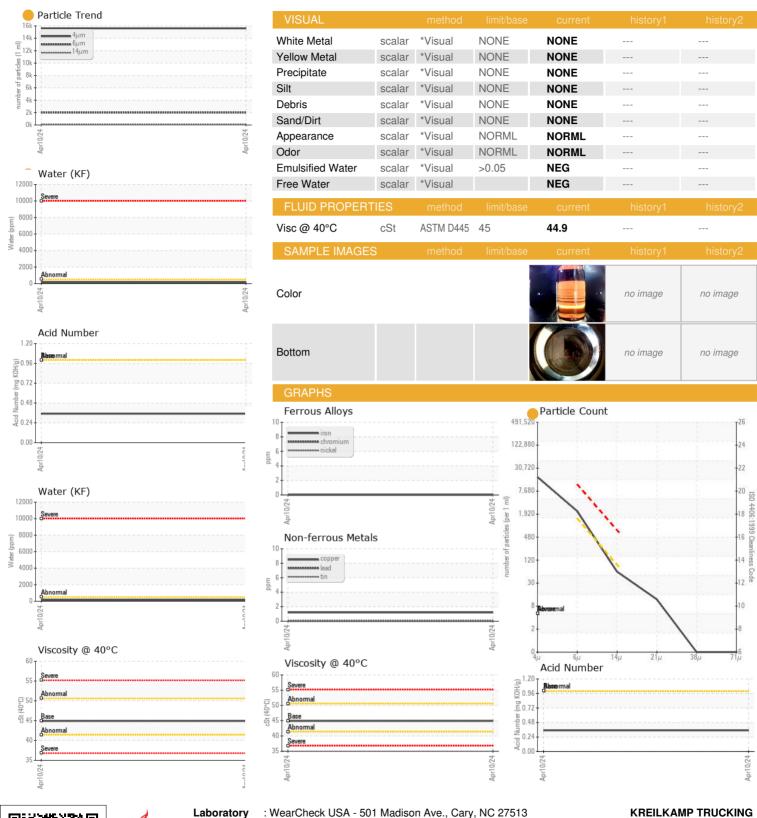





Laboratory Sample No.

: KCPA017149 Lab Number : 06149533

Unique Number : 10979611

Received : 15 Apr 2024 **Tested** Diagnosed

: 16 Apr 2024 : 17 Apr 2024 - Don Baldridge

US 53002 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: KREALL [WUSCAR] 06149533 (Generated: 04/17/2024 23:45:11) Rev: 1

Contact/Location: Service Manager - KREALL

T:

F:

6487 HWY 175

ALLENTON, WI