


OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

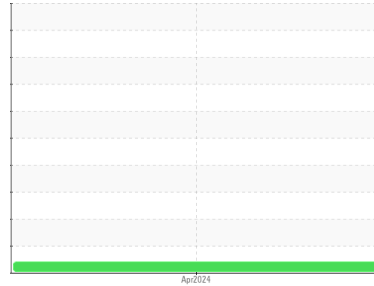

Machine Id
109863
Component
Compressor
Fluid
CIMARRON HB-150 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please note that this is a corrected copy. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

High concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	TO90003992	---	---
Sample Date	Client Info	08 Apr 2024	---	---
Machine Age	hrs	Client Info	0	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	30	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	0	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0	0	---	---
Barium	ppm	ASTM D5185m	0	0	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m	0	0	---	---
Calcium	ppm	ASTM D5185m	0	1	---	---
Phosphorus	ppm	ASTM D5185m	0	64	---	---
Zinc	ppm	ASTM D5185m	0	0	---	---
Sulfur	ppm	ASTM D5185m	0	501	---	---





CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	0	---	---
Sodium	ppm	ASTM D5185m		2	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>2.26	0.472	---	---
ppm Water	ppm	ASTM D6304	>22600	4728	---	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		0.29	---	---
------------------	----------	------------	--	-------------	-----	-----

OIL ANALYSIS REPORT

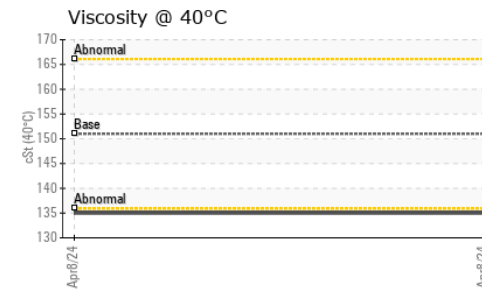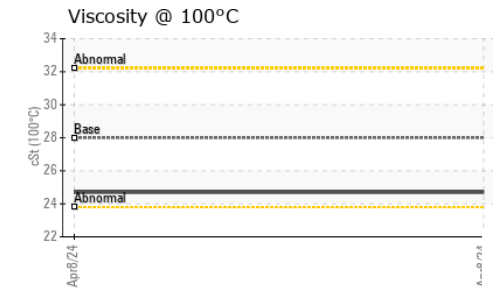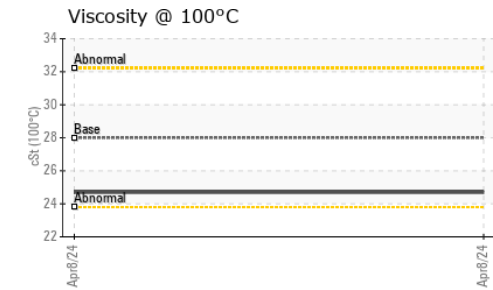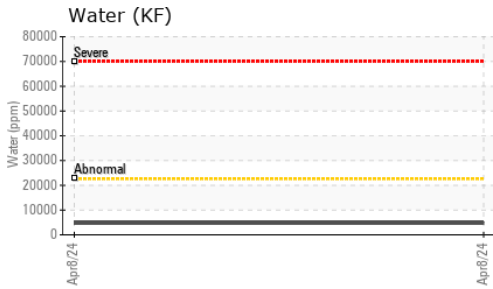




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ HEAVY	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	135	---
Visc @ 100°C	cSt	ASTM D445	28	24.7	---
Viscosity Index (VI)	Scale	ASTM D2270	224	217	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

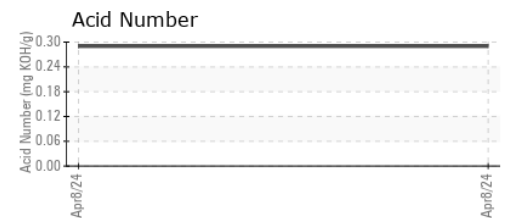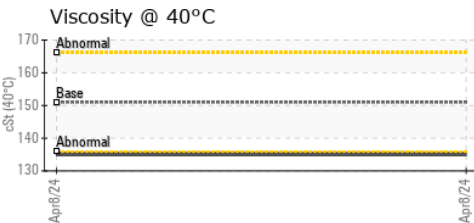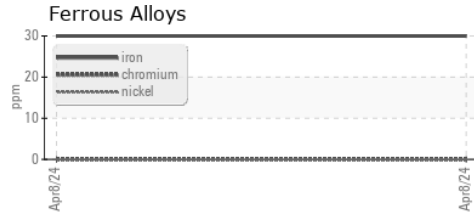

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90003992 **Received** : 15 Apr 2024
Lab Number : 06149549 **Tested** : 14 Jun 2024
Unique Number : 10979627 **Diagnosed** : 14 Jun 2024 - Doug Bogart
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

CIMARRON ENERGY - CARLSBAD
 4425 GRANDI RD, UNIT F
 CARLSBAD, NM
 UM 88220-8923
 Contact: CARLOS LEAL
 cleal@cimarron.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)