

OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

Machine Id

COOLING TOWER 2-2 (S/N 029945)

Gearbox

Fluid **MOBIL DTE OIL HEAVY (2 GAL)**

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

A Wear

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0867566		
Sample Date		Client Info		01 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		17		
Iron	ppm	ASTM D5185m	>30	<u> </u>		
Chromium	ppm	ASTM D5185m	>4	0		
Nickel	ppm	ASTM D5185m	>5	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>5	0		
Aluminum	ppm	ASTM D5185m	>8	1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>8	2		
Tin	ppm	ASTM D5185m	>4	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron		ASTM D5185m		7		
Barium	ppm ppm	ASTM D5185m		0		
Molybdenum		ASTM D5185m		0		
Manganese	ppm ppm	ASTM D5185m		۰ <1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		6		
Phosphorus	ppm	ASTM D5185m		1212		
Zinc	ppm	ASTM D5185m		15		
Sulfur	ppm	ASTM D5185m		6823		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>10	2		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.2	0.017		
ppm Water	ppm	ASTM D6304	>2000	172		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	2418		
Particles >6µm		ASTM D7647	>5000	207		
Particles >14µm		ASTM D7647	>640	9		
Particles >21µm		ASTM D7647	>160	2		
Particles >38µm		ASTM D7647	>40	0		
Particles >71µm		ASTM D7647	>10	0		
Oil Cleanliness		ISO 4406 (c)	>21/19/16	18/15/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	Canta	2.18 ct/l ocation: TEI		

Report Id: KIMPARUS [WUSCAR] 06150323 (Generated: 04/18/2024 15:06:22) Rev: 1

Contact/Location: TERRY BURCHINAL - KIMPARUS Page 1 of 2



OIL ANALYSIS REPORT

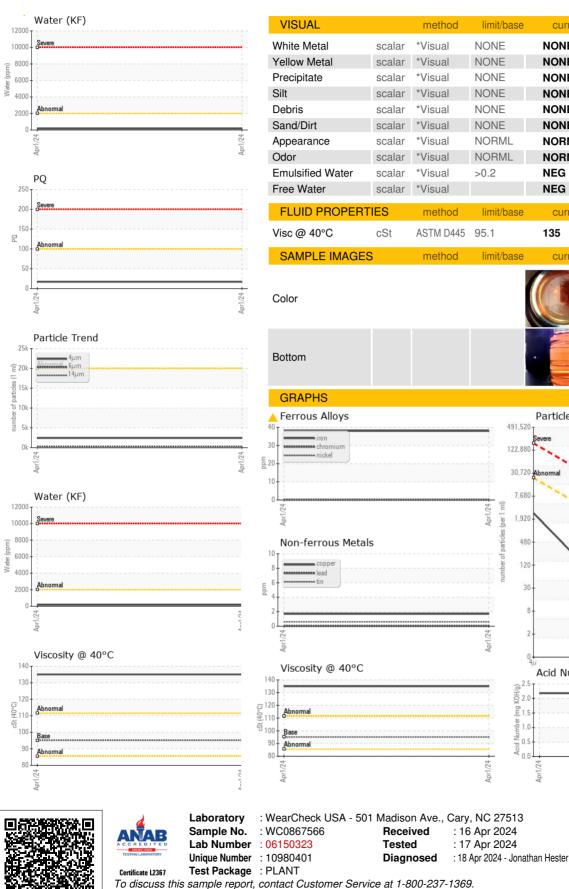

Kimberly-Clark - Paris 2466 FM 137 PARIS, TX US 75460 Contact: TERRY BURCHINAL terry.burchinal@kcc.com T: F:

214

history1

history

history1

no image

no image

current

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

current

current

Particle Count

Acid Number

491,52

122,88

30.72

7.68

1.920

480

120

31

(^B/HOX 2.0

Ē 1.5

-e 1.0

Acid Iv 0.0

0.5

NEG

NEG

135

history2

history

history2

no image

no imade

4406

:1999 Cle

14

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: KIMPARUS [WUSCAR] 06150323 (Generated: 04/18/2024 15:06:22) Rev: 1

Contact/Location: TERRY BURCHINAL - KIMPARUS